





HGP Part Number	HorsePower (HP)	kVar	Harmonic	Voltage (V)	Hz.	Phase
HGP0600CW3----	600	180	5th	600	60	3

HGP Part Number	Schematic Drawing #	Approx Weight (LBS)
HGP0600CW3S0000	29474-4	1176
HGP0600CW3C0000	29474-5	1191
HGP0600CW3C000H	29475-6	1235
HGP0600CWCS1000	29474-PQ1	1178
HGP0600CW3C1000	29474-PQ	1193
HGP0600CW3C100H	29474-PQH	1237

Note: For Torque Information See IOM Manual

Customer Connections.
L1, L2, L3, T1, T2, T3
Wire Range: (Three) 600MCM to 2AWG.

Ground Lug
Wire Range:(Three) 600MCM to 2AWG.

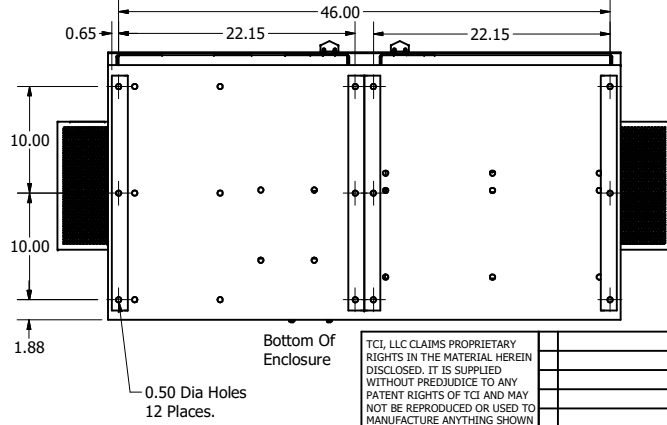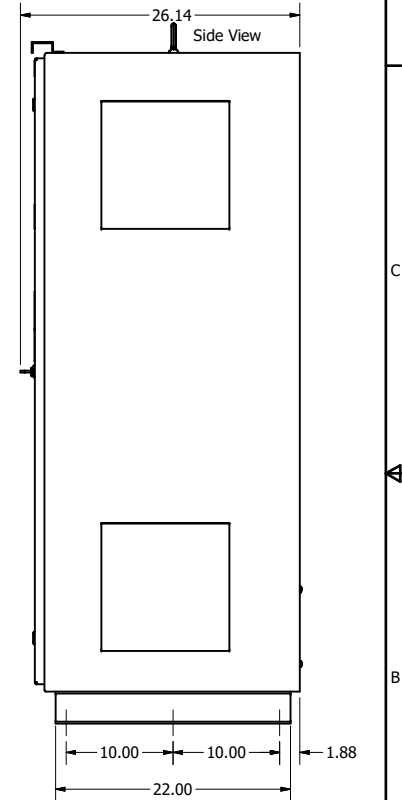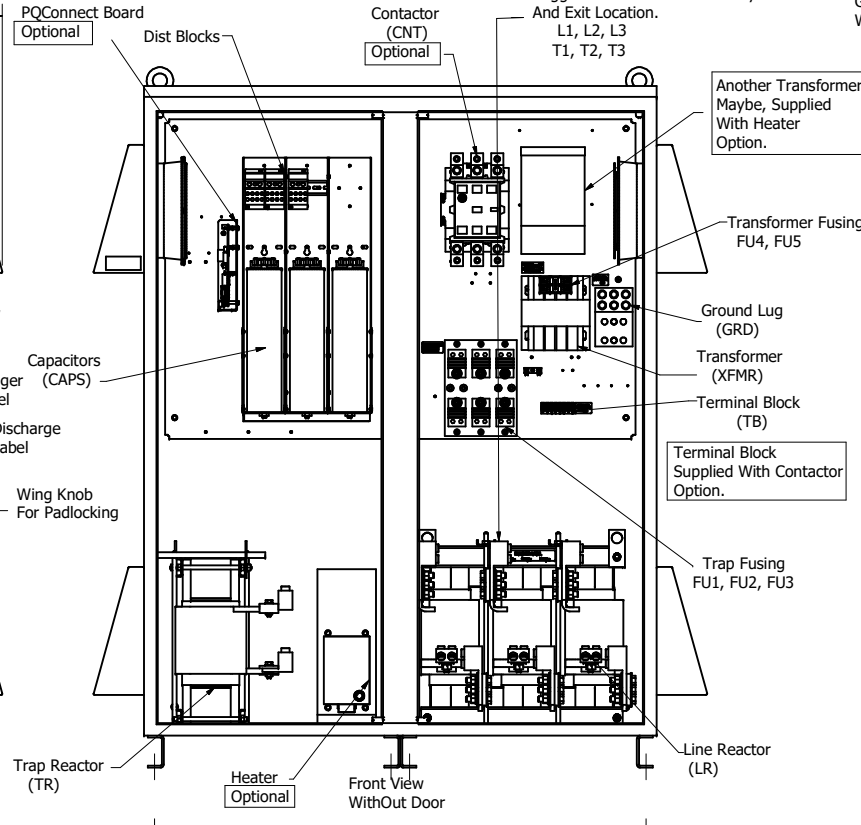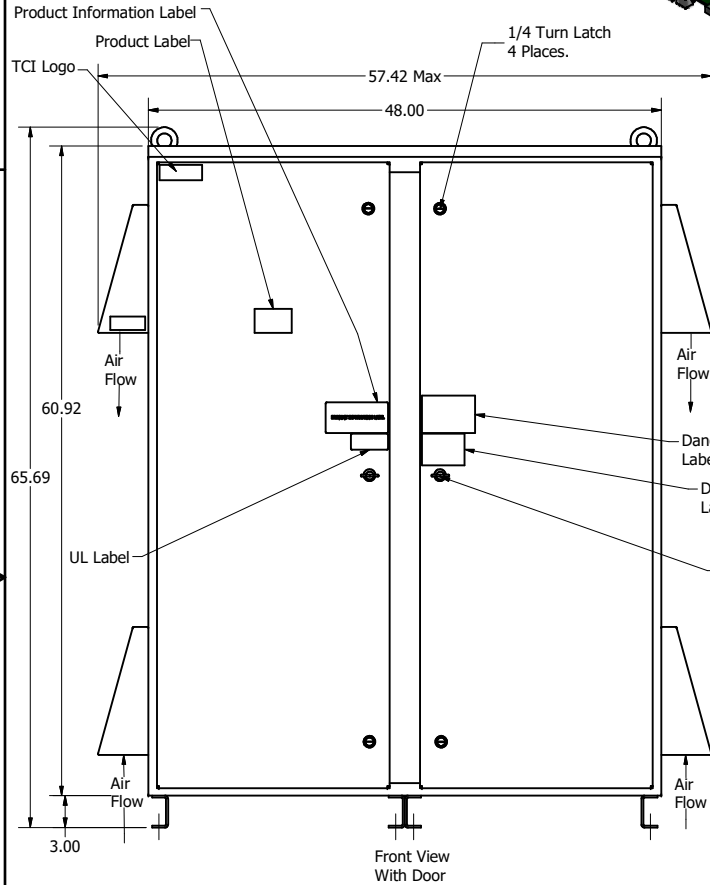

HGP0600CW3----						
Components	S0000	C0000	C000H	S1000	C1000	C100H
Line Reactor (LR)	x	x	x	X	X	X
Trap Reactor (TR)	x	x	x	X	X	X
Capacitor (Cap)	x	x	x	X	X	X
Trap Fusing, FU1, FU2, FU3	x	x	x	X	X	X
Contactor (CNT)		x	x		X	X
Transformer (XFMR)	x	x	x	X	X	X
XFMR Fusing, FU4, FU5	x	x	x	X	X	X
Heater			x			X
PQConnect Board				X	X	X

Customer Is Responsible For Installation to Meet All National And Local Electrical Codes.

NOTE: USE ONLY HUBS OR FITTINGS THAT COMPLY WITH UL514B FOR TYPE 3R ENCLOSURES

Material(s) Shall be RoHS Compliant

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.

TOLERANCES (EXCEPT AS NOTED)				TCI		W132 N10611 Grant Drive Germantown, WI 53022	
DECIMAL				.XX ±.25		.XXX ±.10	
FRACTIONAL				± 1/16		ANGULAR	
± 1°				REVISED		DATE	
B	ADD PQConnect	9/5/18	DSW	DATE	BY	105913DG	DATE
NO	REVISION	DATE	BY	SCALE	1/9	DATE	105913DG