






(Customer Connections) Markings On Terminal Block For Reference Only.

Wire Range: 4-18 AWG.
Torque : 20 IN-LBS (2.3 Nm)

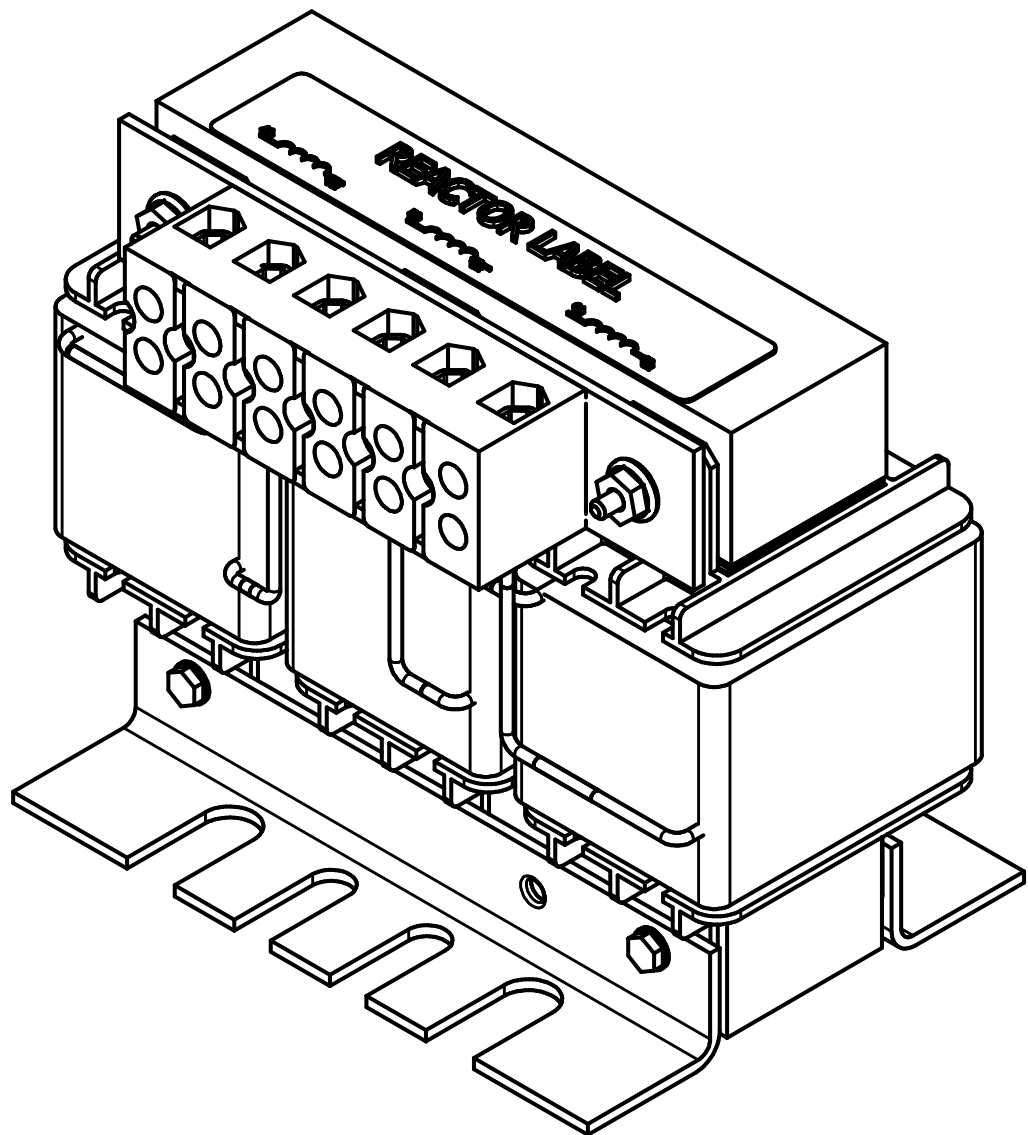

480 Rated Voltage, 600 Max Voltage, High Z, Impedance.						
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)
KDRULE2H	30	40	45	850	16	141

575 Rated Voltage, 600 Max Voltage, High Z, Impedance.						
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)
KDRULE42H	30	32	32	1430	16	140

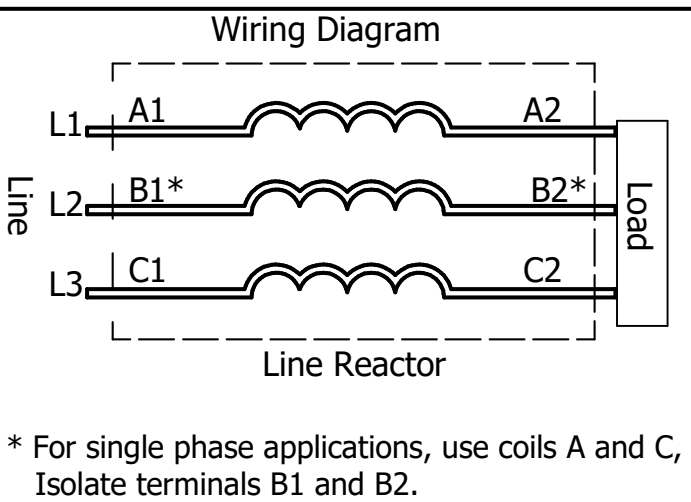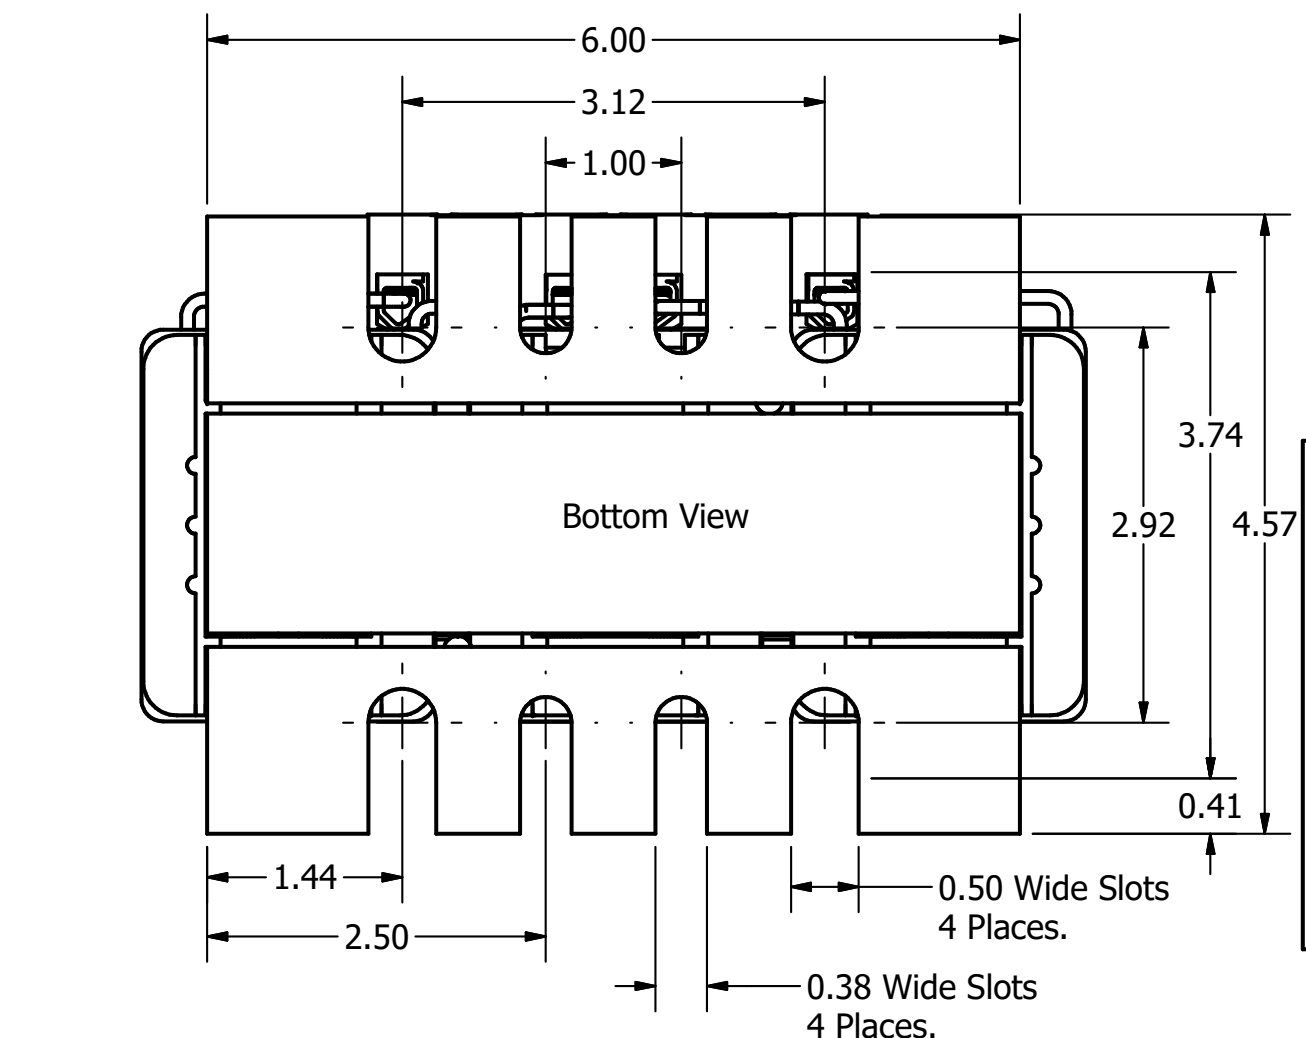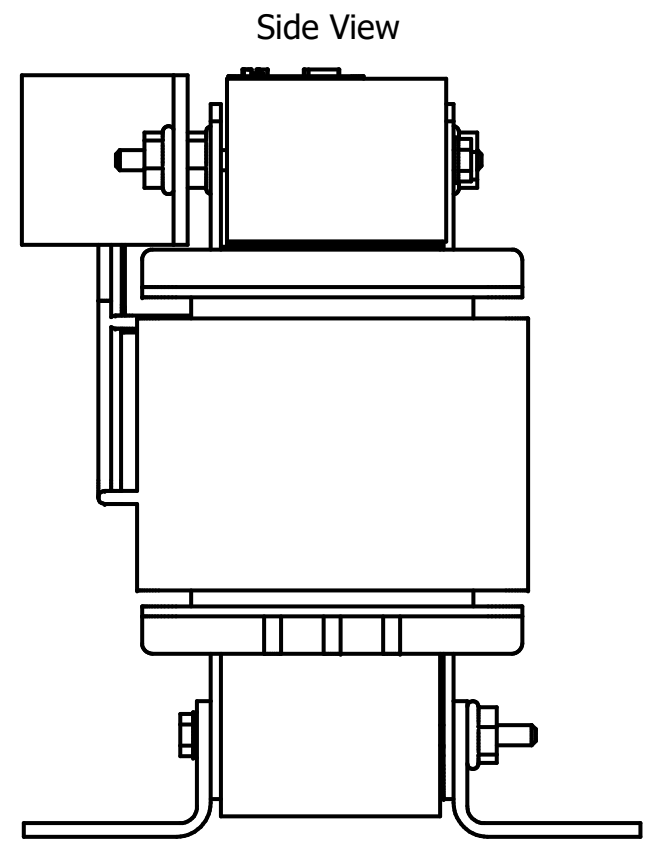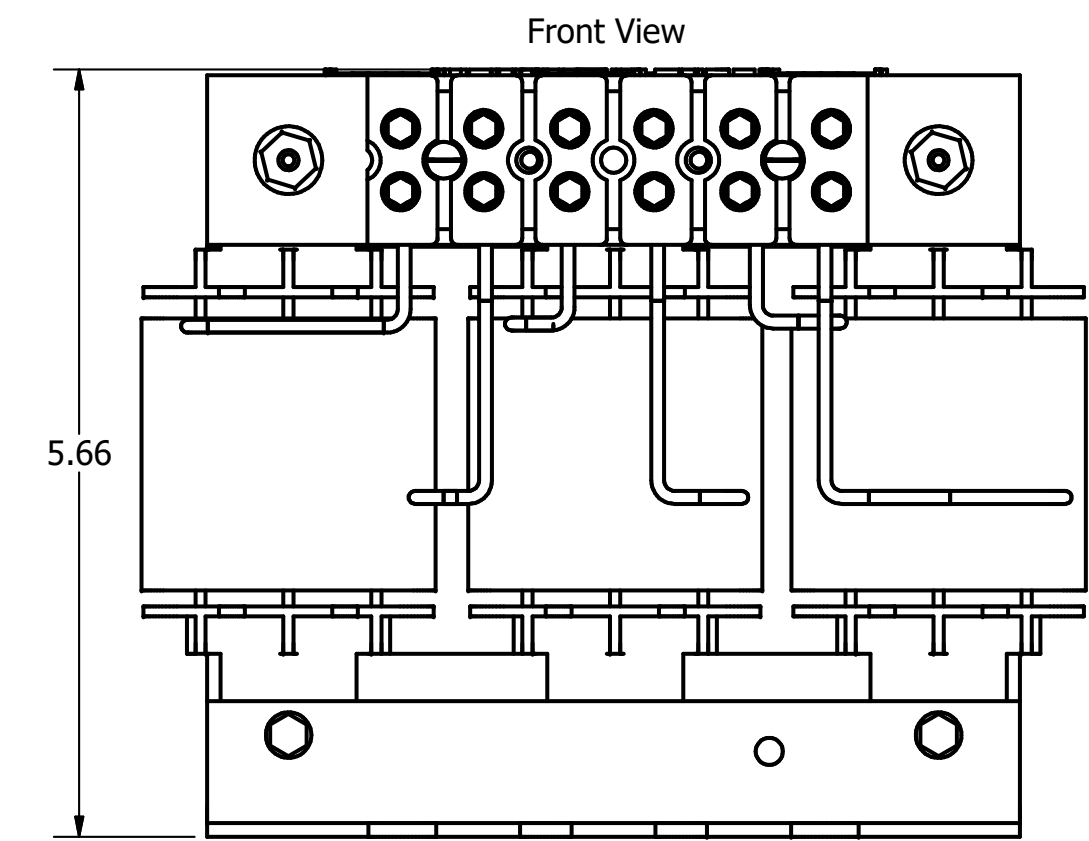

TCI (800) 824-8282 transcoil.com

TCI, LLC
Germanstown, WI, USA.
transcoil.com
800-824-8282

KDRUL Drive Reactor
KDRUL— Motor Amps —
3PH, 50/60Hz, —V Rated, 600V Max, —A Max
40C Amp Max, 135C Rise, RoHS
Term Torque—B-In

UL US LISTED CE
3RD PART. 29, 2010

- Notes:
- UL file number: cULus Listed File E116124.
 - KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 - KDR IOM Manual Part Number 30895
 - Material(s) Shall be RoHS Compliant
 - Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED) DECIMAL XX ± .25 .XXX ± .10 FRACTIONAL ± 1/16 ANGULAR ± 1°		W132 N10611 Grant Drive Germanstown, WI 53022 KDRUL E Frame, Terminal Block Reactor Drawing DRN BY: DSW DATE: 1/22/18 107514DG SCALE: 1:1.5 APRVD: SIZE C SHT. OF 0	
B	4686, TB, Screws Change to 1/8 Hex	5/9/19	DSW				
A	Combined Drawings	1/22/18	DSW				
NO	REVISION	DATE	BY				