


(Customer Connections) Markings On Coils For Reference Only.

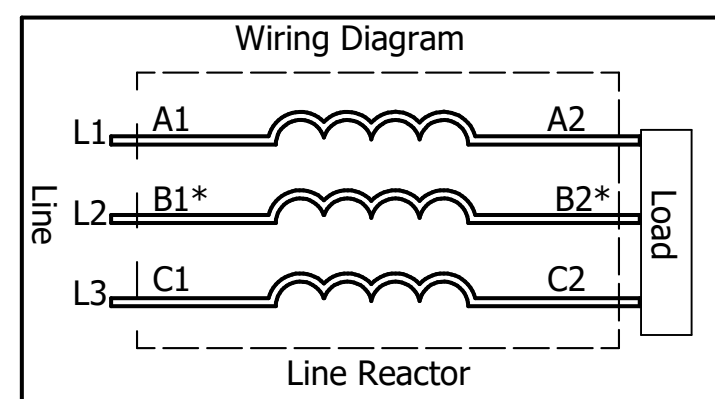

\* For single phase applications, use coils A and C, Isolate terminals B1 and B2.

575 Rated Voltage, 600 Max Voltage, High Z, Impedance.							
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Attached Lug Kit
KDRULG44H	125	125	130	371	67	381	SLK10

480 Rated Voltage, 600 Max Voltage, High Z, Impedance.							
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Attached Lug Kit
KDRULG3H	125	156	160	209	59	274	SLK11

**TCI** (800) 824-8282 [transcoil.com](http://transcoil.com)

TCI, LLC  
 Germantown, WI, USA.  
[transcoil.com](http://transcoil.com)  
 800-824-8282

KDRUL Drive Reactor  
 KDRUL— Motor Amps —  
 3PH, 50/60Hz, —V Rated, 600V Max, —A Max  
 40C Amb Max, 155C Rise, RoHS  
 Term Torque— lb-in

UL LISTED CE  
 AND COMP. EQ. MARK

DATE CODE A1 A2 B1 B2

- Note:
1. UL file number: cULus Listed File E116124.
  2. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
  3. For Terminal Torques And Wire Size See, KDR IOM Manual, Part Number 30895
  4. NEC Current For 208/240 Volts, Horsepower Based On 208 Volts.
  5. Material(s) Shall be RoHS Compliant
  6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.

TOLERANCES (EXCEPT AS NOTED)			
DECIMAL			
	XX ± .25		
	.XXX ± .10		
FRACTIONAL			
	± 1/16		
ANGULAR			
	± 1°		
A	Combined Drawings	3/15/17	DSW
NO	REVISION	DATE	BY

**TCI** W132 N10611 Grant Drive  
 Germantown, WI 53022

KDRUL G Frame, Copper Bus  
 Reactor Drawing

DRN BY: DSW DATE: 3/15/18 107533DG  
 SCALE: 1/2 APRVD: SIZE: C  
 SHT. 2 OF 6