

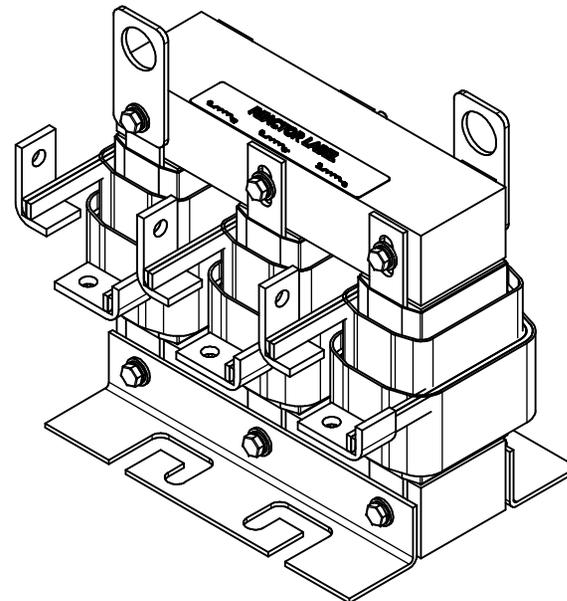
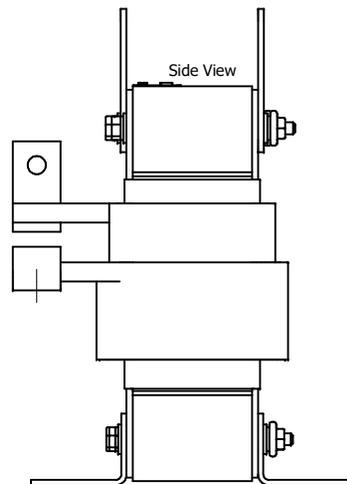


(Customer Connections) Markings On Coils For Reference Only.

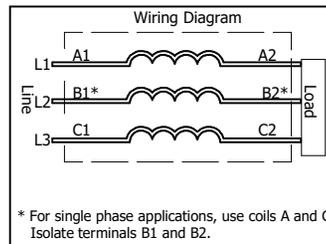

480 Rated Voltage, 600 Max Voltage, High Z, Impedance.							
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Available Lug Kit	Terminal Hole Size (Inches)
KDRG1H	150	180	185	181	60	SLK11	0.38

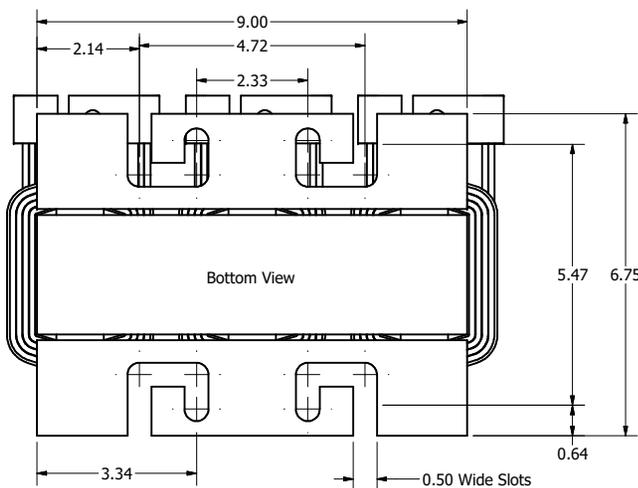

* For single phase applications, use coils A and C, Isolate terminals B1 and B2.

TCL (800) 824-8282 transcoil.com
 TCL, LLC
 Germantown, WI, USA.
 transcoil.com
 800-824-8282

KDRUL Drive Reactor
 KDR - Motor Amps ---
 3PH, 50/60Hz, ---V Rated, 600V Max, -A Max
 40C Amb Max, 150C Rise, RoHS
 Manual #30895 LUG KIT #SLK---

UL LISTED CE
 200-0000-10, 11000

DATE CODE A1 B1 C1

Notes:

1. KDR Lug Kits sold separately. Contact TCL.
2. For KDRUL Version With Terminal Lugs Attached, See Sheet 4
3. UL file number: cULus Listed File E116124.
4. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
5. KDR IOM Manual Part Number 30895
6. NEC Current For 208/240 Volts, Horsepower Based On 208 Volts.
7. Material(s) Shall be RoHS Compliant
8. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.

NO	REVISION	DATE	BY	SCALE
B	5013, DWG was sheet 3	2/25/19	DSW	FRACTIONAL ± 1/32
A	Combine Drawings		DSW	ANGULAR ± 1°
NO				

TCL W132N10611 (Rev 1) Feb 2022
 Germantown, WI 53022
 © 2022 TCL, LLC
 An Official Motion Systems Company
 KDR G Frame, Copper Bus
 Reactor Drawing
 DWN BY: DSW DATE: 12/19/19 107533DG
 SCALE: 1/2 DRAWN BY: DSW
 SHEET 7 OF 8