



480 Rated Voltage, 600 Max Voltage, High Z, Impedance.

Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Available Lug Kit	Terminal Hole Size (Inches)	Losses (W)
KDRG3H	125	156	160	209	54	SLK11	0.28	290

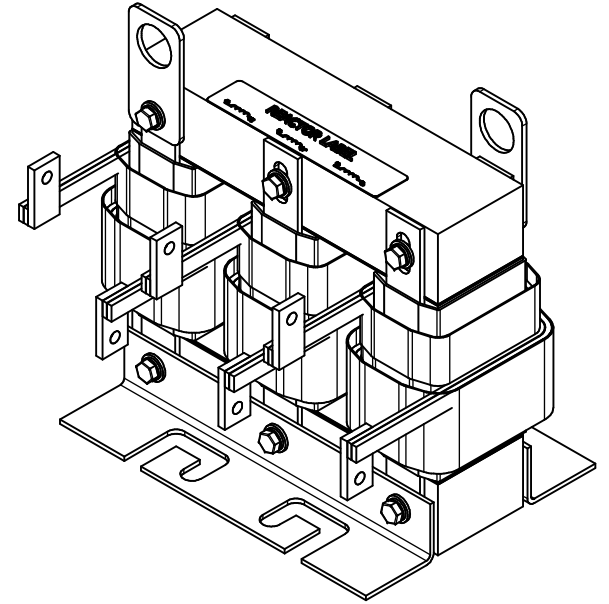

(Customer Connections) Markings On Coils For Reference Only.

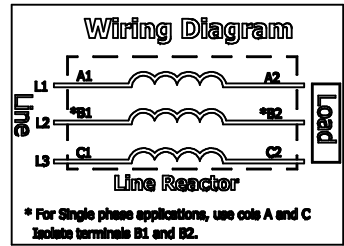

TCL (800) 824-8282 transcoll.com

KDRUL Drive Reactor
 KDR- Motor Amps ---
 3PH, 30/60Hz, ---Y Rated, 600V Max, -A Max
 40C Amb Max, 180C Rise, RoHS
 Manual #30895 LUG KIT #SLK---

UL LISTED CE
 2023 TCI, LLC

DATE CODE: A1 A2 B1 B2 C1 C2

- Notes:
1. KDR Lug Kits sold separately. Contact TCI.
 2. UL file number: cULus Listed File E116124.
 3. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 4. KDR IOM Manual Part Number 30895
 5. Material(s) Shall be RoHS Compliant
 6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/32 ANGULAR ± 1°				W132N10611 (Rev. 11/2023) Germantown, WI 53022 © 2023 TCI, LLC An Official Motion Systems Company KDR G Frame Copper Flag Reactor Drawing DWG BY: DSW DATE: 9/1/2023 107533-9DG SCALE: 1/2 DRAWN: JSE SHEET 1 OF 1	
C	6631 Watts 287 to 290	4/5/2024	DSW						
B	6575 Flag to 32766	2/27/2024	DSW						
A	6400, Bus Bar to Flag Termination	9/1/2023	DSW						
NO	REVISION	DATE	BY						