

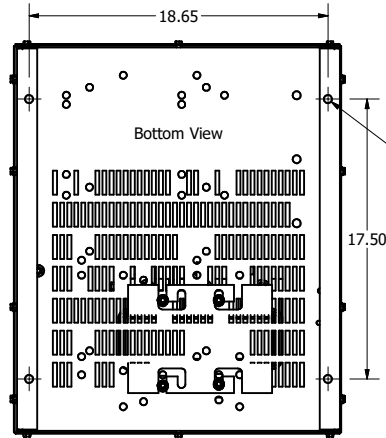
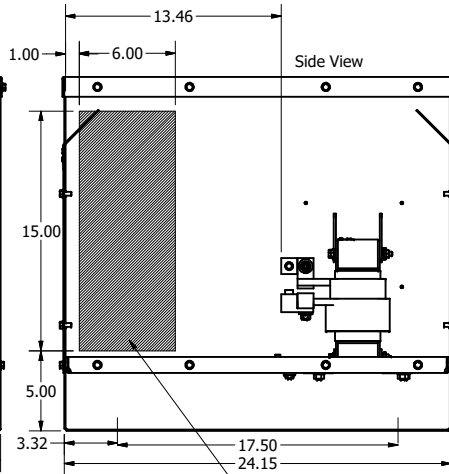
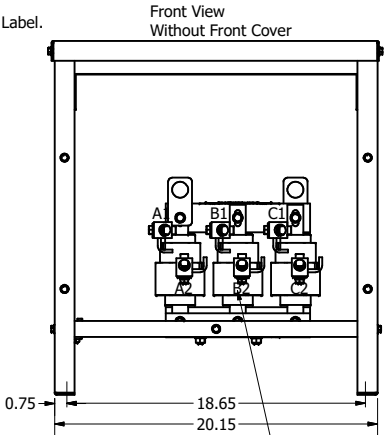
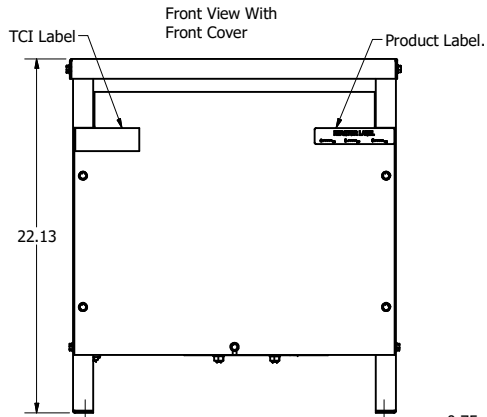
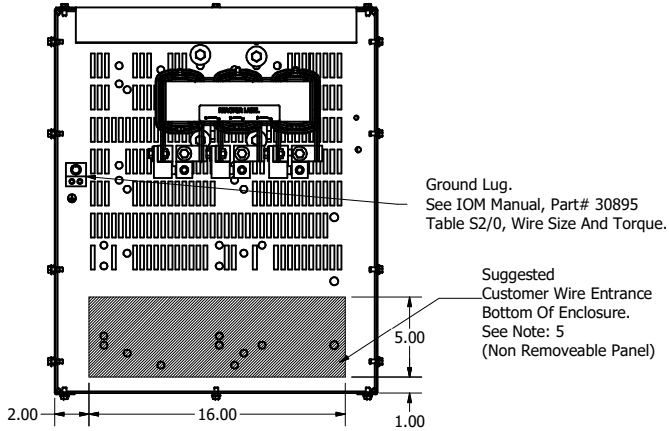


480 Rated Voltage, 600 Max Voltage, High Z, Impedance.							
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Attached Lug Kit
KDRULG1HE01	150	180	185	181	128	359	SLK11

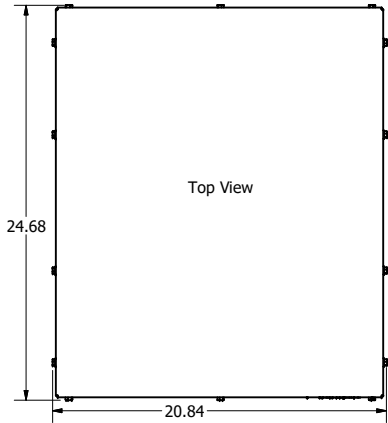

(Customer Connections) Markings On Reactor For Reference Only.

Suggested Customer Entrance Either Side Of Enclosure. See Note: 5 (Non Removeable Panel)

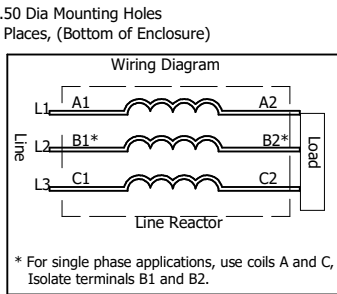

TCI (800) 824-8282 transcoil.com

TCI, LLC
Germantown, WI, USA.
transcoil.com
800-824-8282

KDRULG Drive Reactor
KDR- Motor Amps ---
SPL, 480V/600V, -17 Rated, 600V Max, -A Max
40C Amps Max, 1/20C Max, Part 10
Mount 600V LUG KIT 0812

UL cULus CE

DATE CODE

- Note: 1. UL file number: cULus Listed File E116124.
2. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
3. For Terminal Torques And Wire Size See, KDR IOM Manual, Part Number 30895
4. Material(s) Shall be RoHS Compliant
5. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.

NO	REVISION	DATE	BY	TOLERANCES (EXCEPT AS NOTED)
				DECIMAL
				.XX ± .25
				.XXX ± .10
				FRACTIONAL
				± 1/16
				ANGULAR
				± 1°

TCI W132 N10611 Grant Drive
Germantown, WI 53022

KDRUL G Frame, Copper Bus, Enclosed
Type 1, Reactor Drawing

DRN BY: DSW DATE: 12/20/19 107610DG
SCALE: 1/6 DRAWN BY: DSW
NO. OF SHEETS: 8 OF 8