


208/240 Rated Voltage, 600 Max Voltage, High Z, Impedance.

Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)	Available Lug Kit	Terminal Hole Diameter (Inches)
KDRH23H	60	169	169	103	220	37	SLK21	0.28

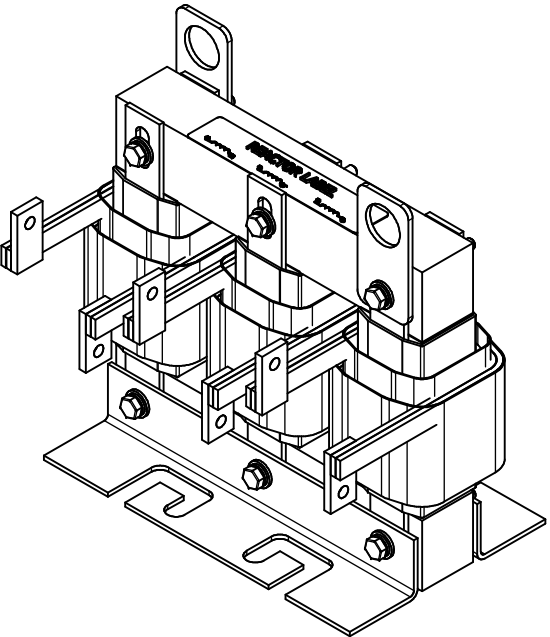

(Customer Connections) Markings On Coils For Reference Only.

TCI (800) 824-8282 transcoil.com


TCI, LLC
 Germantown, WI, USA
 transcoil.com
 800-824-8282

KDRH Drive Reactor
 KDR - Motor Amps -
 3PH, 50/60Hz, -V Rated, 600V Max, -A Max
 40C Amb Max, 150C Rise, Not IS
 Manual #30895 LUG KIT #SLK-

UL LISTED CE
 2024 TCI, LLC

DATE CODE A1 A2 B1 B2 C1 C2

- Notes:
1. KDR Lug Kits sold separately. Contact TCI.
 2. UL file number: cULus Listed File E116124.
 3. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 4. KDR IOM Manual Part Number 30895
 5. Material(s) Shall be RoHS Compliant
 6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

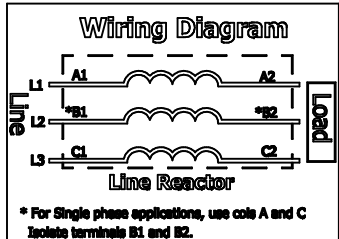

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/32 ANGULAR ± 1°				W132N10611 (Rev 13 Feb 2024) Germantown, WI 53022 © 2024 TCI, LLC An Allied Motion Company KDR H Frame, (Flag Version) Reactor Drawing DWG BY: DSW DATE: 1/10/2024 107589-9DG SCALE: 1/2 DRAWN: JSC SHEET 1 OF 1	
B	6550, Add Lift Rings	1/30/2024	DSW						
A	6555, Copper bus to flag Terminals	1/10/2024	DSW						
NO	REVISION	DATE	BY						