




480 Rated Voltage, 600 Max Voltage, Output								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Available Lug Kit	Terminal Hole Size (Inches)
KDRI2PE01	150	180	200	52	116	135	SLK11	0.38

575 Rated Voltage, 600 Max Voltage, Output								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Available Lug Kit	Terminal Hole Size (Inches)
KDRI32PE01	200	192	200	52.9	111	135	SLK11	0.38

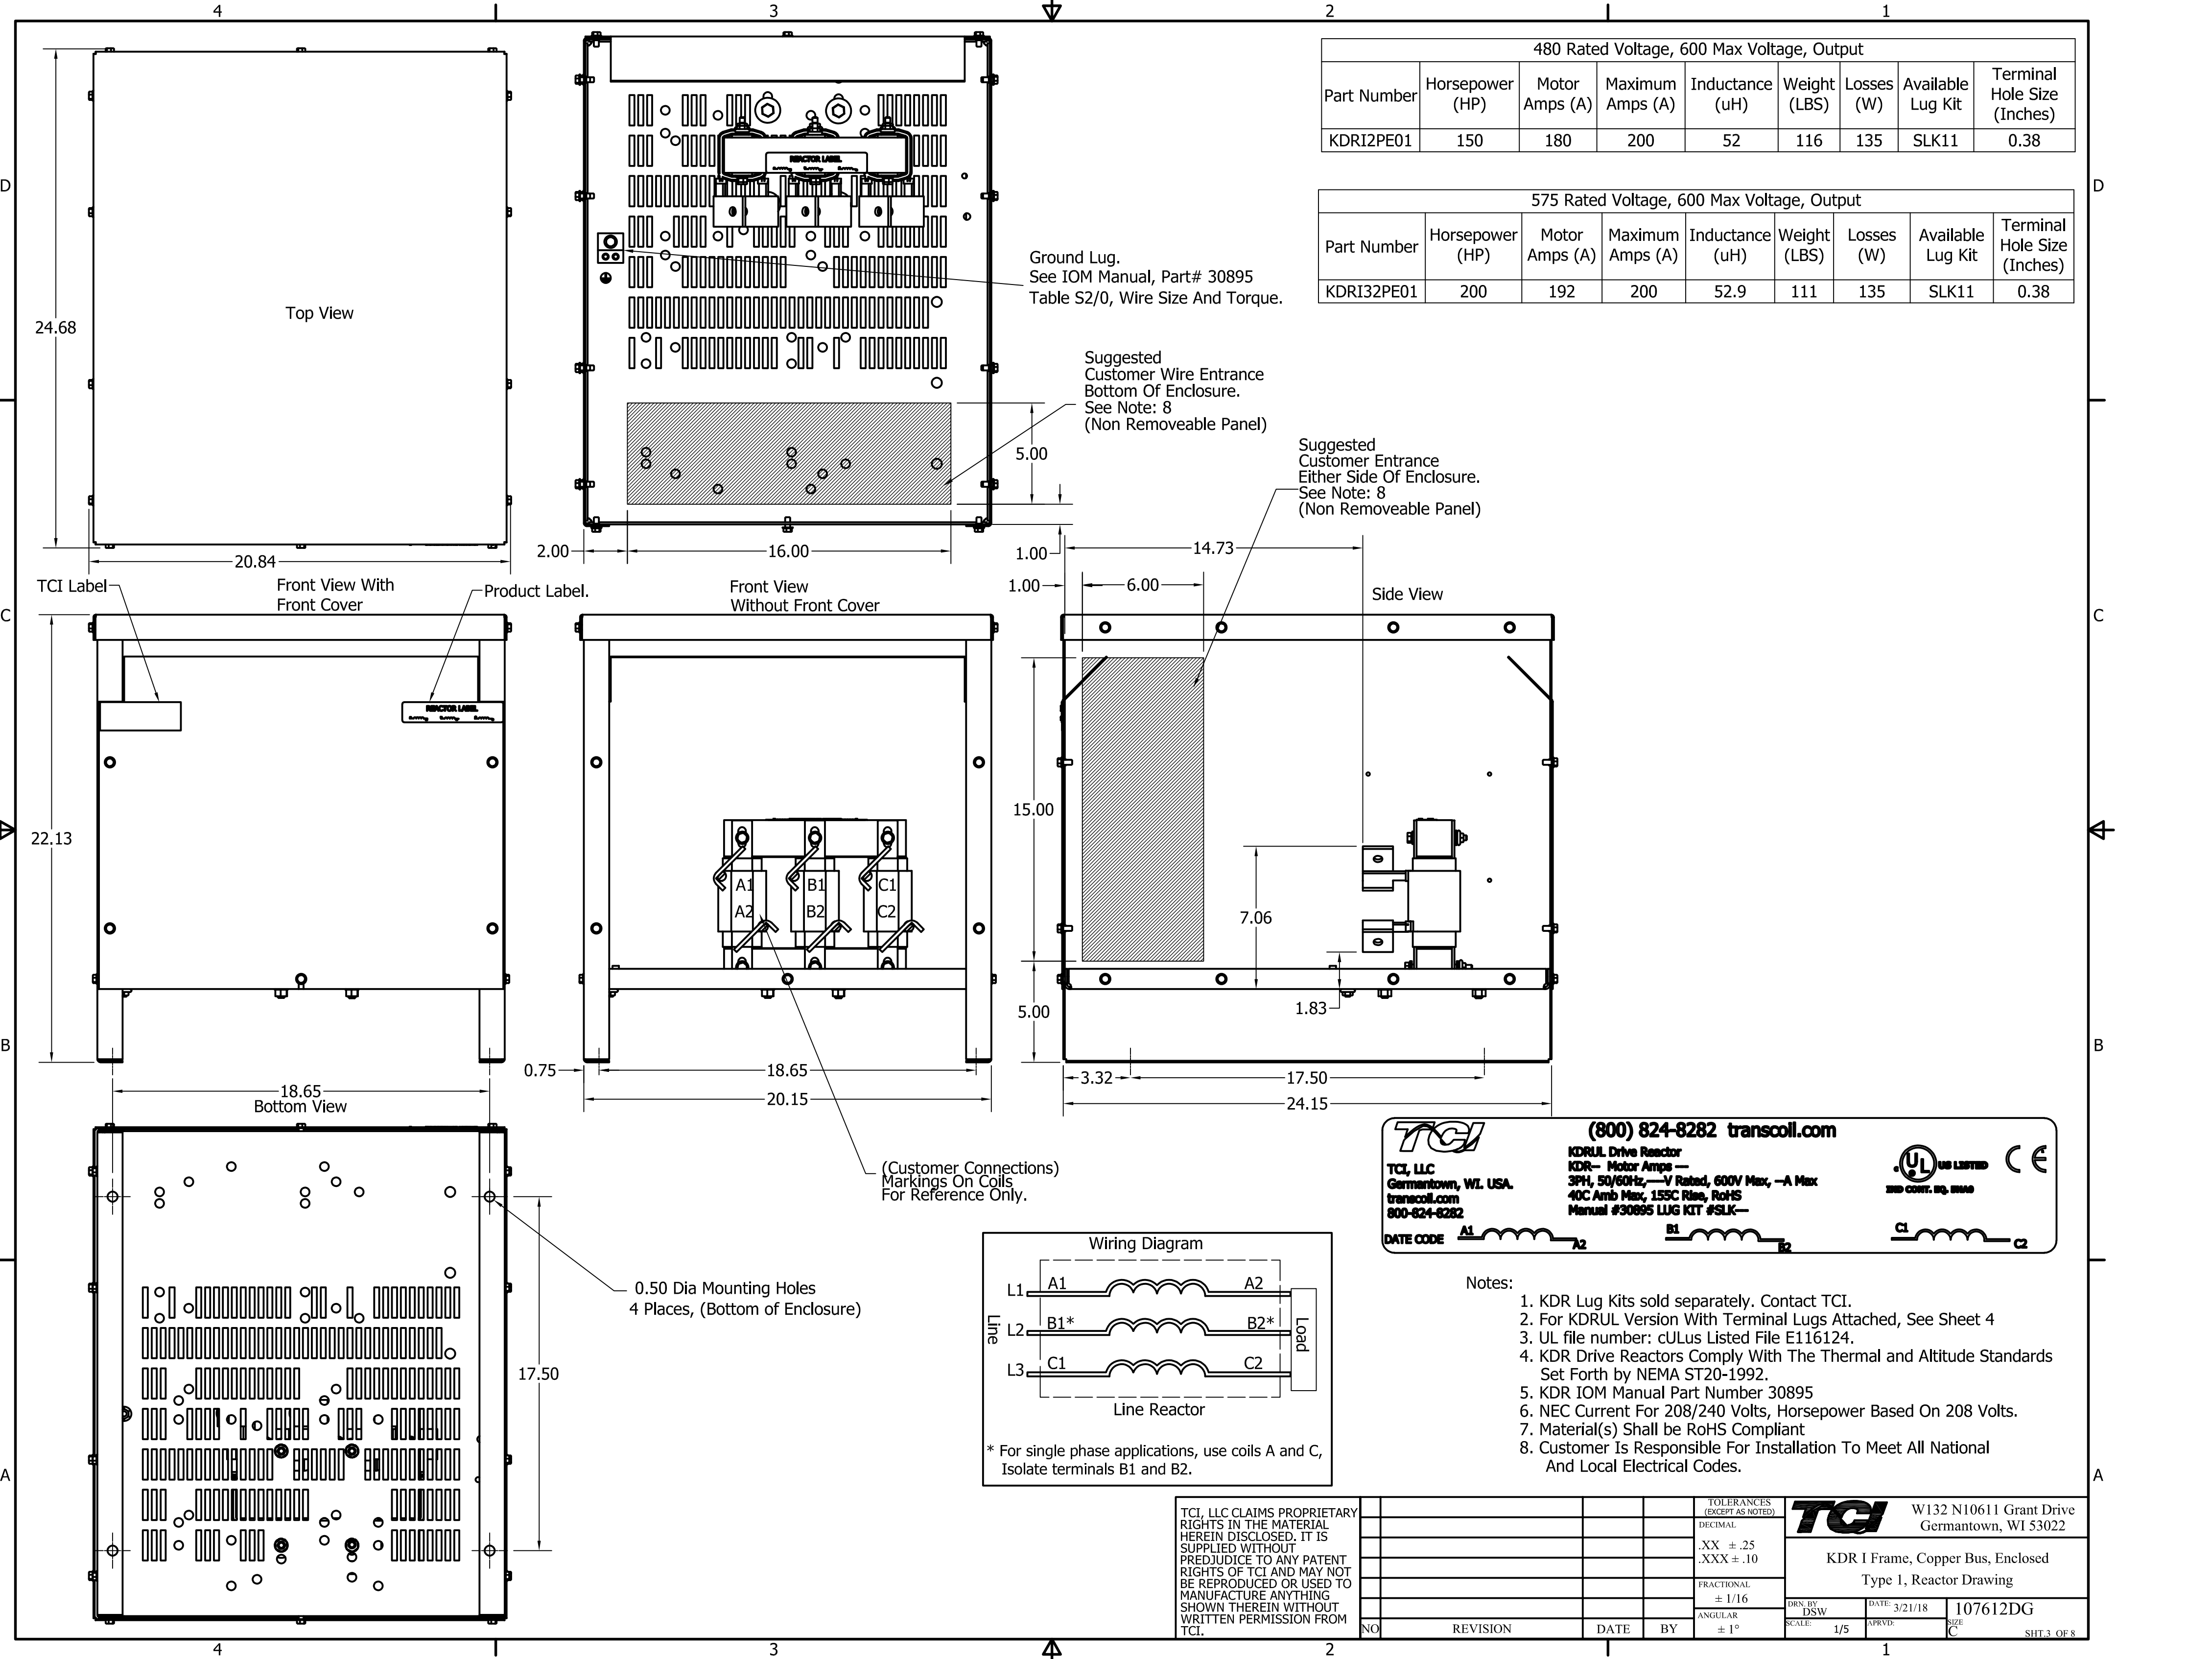

TCI, LLC
Germantown, WI, USA.
transcoil.com
800-824-8282

(800) 824-8282 transcoil.com

KDRUL Drive Reactor
KDR— Motor Amps —
3PH, 50/60Hz,—V Rated, 600V Max, —A Max
40C Amb Max, 155C Rise, RoHS
Manual #30895 LUG KIT #SLK—



and CONT. SQ. INCH

DATE CODE



- Notes:
1. KDR Lug Kits sold separately. Contact TCI.
 2. For KDRUL Version With Terminal Lugs Attached, See Sheet 4
 3. UL file number: cULus Listed File E116124.
 4. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 5. KDR IOM Manual Part Number 30895
 6. NEC Current For 208/240 Volts, Horsepower Based On 208 Volts.
 7. Material(s) Shall be RoHS Compliant
 8. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.					TOLERANCES (EXCEPT AS NOTED)	 W132 N10611 Grant Drive Germantown, WI 53022		
					DECIMAL	KDR I Frame, Copper Bus, Enclosed Type 1, Reactor Drawing		
					.XX ± .25			
					.XXX ± .10			
					FRACTIONAL			
					± 1/16	DRN. BY: DSW DATE: 3/21/18 107612DG		
					ANGULAR			
					± 1°	SCALE: 1/5 APRVD: SIZE C		
	NO	REVISION	DATE	BY		SHT. 3 OF 8		