




480 Rated Voltage, 600 Max Voltage, Low Z, Impedance.								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Available Lug Kit	Terminal Hole Size (Inches)
KDRL3L	600	720	750	26	105	510	SLK15	0.53 x 1.00 Slot

575 Rated Voltage, 600 Max Voltage, Low Z, Impedance.								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Available Lug Kit	Terminal Hole Size (Inches)
KDRL43L	700	672	675	34	120	590	SLK15	0.53 x 1.00 Slot

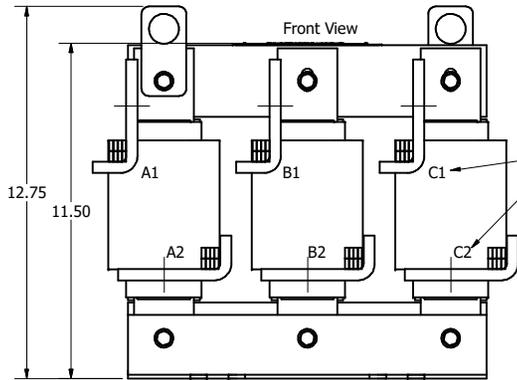

0.53 X 1.00 Slots  
6 Places

(Customer Connections)  
Markings On Coils  
For Reference Only.

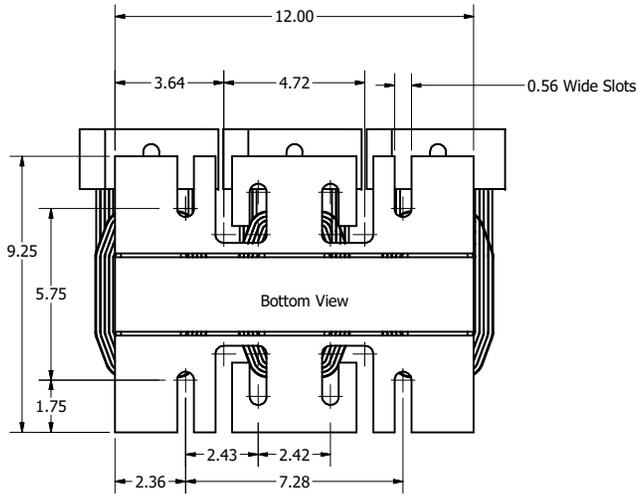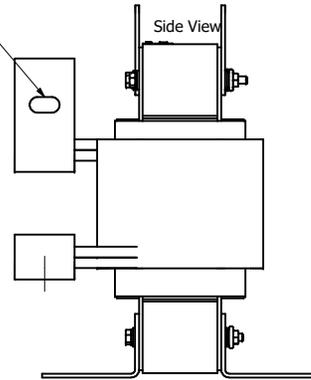


**TGI** (800) 824-8282 [transcoil.com](http://transcoil.com)

**TCI, LLC**  
Germanstown, WI, USA.  
[transcoil.com](http://transcoil.com)  
800-824-8282

**KDRL Drive Reactor**  
KDR - Motor Amps ---  
3P4, 50/60Hz, ---V Rated, 600V Max, -A Max  
40C Amb Max, 150C Rise, RoHS  
Manual #30895 LUG KIT #SLK---

UL LISTED CE  
200 0207, 10, 1000

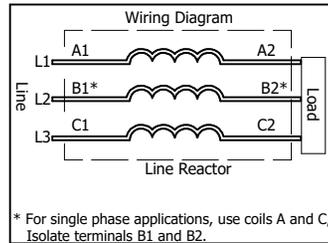

Notes:

1. KDR Lug Kits sold separately. Contact TCI.
2. For KDRUL Version With Terminal Lugs Attached, See Sheet 8
3. UL file number: cULus Listed File E116124.
4. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
5. KDR IOM Manual Part Number 30895
6. NEC Current For 208/240 Volts, Horsepower Based On 208 Volts.
7. Material(s) Shall be RoHS Compliant
8. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.

REV	DATE	BY	DESCRIPTION
B	5/10, L3L, L43L, Term updated	2/10/2021	DSW
NO	REVISION	DATE	BY

TOLERANCES (EXCEPT AS NOTED)	
DECIMAL	.XX ± .25 .XXX ± .10
FRACTIONAL	± 1/16
ANGULAR	± 1°

**TGI** W132N10611 Grant Drive  
Germanstown, WI 53022  
© 2021 TCI, LLC

An Official **Motion Company**

KDR L-Frame, Copper Bus  
Reactor Drawing

DRN BY: DSW DATE: 3/23/18 FILE: 107537DG  
SCALE: 1/3.2 DRAWN BY: CJC SHEET 7 OF 10