
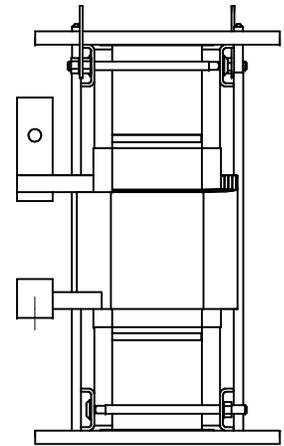
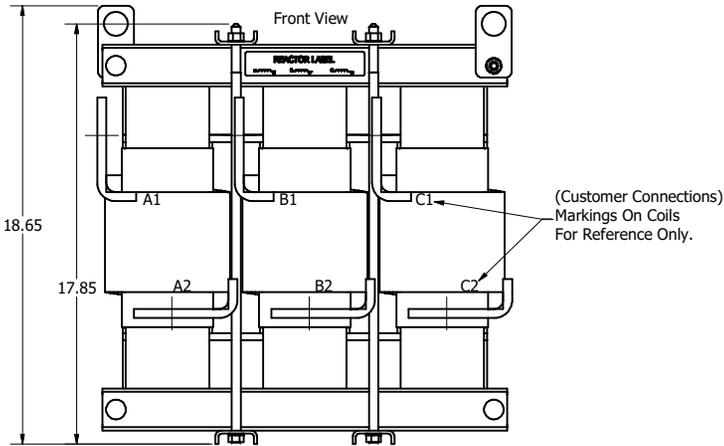
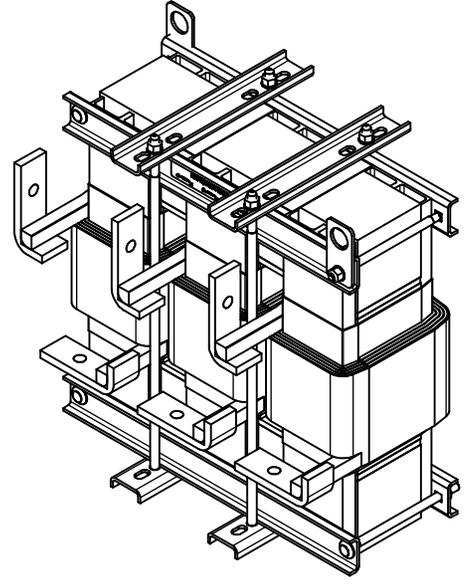


575 Rated Voltage, 600 Max Voltage, High Z, Impedance.							
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Available Lug Kit	Terminal Hole Size (Inches)
KDRX45H	700	672	760	57	280	SLK15	0.53

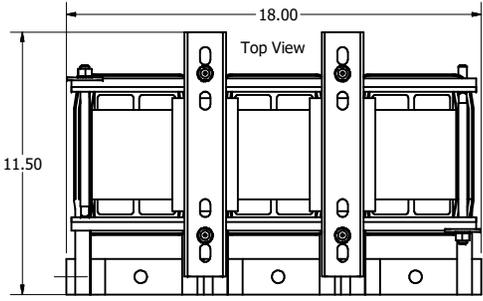



TCL (800) 824-8282 transcoll.com

TCL, LLC
Germanstown, WI, USA
transcoll.com
800-824-8282

KDRUL Drive Reactor
KDR - Motor Amps ---
3PH, 50/60Hz, ---V Rated, 600V Max, -A Max
40C Amp Max, 155C Min, RoHS
Manual #30895 LUG KIT #SLK---

UL 100 LUGS CE
200 CONT. 10, 1500

DATE CODE A1 B1 C1

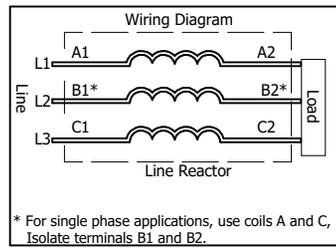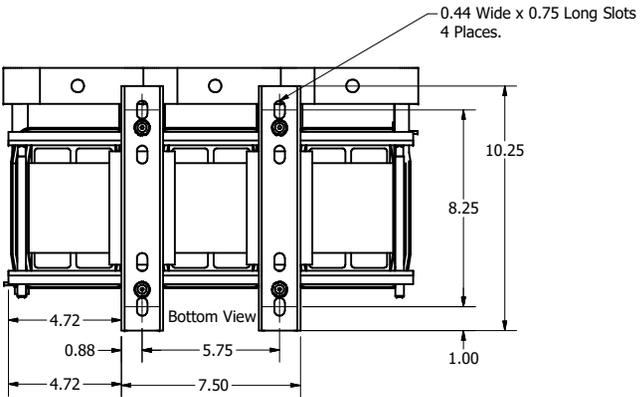

- Notes:
1. KDR Lug Kits sold separately. Contact TCL.
 2. For KDRUL Version With Terminal Lugs Attached, See Sheet 6
 3. UL file number: cULus Listed File E116124.
 4. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 5. KDR IOM Manual Part Number 30895
 6. NEC Current For 208/240 Volts, Horsepower Based On 208 Volts.
 7. Material(s) Shall be RoHS Compliant
 8. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .02 .XXX ± .10 FRACTIONAL ± 1/16 ANGULAR ± 1°				W132N10611 (Rev 1) Feb 2021 Germanstown, WI 53022 © 2021 TCL, LLC An Official Motors Company KDR X Frame, Copper Bus Reactor Drawing DWG BY: DSW DATE: 3/5/2018 107539-5DG SCALE: 1:3.2 DRAWN BY: DSW SHEET: 5 OF 6	
B	5796, Title blk updated, chg lift ring sides	12/8/2021	DSW						
A	Combined Drawings	3/5/2018	DSW						
NO	REVISION	DATE	BY						