
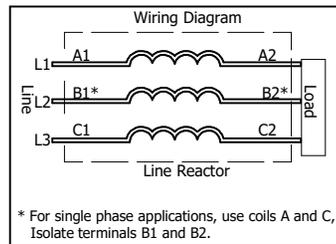
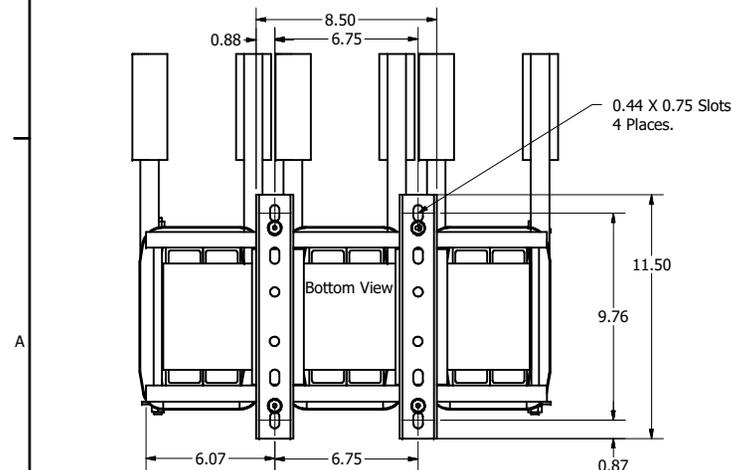


575 Rated Voltage, 600 Max Voltage, High Z, Impedance.								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Available Lug Kit	Terminal Hole Size (Inches)
KDRY42H	1500	1440	1500	26.6	575	2985	SLK18	0.53

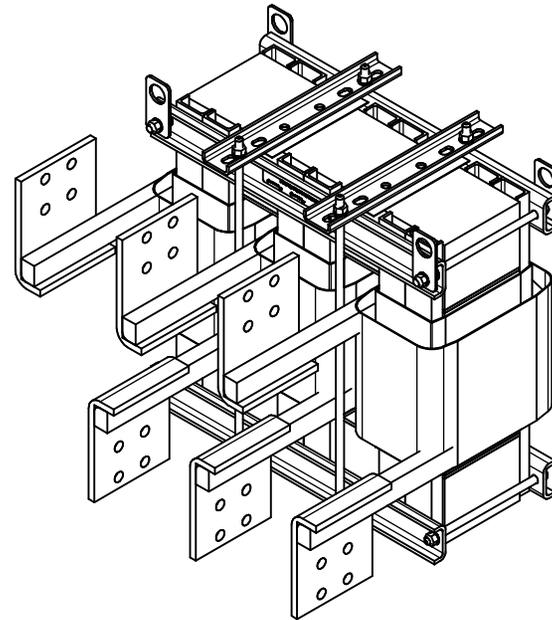

TCI (800) 824-8282 transcoil.com

KDRUL Drive Reactor
 KDR - Motor Amps -
 3PH, 600Hz, -V Rated, 600V Max, -A Max
 40C Amb Max, 150C Rise, RoHS
 Manual #30895 LUG KIT #SLK-

DATE CODE **A1** **B2** **C1** **C2**

- Notes:
1. KDR Lug Kits sold separately. Contact TCI.
 2. For KDRUL Version With Terminal Lugs Attached, See Sheet 4
 3. UL file number: cULus Listed File E116124.
 4. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 5. KDR IOM Manual Part Number 30895
 6. Material(s) Shall be RoHS Compliant
 7. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .03 .XXX ± .010 FRACTIONAL ± 1/32 ANGULAR ± 1°				W182N10611 (Rev 11/16) Germantown, WI 53022 © 2022 TCI, LLC An <i>Advanced Motion Company</i> KDR Y-Frame, Copper Bus Reactor Drawing	
A	Combined drawings	3/5/18	DSW	DATE	BY	SCALE: 1/4.5	DATE: 3/5/18	REVISED	107540DG
NO	REVISION	DATE	BY	DATE	BY	SCALE	DATE	REVISED	SHT 3 OF 6