

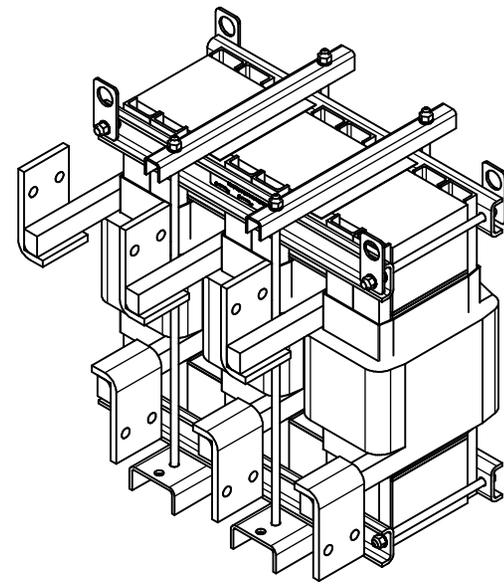


480 Rated Voltage, 600 Max Voltage, High Z, Impedance.								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Available Lug Kit	Terminal Hole Size (Inches)
KDRY2H	1100	1320	1350	23.7	550	2284	SLK19	0.56

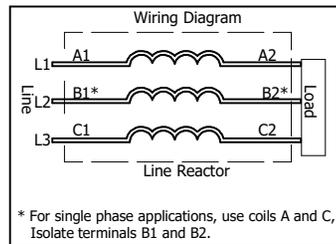

(Customer Connections) Markings On Coils For Reference Only.

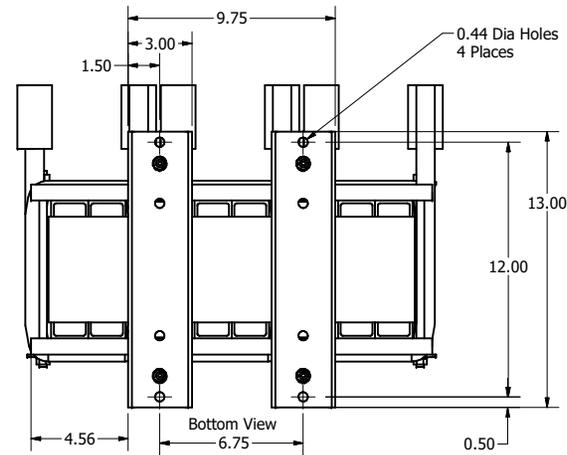

\* For single phase applications, use coils A and C, Isolate terminals B1 and B2.

**TCL** (800) 824-8282 transcoil.com  
 TCI, LLC  
 Germantown, WI, USA  
 transcoil.com  
 800-824-8282

KDRUL Drive Reactor  
 KDR— Motor Amps —  
 3PH, 480V/600V Rated, 600V Max, -A Max  
 40C Amb Max, 155C Rise, RoHS  
 Manual #30896 LUG KIT #SLK—

UL LISTED CE  
 2002, 2018, 2020

DATE CODE A1 B1 C1

- Notes:
1. KDR Lug Kits sold separately. Contact TCI.
  2. For KDRUL Version With Terminal Lugs Attached, See Sheet 4
  3. UL file number: cULus Listed File E116124.
  4. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
  5. KDR IOM Manual Part Number 30895
  6. Material(s) Shall be RoHS Compliant
  7. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.

NO	REVISION	DATE	BY
A	Combined drawings	3/5/18	DSW

**TCL** W132N10611 (Rev. 11/16)  
 Germantown, WI 53022  
 © 2022 TCI, LLC  
 An Allied Motion Company  
 KDRUL Y Frame, Copper Bus  
 Reactor Drawing  
 DWG BY: DSW DATE: 3/5/18 107540DG  
 SCALE: 1/4.5 DRAWN BY: CJC SHEET 5 OF 6