
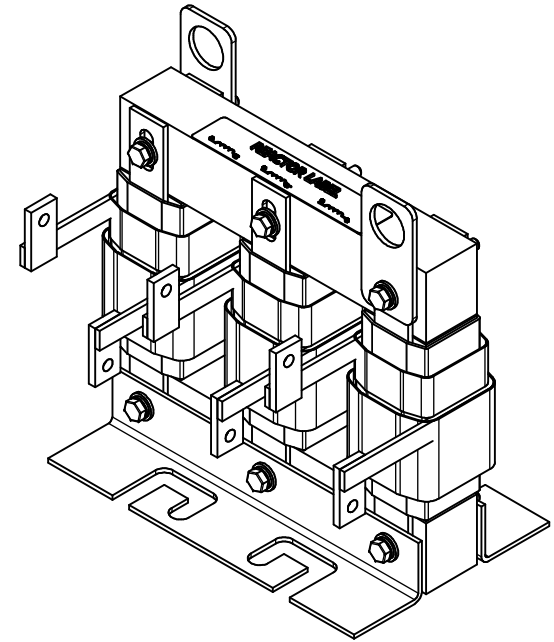


(Customer Connections)
Markings On Coils
For Reference Only.

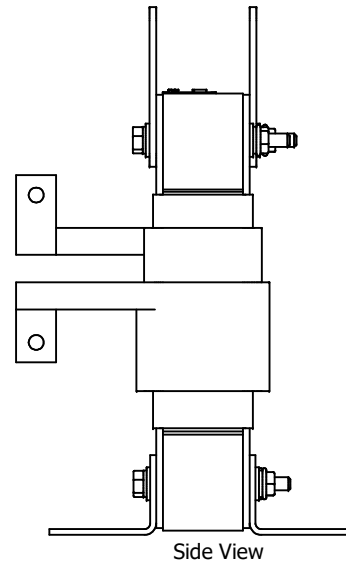

TCI (800) 824-8282 transcoll.com
 TCI, LLC
 Germantown, WI, USA.
 transcoll.com
 800-824-8282


KDRUL Drive Reactor
 KDR- Motor Amps ---
 3074, 50/60Hz, ---Y Rated, 600V Max, -A Max
 400 Arms Max, 150C Rise, R410
 Manual #30895 LUG KIT #SLK-

UL LISTED
 cULus Listed File E116124
 © 2024 TCI, LLC

DATE CODE

Notes:

1. KDR Lug Kits sold separately. Contact TCI.
2. UL file number: cULus Listed File E116124.
3. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
4. KDR IOM Manual Part Number 30895
5. Material(s) Shall be RoHS Compliant
6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

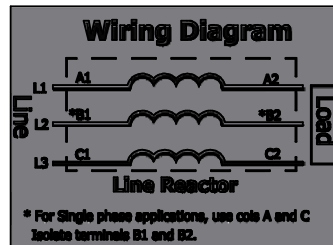

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10				W132N10611 (Rev 13)Feb Germantown, WI 53022 © 2024 TCI, LLC	
C	6535, Terminal To 32766	1/31/2024	DSW	FRACTIONAL ± 1/32				An Official Motors Company KDR H Frame, Flag Version Reactor Drawing	
B	6394, Termination update	1/16/2024	DSW	ANGULAR ± 1°				DRN BY: DSW DATE: 8/28/2023 107589-3DG SCALE: 1/2 DRWG: CSE	
A	6394 was bushbar	8/28/2023	DSW						
NO	REVISION	DATE	BY					SHT 1 OF 1	