
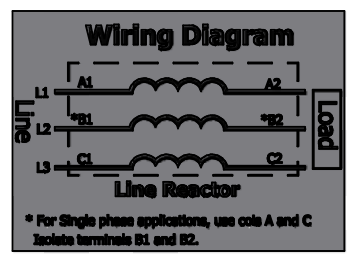
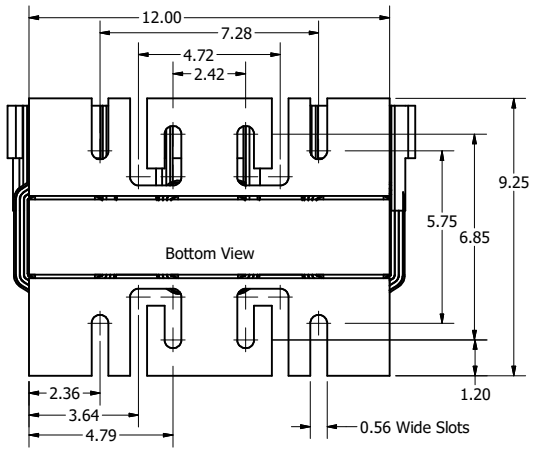
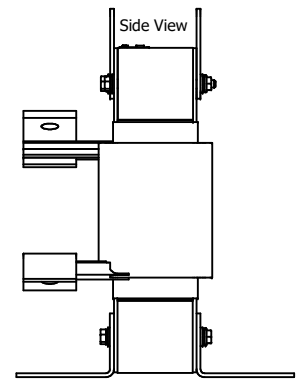


480 Rated Voltage, 600 Max Voltage, Output								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Available Lug Kit	Terminal Hole Size (Inches)
KDRL1P	350	414	420	26.4	85	275	SLK13	0.53
KDRL3P	450	515	600	19	100	338	SLK14	0.53
KDRL4P	500	590	600	18.7	100	338	SLK14	0.53

575 Rated Voltage, 600 Max Voltage, Output								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Available Lug Kit	Terminal Hole Size (Inches)
KDRL31P	400	382	420	26.5	85	420	SLK13	0.53
KDRL35P	450	412	420	26.4	85	420	SLK13	0.53

480 Rated Voltage, 600 Max Voltage, High Z, Impedance.								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Available Lug Kit	Terminal Hole Size (Inches)
KDRL1H	250	302	310	106	105	548	SLK13	0.56
KDRL2H	300	361	365	86	105	786	SLK13	0.56
KDRL3H	350	414	435	74	109	750	SLK13	0.53
KDRL4H	400	477	480	65	135	730	SLK13	0.56

480 Rated Voltage, 600 Max Voltage, Low Z, Impedance.								
Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Losses (W)	Available Lug Kit	Terminal Hole Size (Inches)
KDRL1L	450	515	610	36.3	110	509	SLK14	0.53
KDRL2L	500	590	610	31.5	110	518	SLK14	0.53

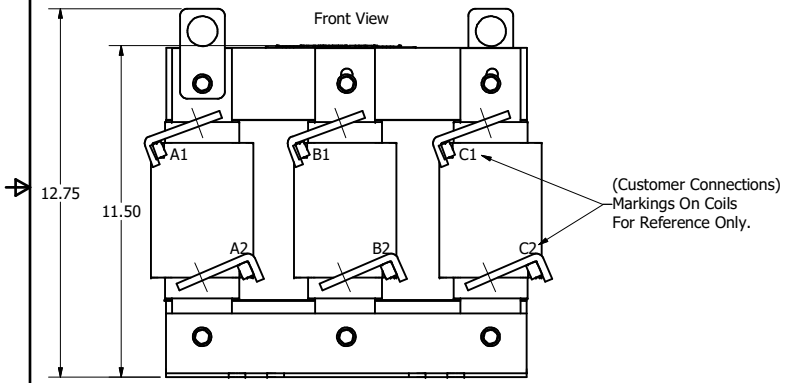

**TCL** (800) 824-8282 [transcoll.com](http://transcoll.com)

**KDRL Drive Reactor**  
 KDR - Motor Amps -  
 3PH, 50/60Hz, -V Rated, 600V Max, -A Max  
 40C Amp Max, 155C Rise, RoHS  
 Manual #30895 LUG KIT #SLK-

UL LISTED CE  
 2000 0001 00 0000

DATE CODE: A1 A2 B1 B2 C1 C2

- Notes:
1. KDR Lug Kits sold separately. Contact TCI.
  2. UL file number: cULus Listed File E116124.
  3. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
  4. KDR IOM Manual Part Number 30895
  5. NEC Current For 208/240 Volts, Horsepower Based On 208 Volts.
  6. Material(s) Shall be RoHS Compliant
  7. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .03 .XXX ± .010 FRACTIONAL ± 1/32 ANGULAR ± 1°				W132N10611 (Rev 1) 1/16/20 Germerman, WI 53012 © 2023 TCI, LLC An Official Motors Company KDR L Frame, Copper Bus Reactor Drawing DWN BY: DSW DATE: 3/23/18 FILE: 107537DG SCALE: 1/3.2 DRAWN: CFC SHEET 5 OF 10	
REV	6523, Remove L2P, L32P	12/19/2023	DSW	NO	REVISION	DATE	BY		