
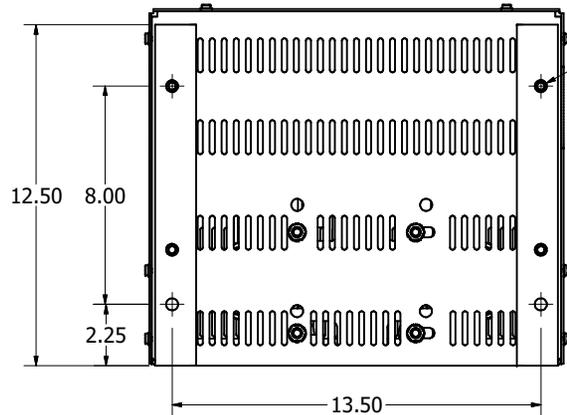
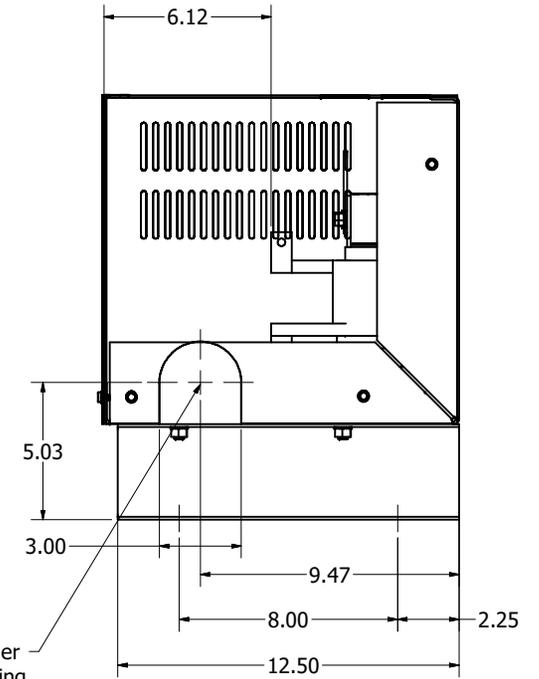
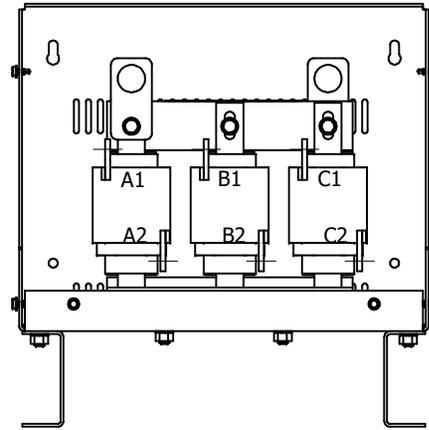
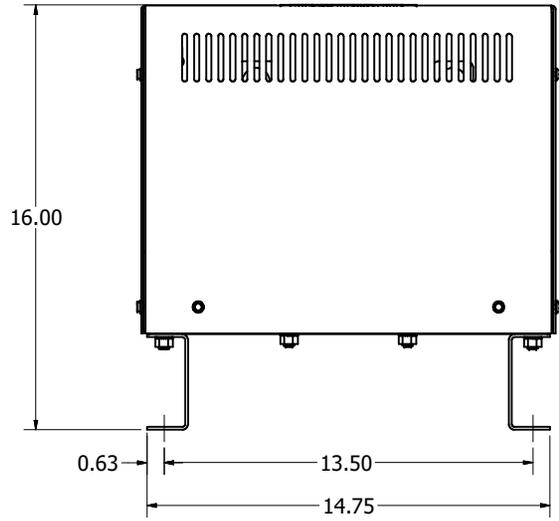
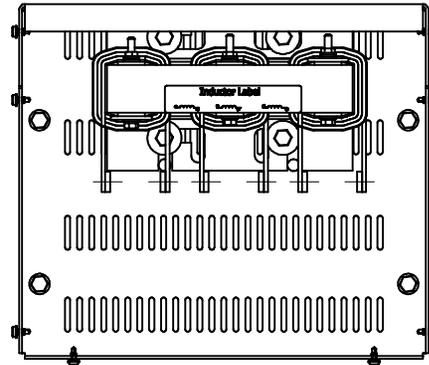


For Electrical Information See: **KDRI2H, KDRI31P, KDRI41H**

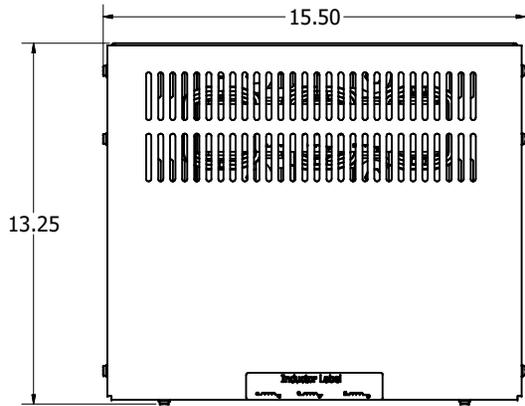

0.44 Dia Mounting Holes

Location For Customer Conduit Fitting (Both Sides)

Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

Material(s) Shall be RoHS Compliant

DIMENSIONS IN INCHES (EXCEPT AS NOTED) TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/32 ANGULAR ± 1°		THE INFORMATION AND DESIGN CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIENT INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIENT INC. AND ITS SUBSIDIARIES.		DESIGNED BY DSW	DATE 01/17/05		W132N10611 Grant Drive Germantown, WI 53022 © 2026 Allient Inc.
C	7384	Update Title Block	02/03/26	DSW	KDR I Frame C4 Enclosure, Nema 1		
A	6346-1	Flag Updated	07/26/23	DSW	SCALE 1/3.5	DESIGN NO. KDR-101DG	SIZE C
NO	ECO	REVISION	DATE	BY	SHEET 1 OF 1		