
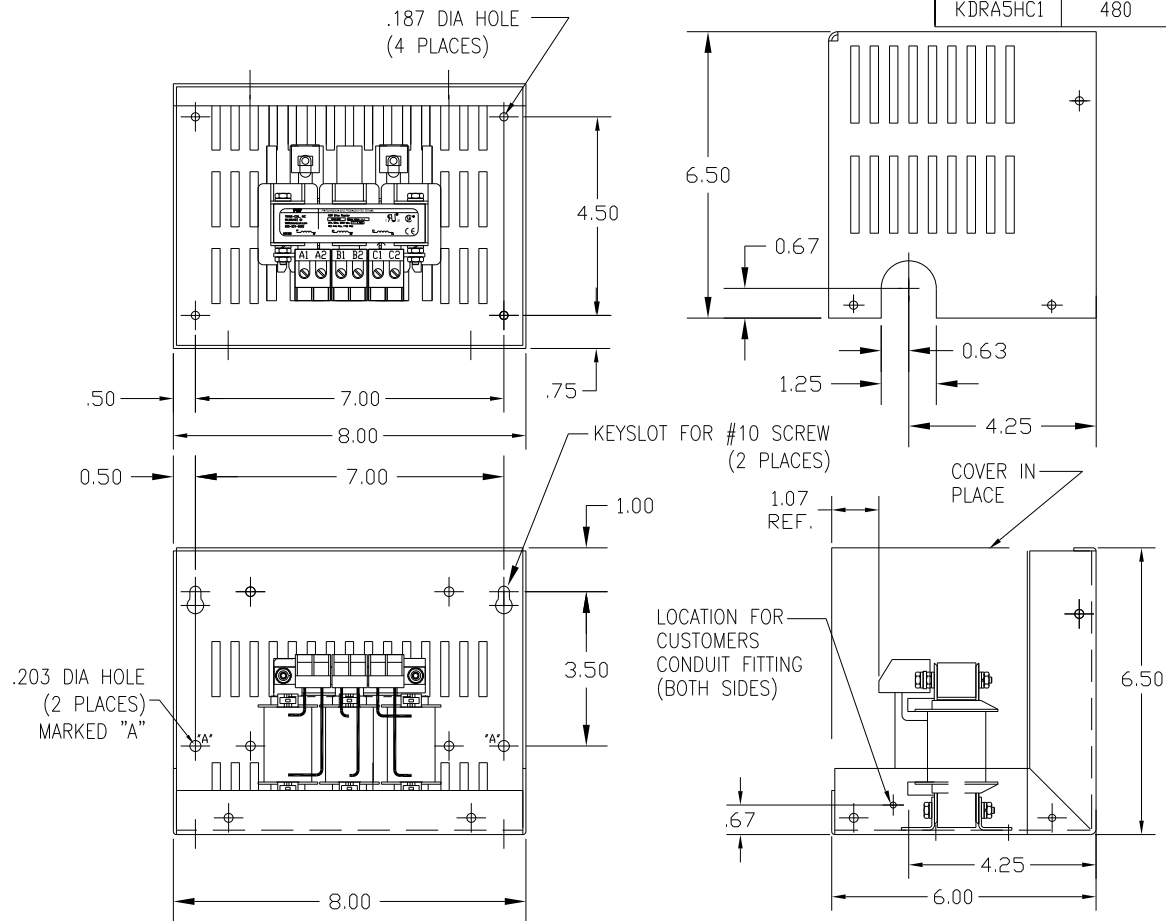
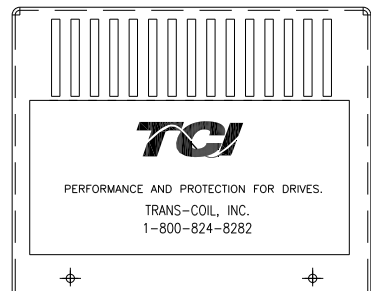


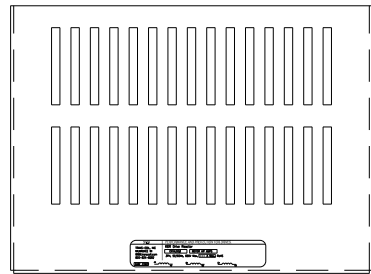

NOTE: A1, A2, B1, B2, C1, C2,
MARKINGS ON TERMINAL BLOCK
FOR REFERENCE ONLY.

BLOCK WIRE RANGE FOR REACTOR AND TIGHTENING TORQUE.	#12-#18 AWG 10 LB-IN
---	-------------------------

CUSTOMER IS RESPONSIBLE FOR INSTALLATION
TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

				TOLERANCES (EXCEPT AS NOTED) DECIMAL	 7878 N. 86th STREET MILWAUKEE, WI 53224 KDR DRIVE REACTOR 480V HIGH Z, FRAME A
				.XX ± .03	
				.XXX ± .01	
				FRACTIONAL ± 1/32	
NO	REVISION	DATE	BY	ANGULAR ± 1/2°	DRN. BY DSW SCALE DATE 1/25/12 APRVD. DWG. NO. B KDR A5HC1DG SHT. 1 OF 1