





VOLTAGE	NEC MOTOR HP	CATALOG NO	NEC MOTOR CURRENT	AMPS MAX	WATTS LOSS	APPROX WT-LBS	RING LUG HOLE SIZE
690	20	KDRB44LDRV	22	24.0	71.2	8	.25

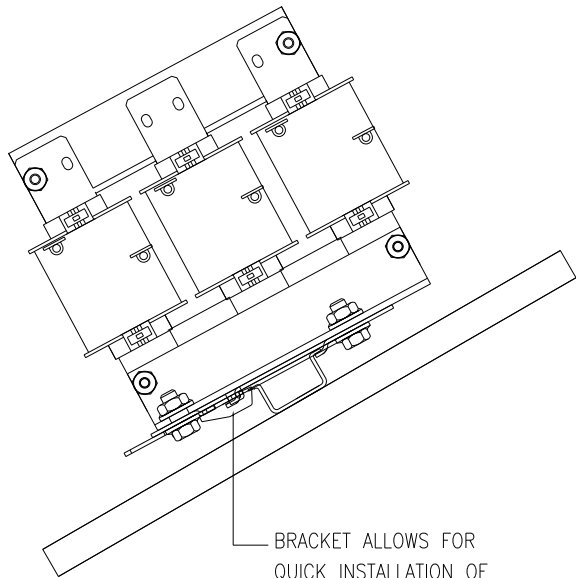


BRACKET ALLOWS FOR QUICK INSTALLATION OF REACTOR ON DIN RAIL.

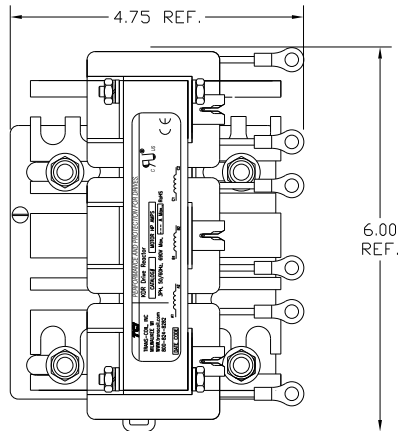

TCI'S DIN RAIL MOUNTED REACTORS FIT STANDARD SIZE DIN RAIL. TCI RECOMMENDS USING HIGH PROFILE STANDARD STEEL RAIL OR HEAVY DUTY STANDARD STEEL DIN RAIL.

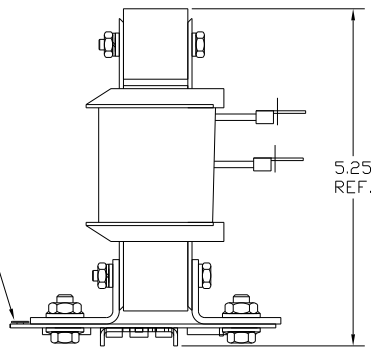

STANDARD STEEL HIGH PROFILE DIN RAIL.



HEAVY DUTY STEEL DIN RAIL.

TCI RECOMMENDS TAKING PRECAUTIONS WHEN SHIPPING MOUNTED REACTORS.

TCI TRANS-COIL, INC MILWAUKEE WI WWW.transcoil.com 800-824-8282	PERFORMANCE AND PROTECTION FOR DRIVES. KDR Drive Reactor		
	CATALOG #	MOTOR HP AMPS	
DATE CODE			

				TOLERANCES UNLESS NOTED OTHERWISE: DECIMALS: XX ± .03, .XXX ± .01 FRACTIONS: ± 1/32 ANGLES: ± 1/2° FINISH: NONE		TCI 7878 N. 86TH STREET MILWAUKEE, WI 53224	
				KDR 690V DIN RAIL FRAME B		DATE: 11/29/2011 DESIGNED BY: DSW DRAWING NO: KDRB44LDRV DG SHEET: 1 OF 1	
NO	REVISION	DATE	BY	APPROVED	DATE	BY	NO