


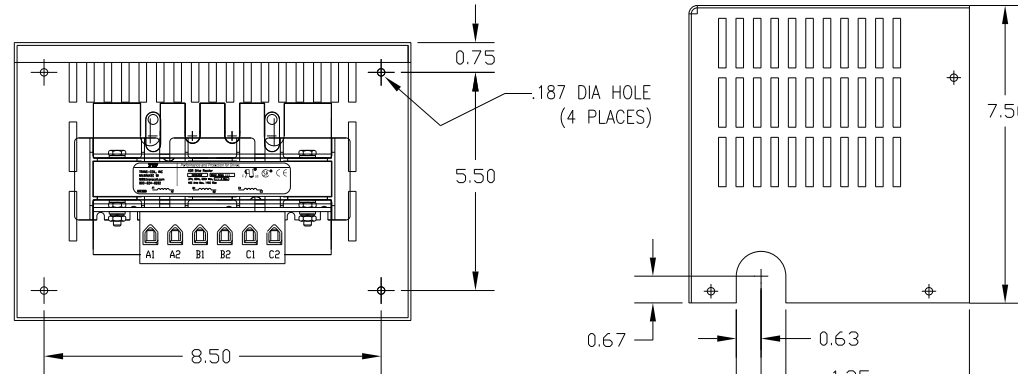
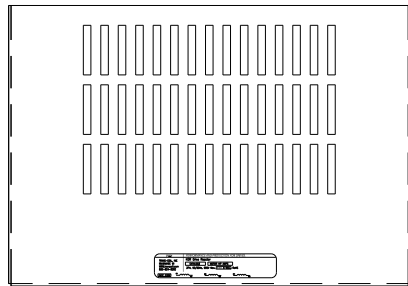


CATALOG NO	VOLTAGE	NEC MOTOR HP	NEC MOTOR CURRENT	WATTS LOSS	APPROX WT-LBS	TORQUE (LB-IN)
KDRD34PC2	575	40	41	NOTE:1	18	20

NOTE 1: WATTS LOSS WILL VARY DUE TO FUNDAMENTAL FREQUENCY, CARRIER FREQUENCY AND OTHER SYSTEM CHARACTERISTICS.  
KDR DRIVE REACTORS COMPLY WITH THE THERMAL AND ALTITUDE STANDARDS SET FORTH BY NEMA ST20-1992..

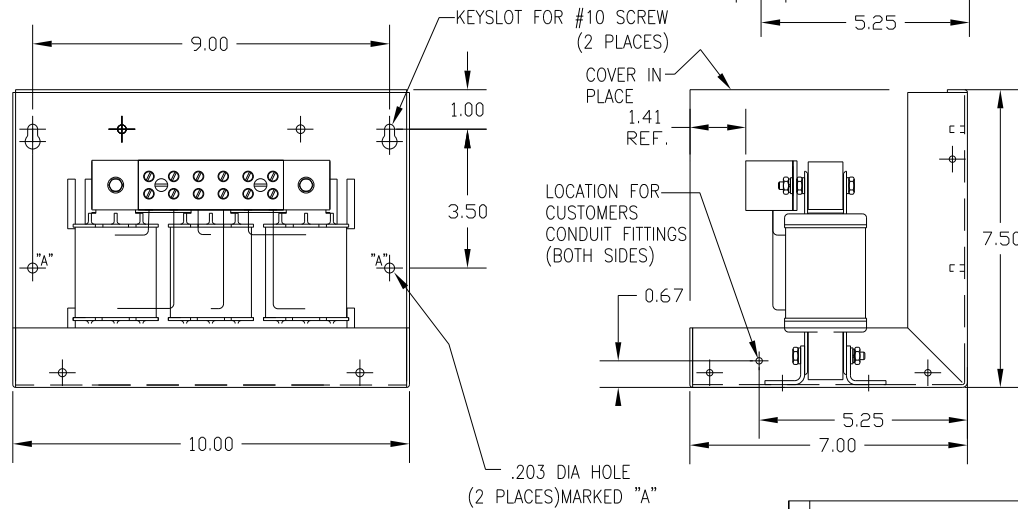

NOTE: A1, A2, B1, B2, C1, C2, MARKINGS ON TERMINAL BLOCK FOR REFERENCE ONLY.

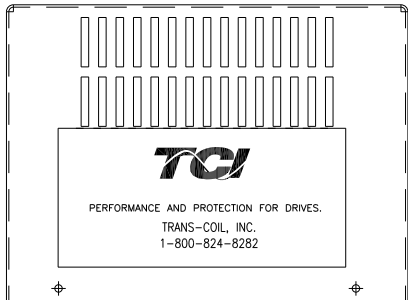

CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

NO	REVISION	DATE	BY	TOLERANCES (EXCEPT AS NOTED)	SCALE	DRN BY	DATE	APRVD	DWG NO	REV
				DECIMAL .XX ± .03 .XXX ± .01		DSW	1/25/12		TCI 7878 N. 86th STREET MILWAUKEE, WI 53224	KDR OUTPUT REACTOR 575V, FRAME D
				FRACTIONAL ± 1/32						
				ANGULAR ± 1/2°						SHT. 1 OF 1