

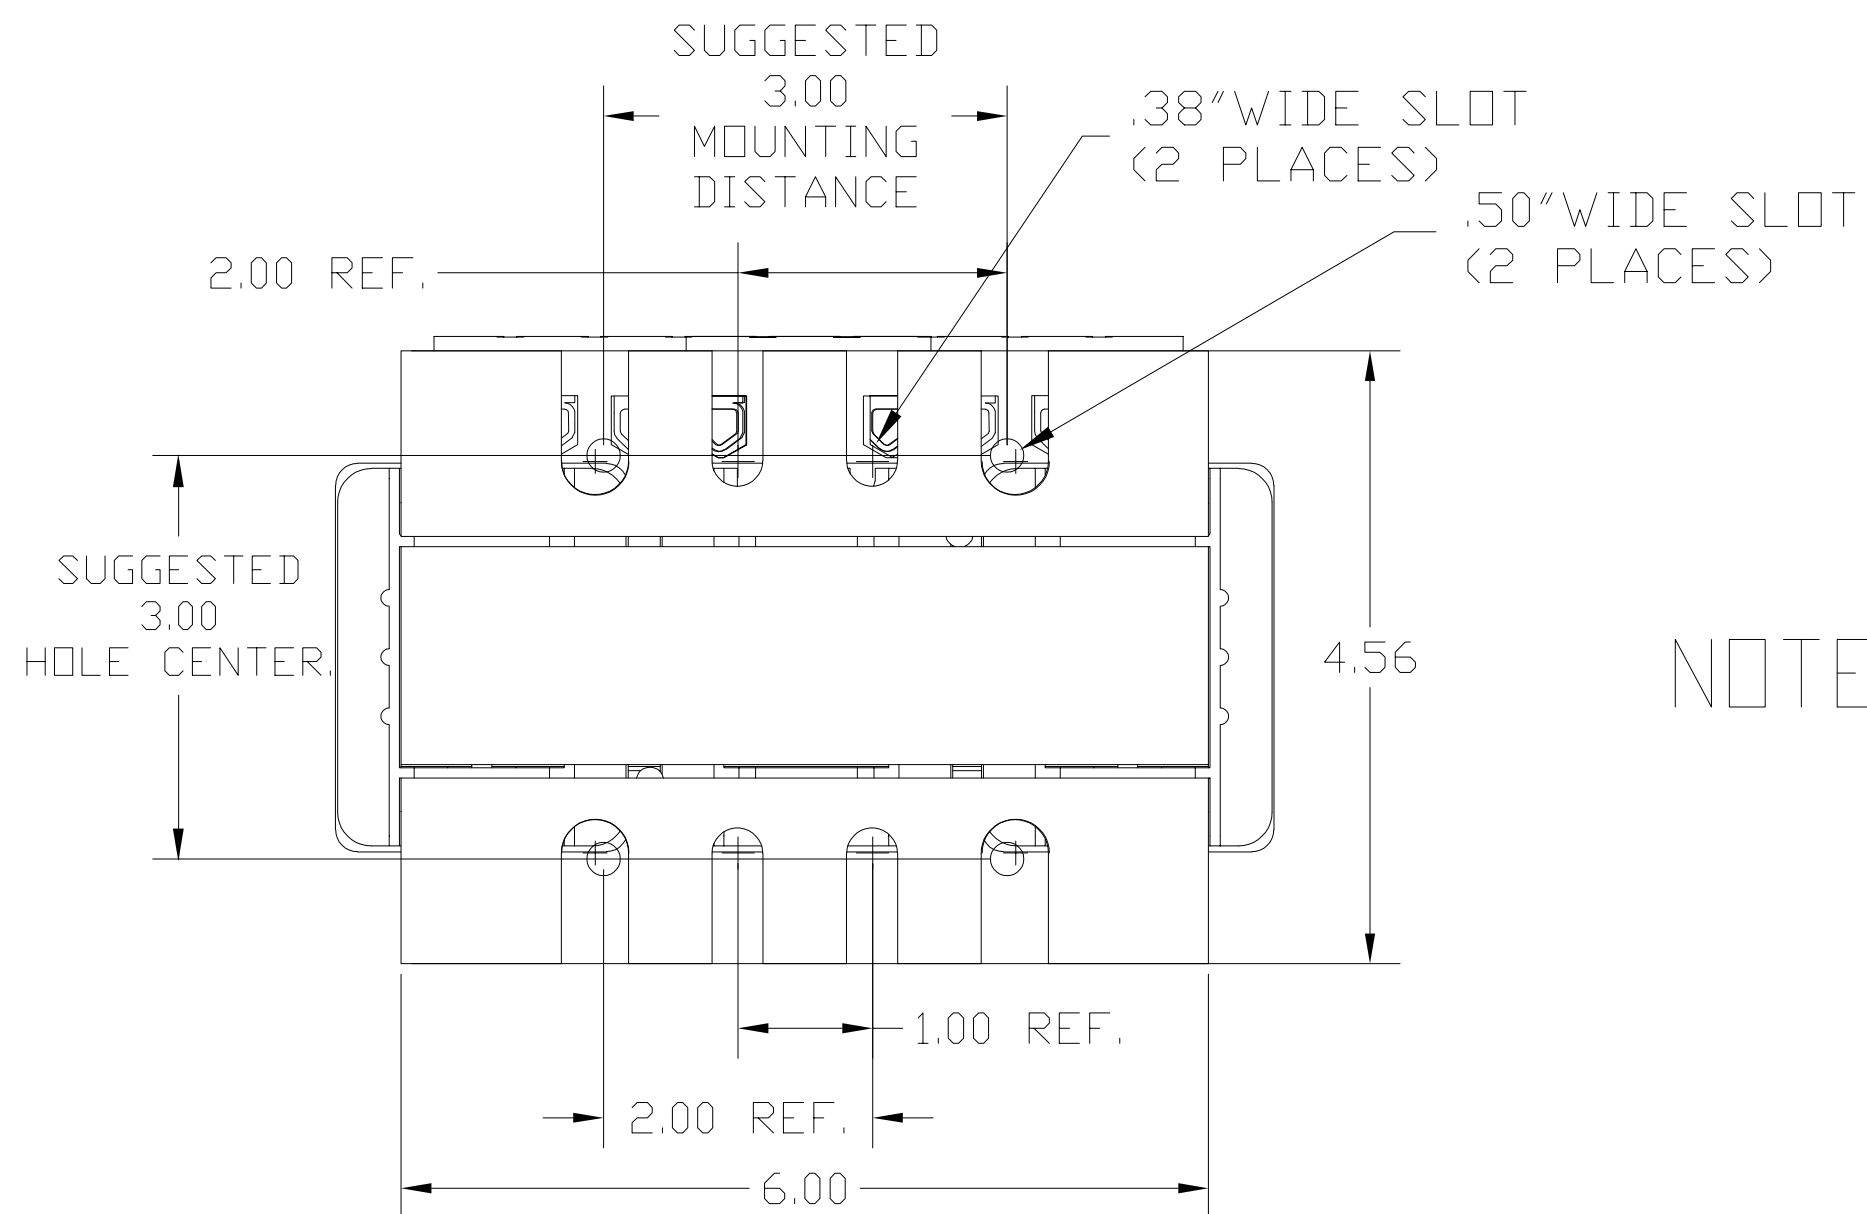
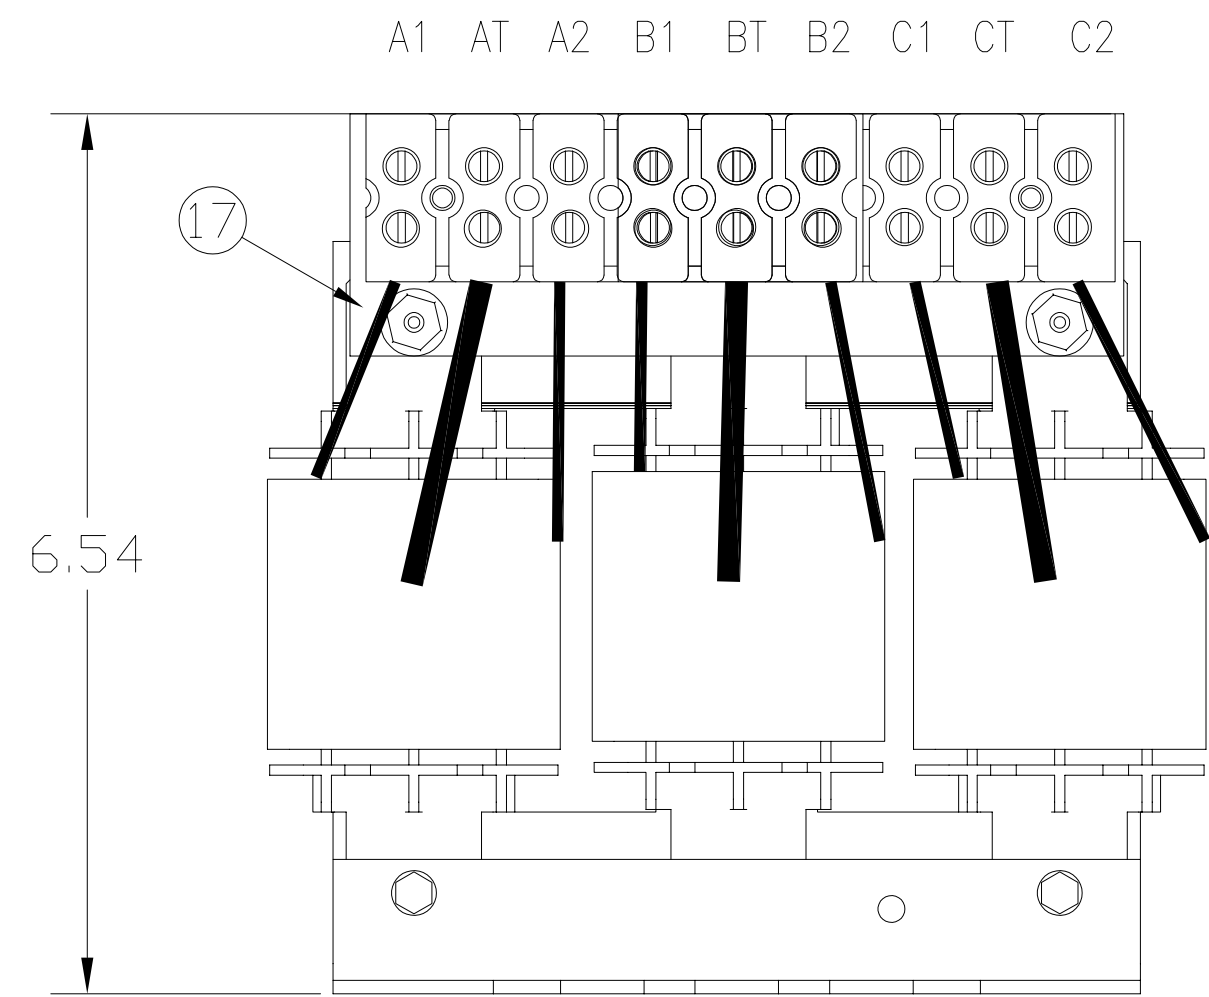


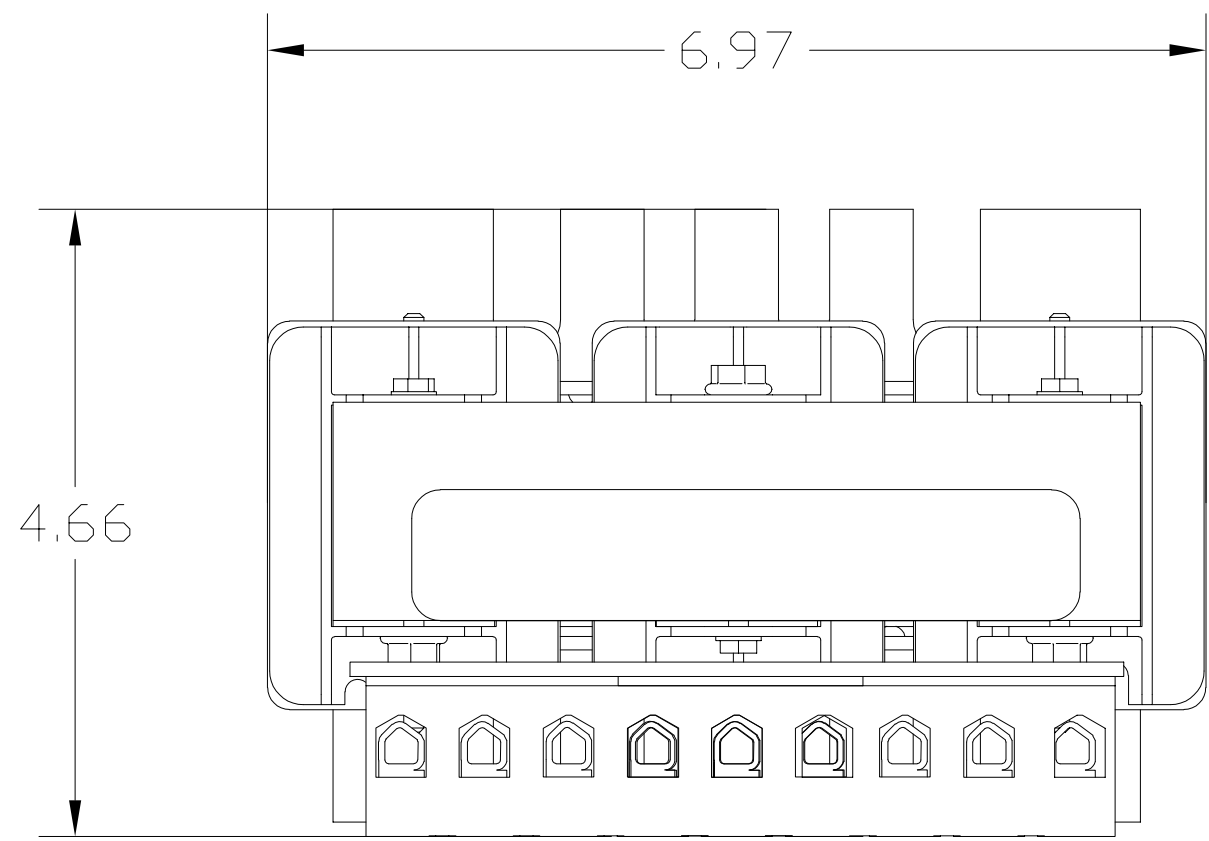


CATALOG NO	__AMPS(A)	MAX. __AMPS(A)	APPROX WT-LBS
KDRE3TT	6.0	7.6	16.65

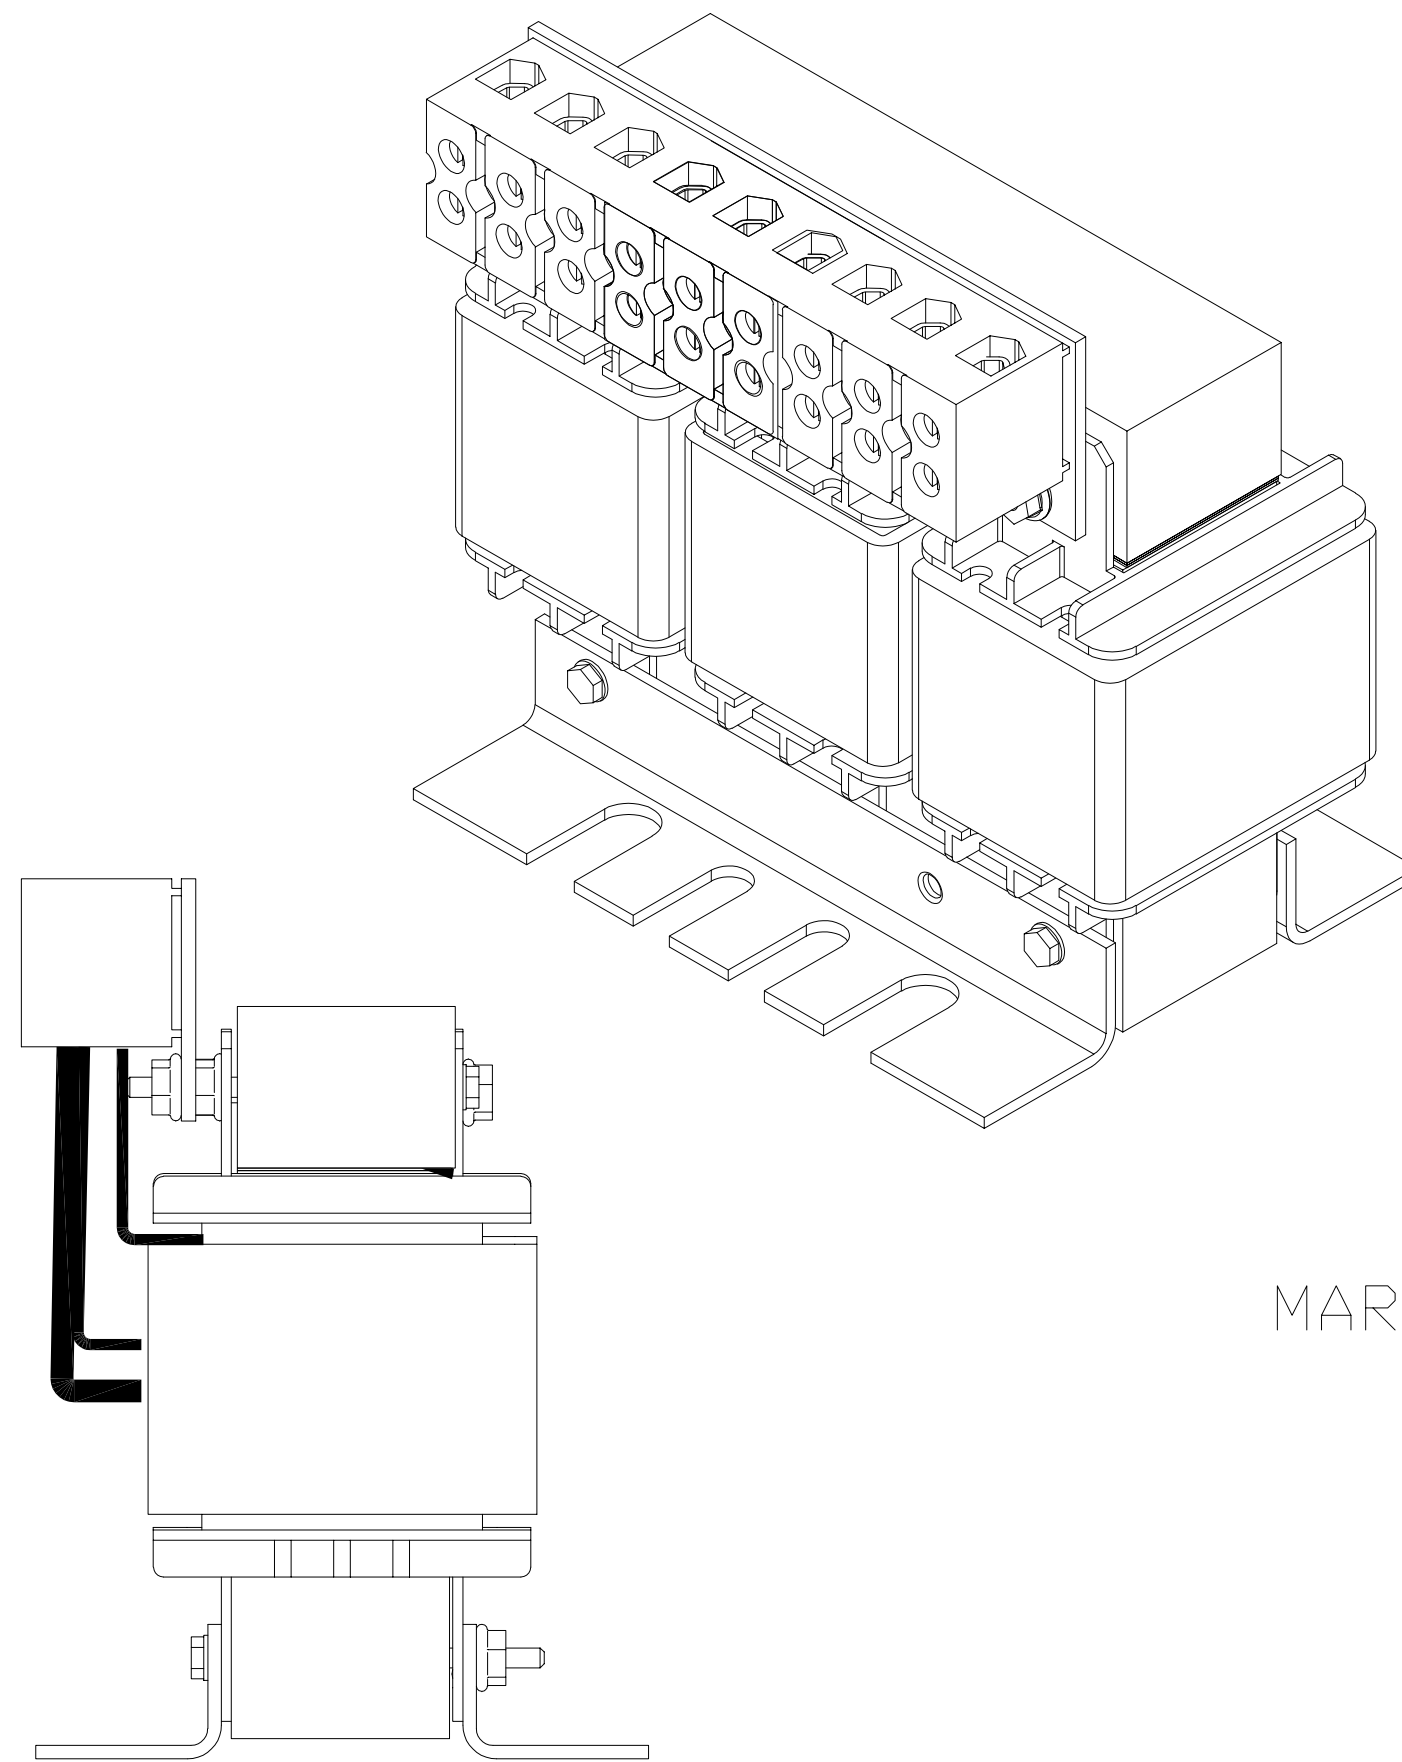

MARKINGS ON BLOCK FOR REF.

A1 AT A2 B1 BT B2 C1 CT C2

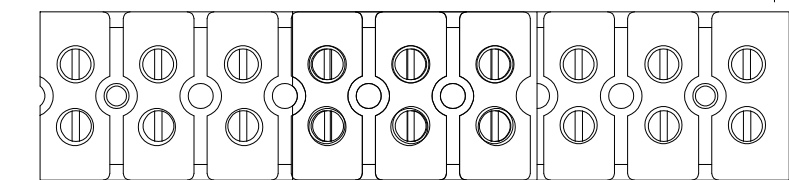

TERMINAL BLOCK
TORQUE
(LB-IN)
20

TAP AT 145
NOTE: COIL DRAWING# 28891

				TOLERANCES (EXCEPT AS NOTED) DECIMAL	 W132 N10611 GRANT DR GERMANTOWN, WI 53022
D	Weight Was 10lbs	8/8/18	DSW	.XX ±.02	
C	4374, Remove 1762 from center bolt	5/16/18	DSW	.XXX±.01	KDRE3TT
B	3124, TAP WAS AT 138	6/19/14	DSW	FRACTIONAL ± 1/32	
A	AS BUILT	1/13/14	DSW	ANGULAR ± 1/2°	DRN. BY DSW DATE 1/13/2014 DWG. NO. 105582DG
NO	REVISION	DATE	BY	SCALE TO FIT	APRVD. C SHT.1 OF1