
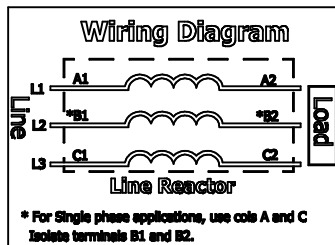


600 Rated Voltage, 600 Max Voltage, High Z, Impedance.

Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Losses (W)	Weight (LBS)	Available Lug Kit	Terminal Hole Size (Inches)
KDRG44HV	125	125	130	371	381	51	SLK10	0.28

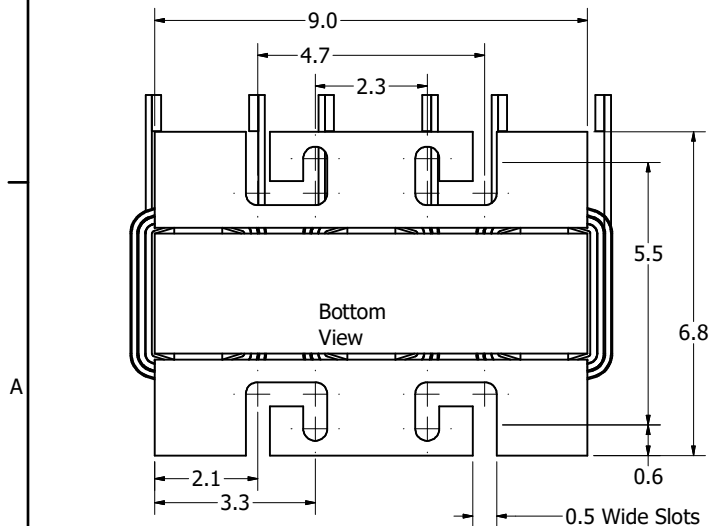

TCI (800) 824-8282 transcoll.com

KDRUL Drive Reactor
 KDR- Motor Amps ---
 3PH, 3Ø/60Hz, ---Y Rated, 600V Max, -A Max
 transcoll.com
 800-824-8282
 Manual #30895 LUG KIT #SLK---

DATE CODE

- Notes:
1. KDR Lug Kits sold separately. Contact TCI.
 2. UL file number: cULus Listed File E116124.
 3. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
 4. KDR IOM Manual Part Number 30895
 5. NEC Current For 208/240 Volts, Horsepower Based On 208 Volts.
 6. Material(s) Shall be RoHS Compliant
 7. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/32 ANGULAR ± 1°				W132N10611 (Rev'd 11Feb) Germantown, WI 53022 © 2024 TCI, LLC KDR G Frame, Flag 600V, Reactor Drawing DWN BY: DSW DATE: 02/05/2007 103099DG SCALE: 1/2 DRAWN: DATE:	
A	6575, Term change to Flag	2/26/2024	DSW						
NO	REVISION	DATE	BY						