

4

3

2



1

Ground Lug.
See IOM Manual, Part# 30895
Table S2/0, Wire Size And Torque.

480 Rated Voltage, 600 Max Voltage, High Z, Impedance.



Part Number	Horsepower (HP)	Motor Amps (A)	Maximum Amps (A)	Inductance (uH)	Weight (LBS)	Available Lug Kit	Terminal Hole Size (Inches)	Losses (W)
KDRI2HE01	100	124	125	252	119	SLK10	0.38	301

D

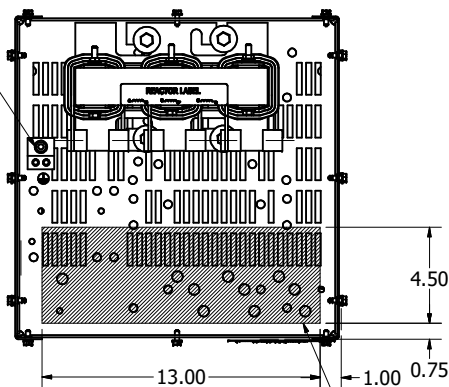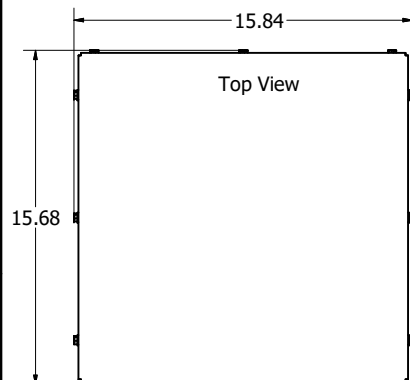


Suggested Customer Wire Entrance Bottom Of Enclosure.
See Note: 6
(Non Removeable Panel)


C

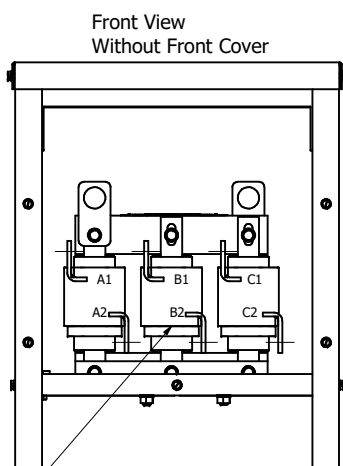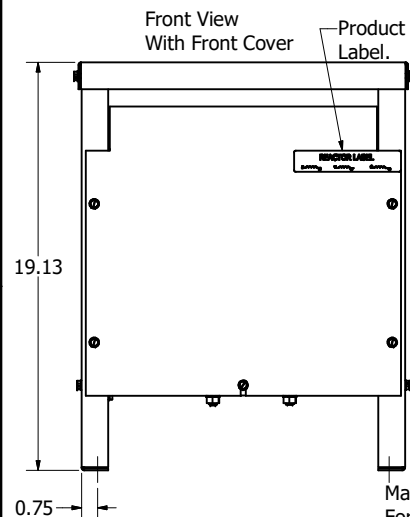

Side View

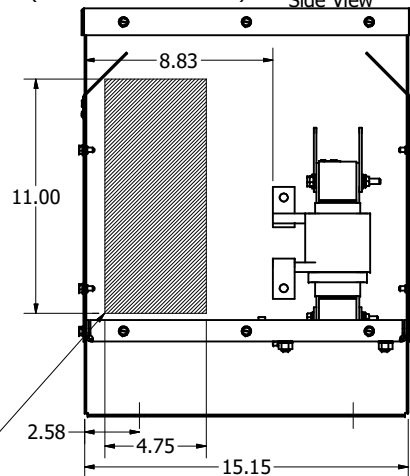


B

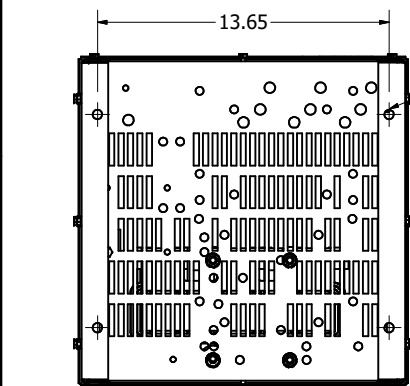

Markings On Coils For Reference Only.

0.44 Dia Mounting Holes, 4 Places, (Bottom of Enclosure)

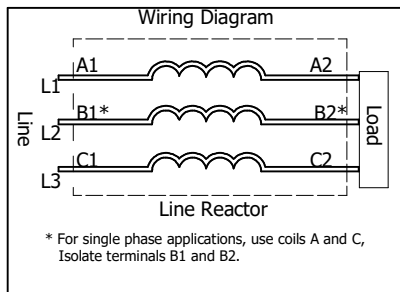

Suggested Customer Entrance Either Side Of Enclosure.
See Note: 6
(Non Removeable Panel)



Notes:

1. KDR Lug Kits sold separately. Contact TCI.
2. UL file number: cULus Listed File E116124.
3. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
4. KDR IOM Manual Part Number 30895
5. Material(s) Shall be RoHS Compliant
6. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

A

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.				TOLERANCES (EXCEPT AS NOTED)				TCI An Official Motion Systems Company KDR I Frame, Copper Bus, Enclosed Type 1, Inductor Drawing			
A As Designed				7/27/2023				DATE 7/27/2023			
NO REVISION				DATE				SCALE 1/3			
				BY				DWG 107612-9DG			
				DATE				REV C			

4

3

2

1