
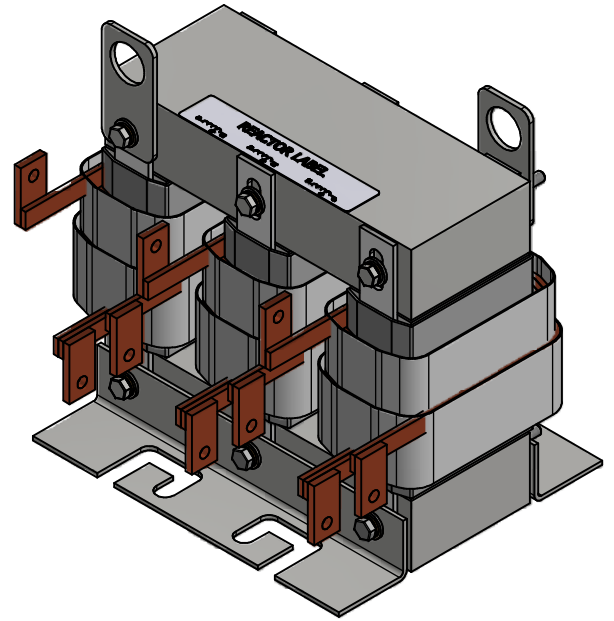



| HP | Reactor Part Number | Rated Amps (A) | Max Amps (A) | uH +/- 5% | Weight (LBS) | Terminal Hole Dia (Inches) | Available Lug Kit |
|-----|---------------------|----------------|--------------|-----------|--------------|----------------------------|-------------------|
| 100 | KDRJ2TT | 96.6 | 124 | 889 | 80 | 0.28 | SLK31 |

System Voltage 480V, 60Hz.

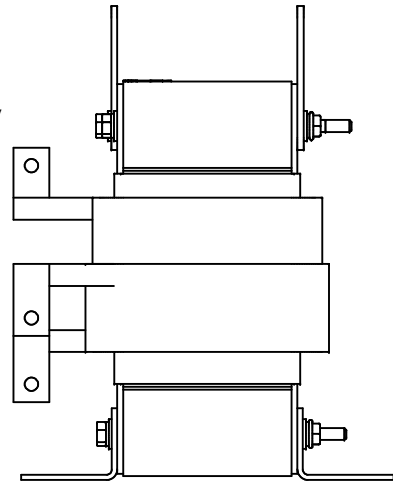

Customer Is Responsible For Installation
To Meet All National And Local Electrical Codes.
Dimensions are in inches unless otherwise specified.
Material(s) Shall be RoHS Compliant

| | | | | | | |
|--|----------|------|----|------------------------------|--------------------------------------|---|
| THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. | | | | TOLERANCES (EXCEPT AS NOTED) | |  An Allied Motion Company KDR, HGP Inductor, 480V, 100HP W132N10611 (Rev. 19Feb) Germantown, WI 53022 © 2024 TCI, LLC |
| | | | | F | 6891, Flag 15465 to 32766 | 12/3/2024 |
| | | | | D | 6760 Add Available Lug Kit | 8/23/2024 |
| | | | | C | 6347, Update Cut Length 1.75 to 1.5" | 8/7/2023 |
| | | | | B | 4729 Coil Updated | 12/16/19 |
| NO | REVISION | DATE | BY | TOLERANCES (EXCEPT AS NOTED) | | OWN. BY: DSW SCALE: 1/2 DATE: 7/5/13 REVISED: 7/5/13 HIG: C |
| | | | | DECIMAL | .XX ± .25 .XXX ± .10 | 105297DG |
| | | | | FRACTIONAL | ± 1/32 | |
| | | | | ANGULAR | ± 1° | |
| | | | | | | SHT 1 OF 1 |