



LABEL PLACED ON INSIDE WALL OF CABINET.

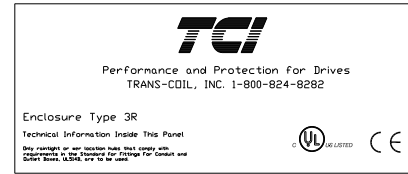

LABEL PLACED ON FRONT OF CABINET.

NOTE: ROTATE AS NEEDED TO MEET
.50 CLEARANCE BETWEEN TERMINAL
OR LUGS (PHASE TO PHASE).
ALSO .50 CLEARANCE FROM TERMINALS
OR LUGS TO GROUNDING SURFACE.

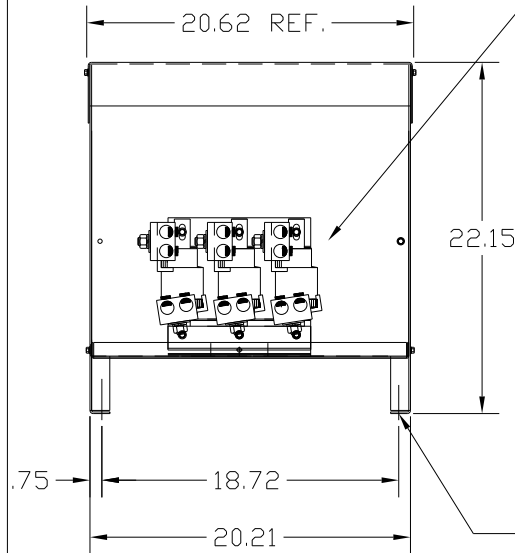


.50 DIA
MOUNTING HOLES
4 PLACES.

CATALOG NO	VOLTAGE	NEC MOTOR HP	NEC MOTOR CURRENT	WATTS LOSS	APPROX. WEIGHT-LBS	AMPS MAX.
KDRULJ24LE3R	208/240	200	528	442	150	534

NOTE 1: WATTS LOSS WILL VARY DUE TO FUNDAMENTAL FREQUENCY,
CARRIER FREQUENCY AND OTHER SYSTEM CHARACTERISTICS.

KDR DRIVE REACTORS COMPLY WITH THE THERMAL AND
ALTITUDE STANDARDS SET FORTH BY NEMA ST20-1992..


NEC MOTOR CURRENTS SHOWN IN THE 208/240 VOLT CHART
ARE BASED ON HORSEPOWER AT 208 VOLT. 575/600 VOLT
CHART USE THE 575 VOLT CURRENT RATING.

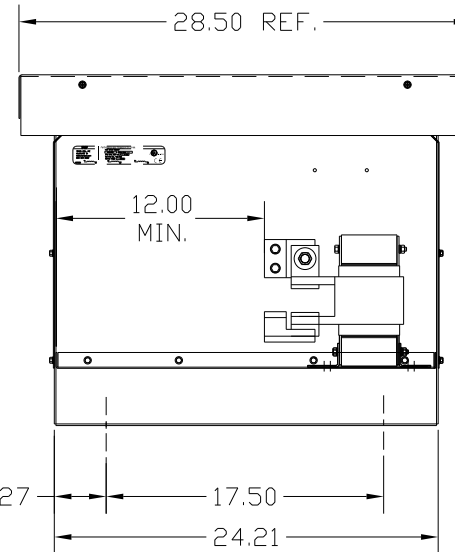

LUG WIRE RANGE TWO 600MCM-2, AL. OR CU.
FOR REACTOR.
TIGHTENING TORQUE. 500 LB-IN

PAINT SUITABLE FOR OUTDOOR APPLICATION PER UL TYPE 3R
AND APPLIED PER A UL ACCEPTED DTW2 COATING PROGRAM.

CUSTOMER IS RESPONSIBLE FOR INSTALLATION
TO MEET ALL LOCAL AND NATIONAL CODES

				TOLERANCES (EXCEPT AS NOTED)	 7878 N. 86th STREET MILWAUKEE, WI 53224
				DECIMAL	
				.XX ± .03	
				.XXX ± .01	
				FRACTIONAL ± 1/32	
				ANGULAR ± 1/2°	KDRULJ24LE3R SHT. 1 OF 1
NO	REVISION	DATE	BY	SCALE	
				DRN. BY DSW DATE 6/21/04 DWG. NO. B	
				APRVD.	