

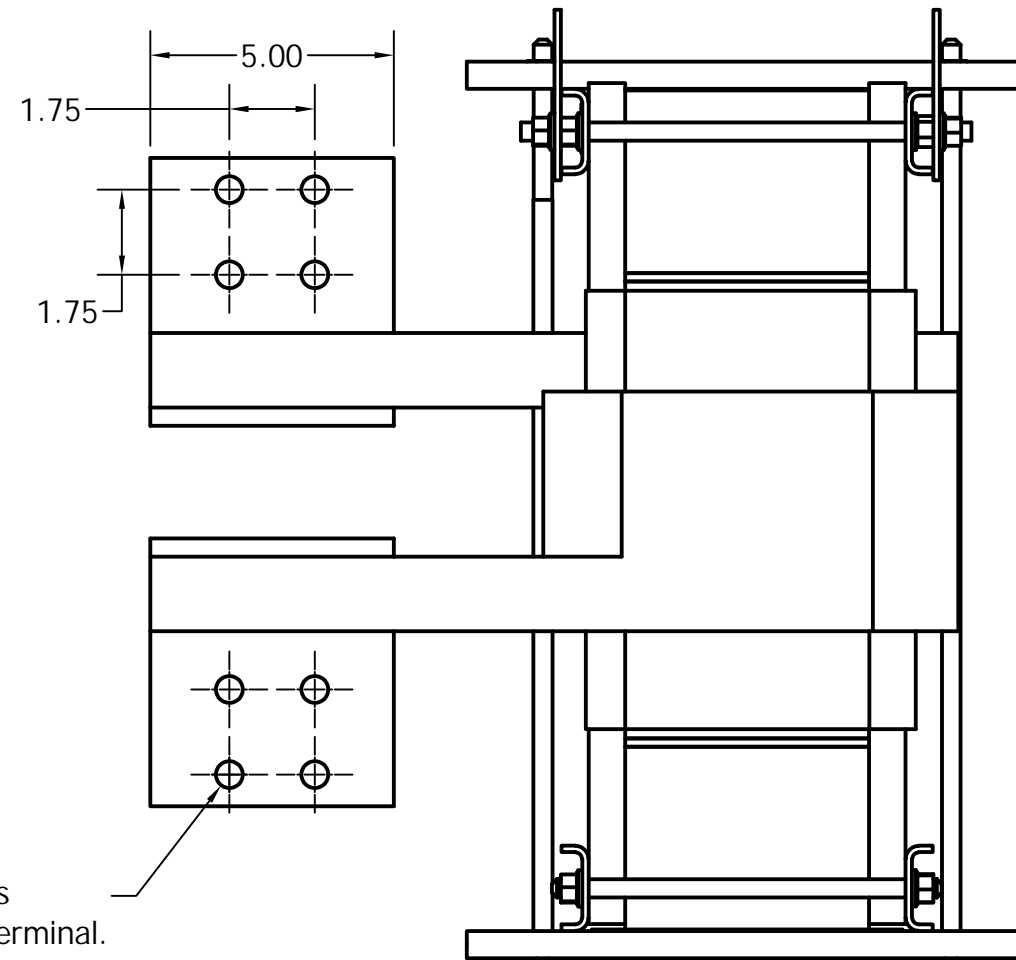
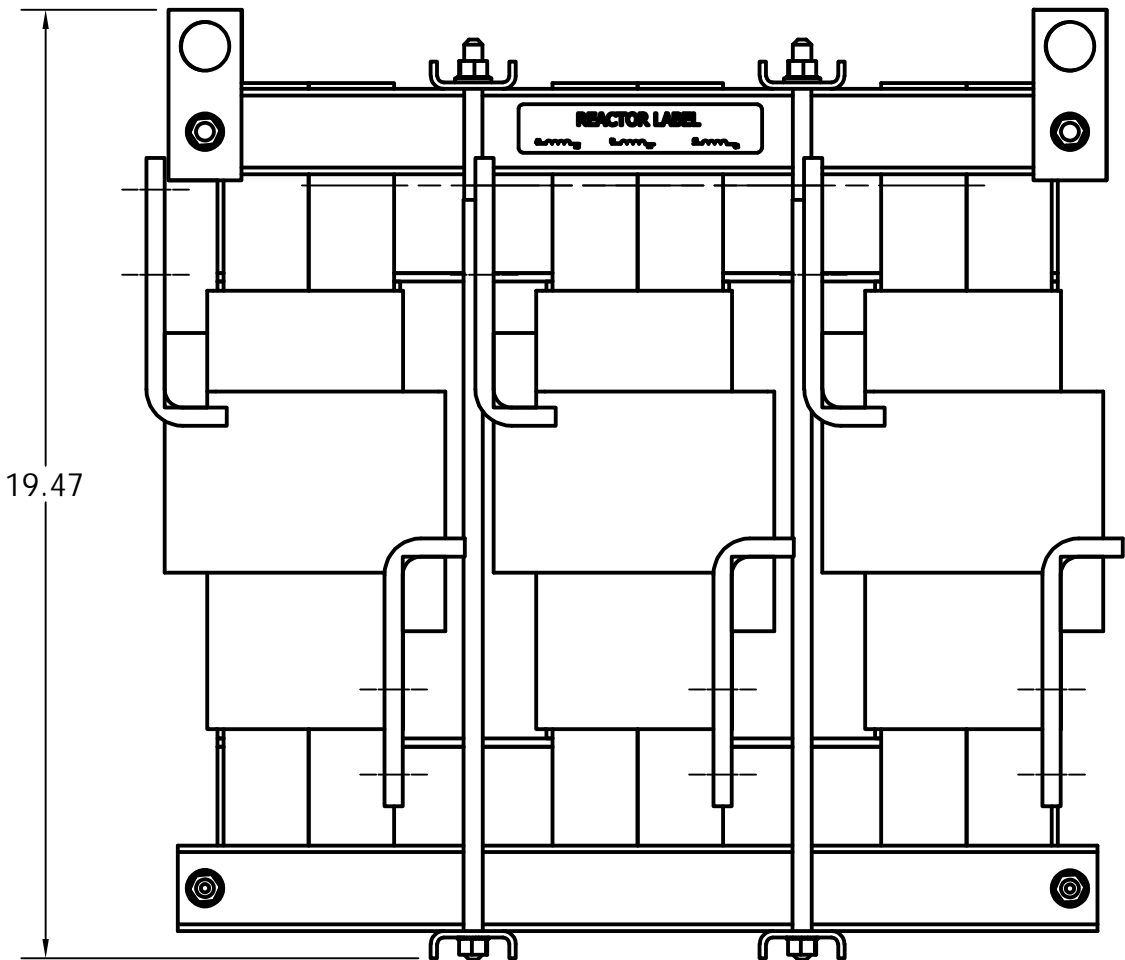
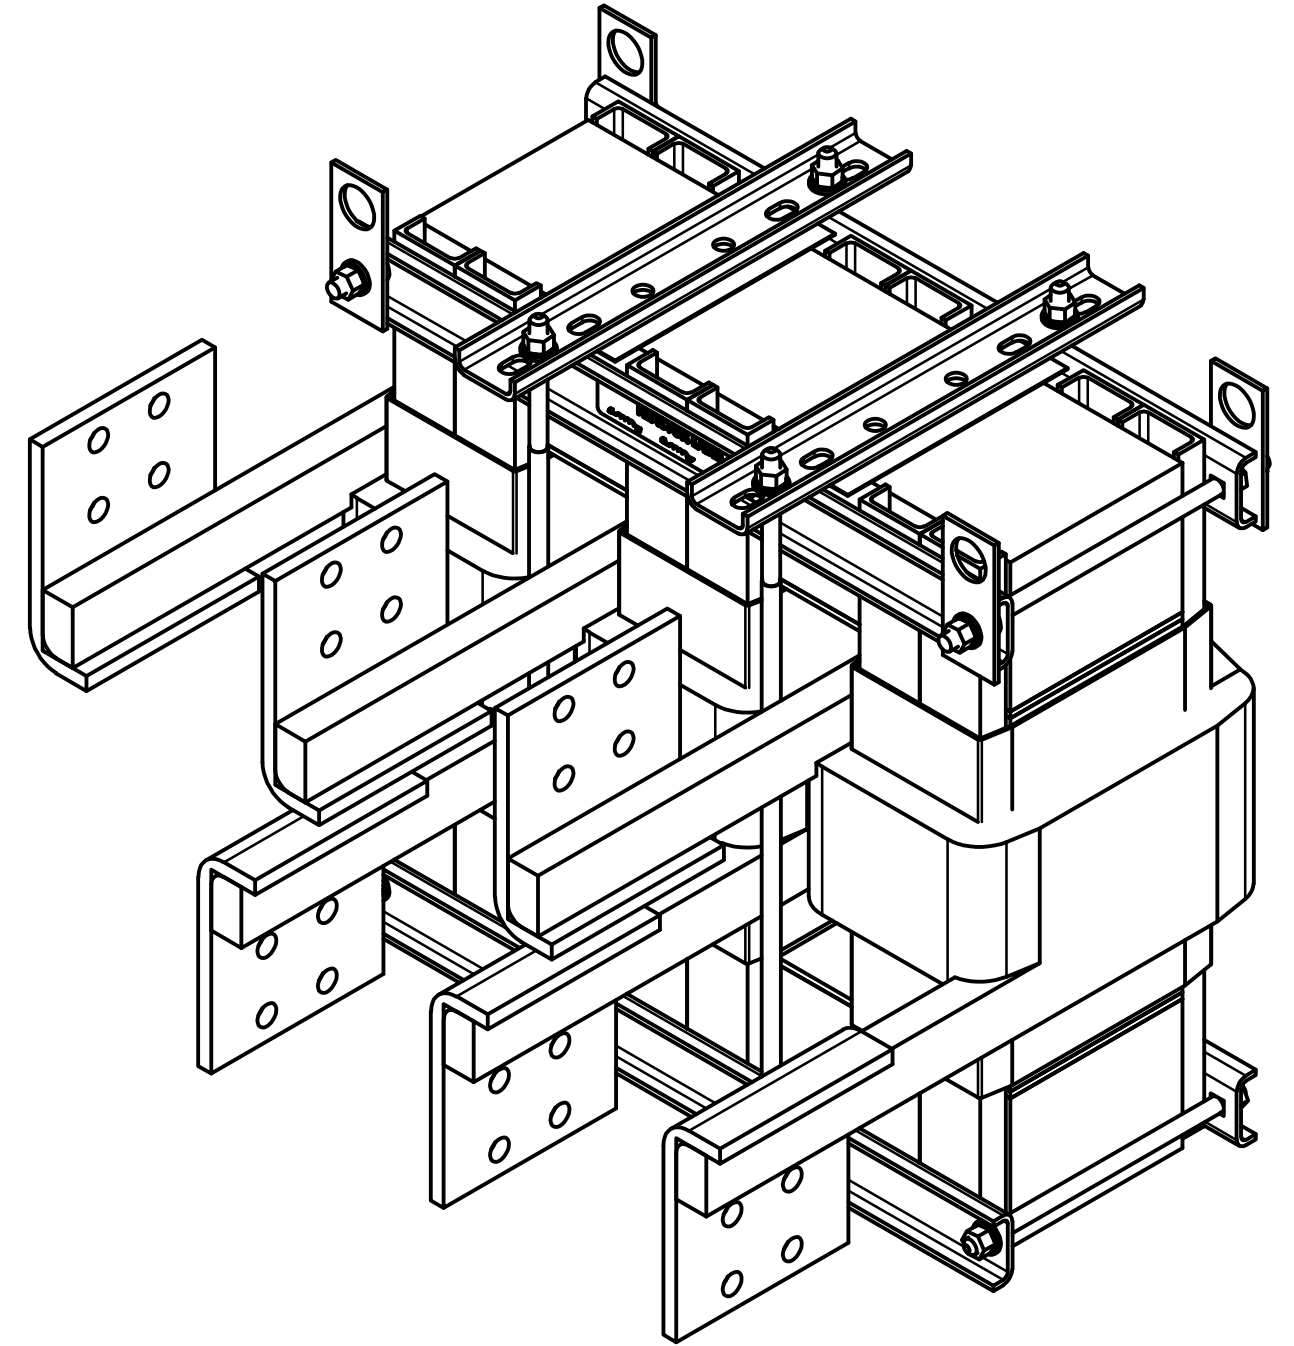


HP	TCI Part Number	Motor Amps	Amps Max.	Watts Loss	Approx Weight (LBS)
1500	KDRY41LV	1440	1500	1791	465
1250	KDRY41HV	1200	1200	2488	475

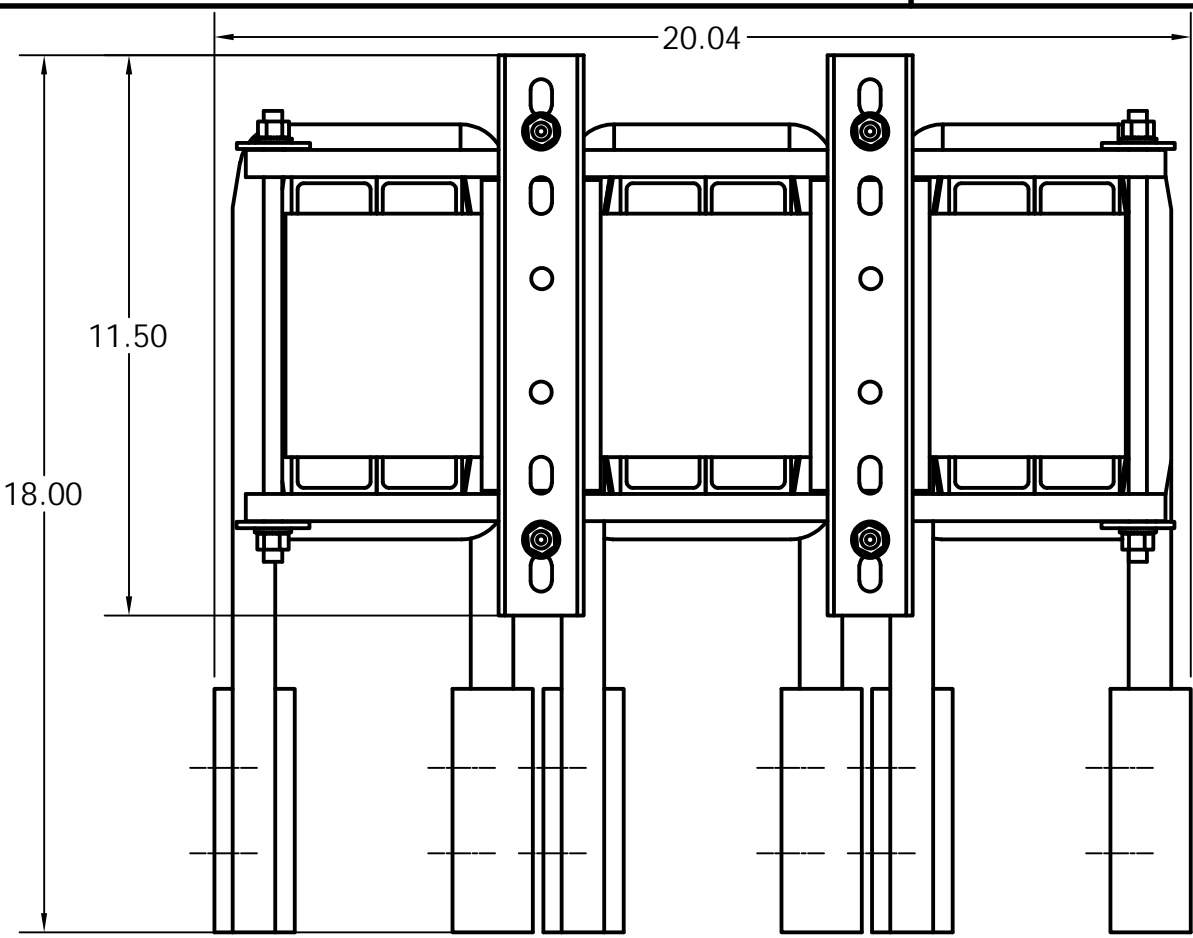


0.56 Dia Holes
4 Places Per Terminal.

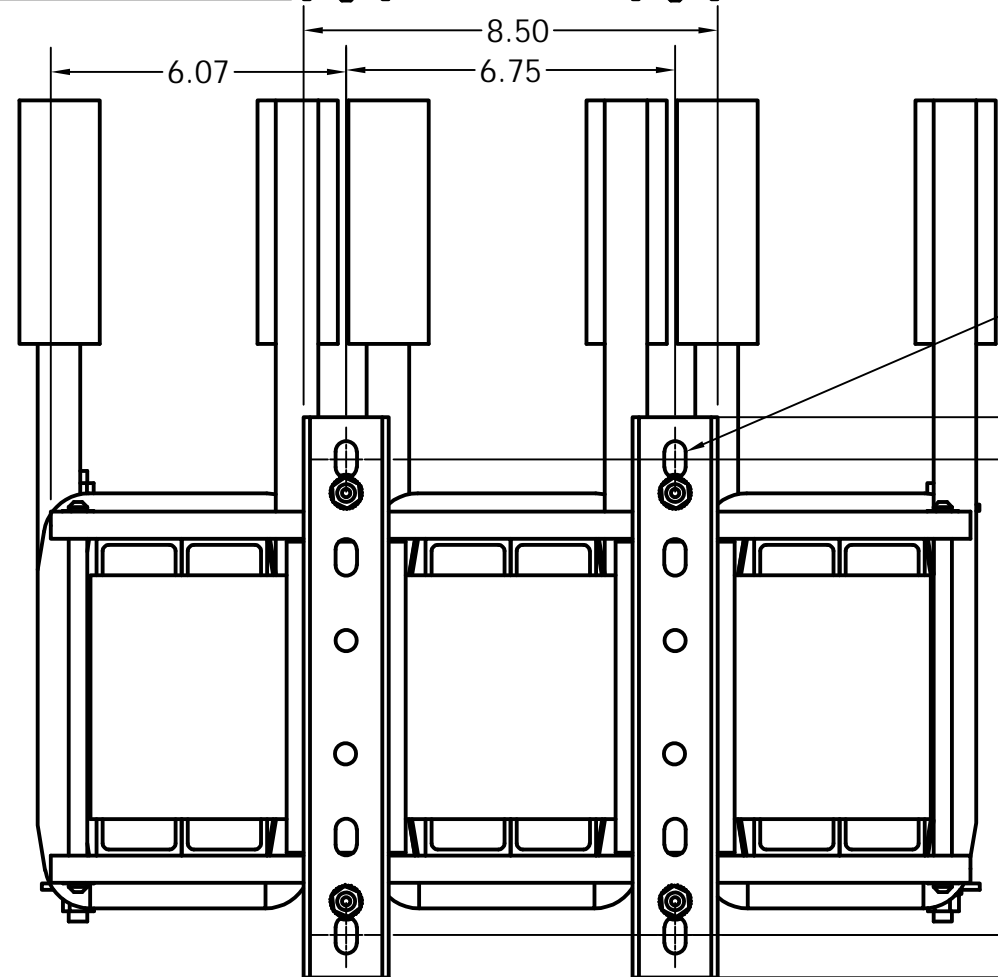

0.44" Wide X 0.75" Long Slots
4 Places.

Material(s) Shall be RoHS Compliant

Customer Is Responsible For Installation to Meet All National And Local Electrical Codes.

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.	TOLERANCES (EXCEPT AS NOTED)			 W132 N10611 Grant Drive Germantown, WI 53022 KDRY41LV, 690V, 1500A, 1500HP, 3 Phase, KDRY41HV, 690V, 1200A, 1250HP, 3 Phase Open, Input Line Reactor, Low Impedance
	DECIMAL			
	.XX ± .25 .XXX ± .10			
	FRACTIONAL			
A	4130, Flag Terminal Change.	9/20/17	DSW	DRN BY: DSW SCALE: 1/4 DATE: 02/06/07 APRVD: SIZE: 103117DG C
NO	REVISION	DATE	BY	± 1° 1 SHT 1 OF 1