


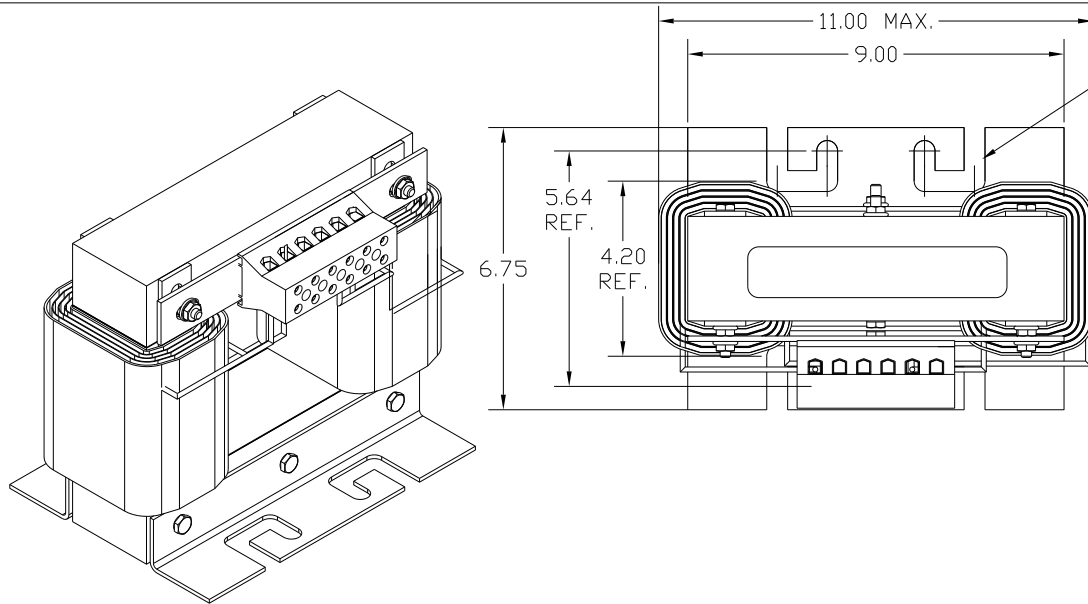

.50" WIDE SLOT




PART #	RATED AMPS	AMPS MAX	APPROX WT-LBS
--------	---------------	-------------	------------------

KDSG21B	70	70	50
---------	----	----	----

TCI		PERFORMANCE AND PROTECTION FOR DRIVES.	
TRANS-COIL, INC. MILWAUKEE, WI WWW.transcoil.com 800-824-8282	KDR Drive Reactor		
	CATALOG#	MOTOR HP/AMPS	
	1PH, 60Hz, 600V Max, --- A Max.		
	40C Amb Max, 155C Rise		
DATE CODE	A1		C1

TERMINAL BLOCK
TORQUE (LB-IN) = CUSTOMER WIRE

35 = 1 AWG THRU 4 AWG
30 = 6 AWG THRU 14 AWG
25 = 16 AWG THRU 20 AWG
20 = 22 AWG

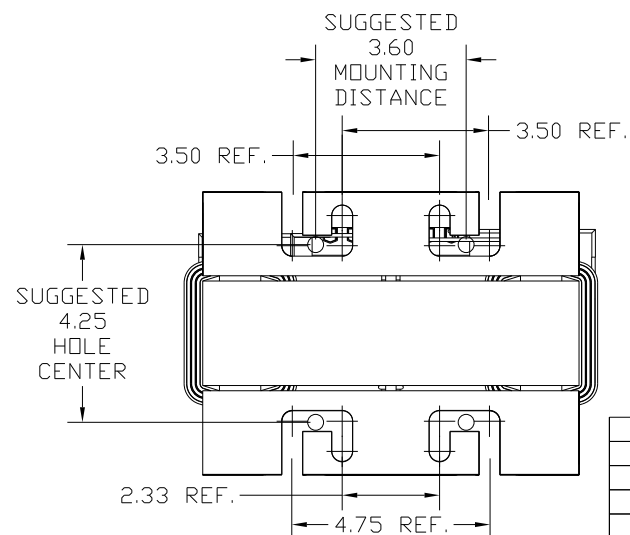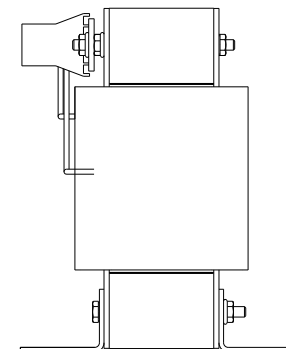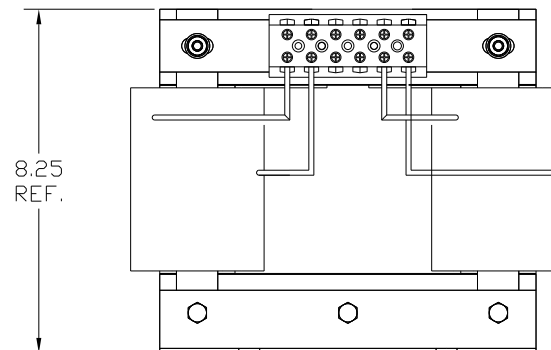

TOLERANCES (EXCEPT AS NOTED)				7878 N. 86th STREET MILWAUKEE, WI 53224	
NO	REVISION	DATE	BY		
				DECIMAL	
				.XX ± .03	
				.XXX ± .01	
				FRACTIONAL	
				± 1/32	
				ANGULAR	
				± 1/2°	
				DRN BY DSW	DATE 12/3/10
				SCALE TO FIT	APPROV. C 104555DG
				SHT. 1 OF 1	