
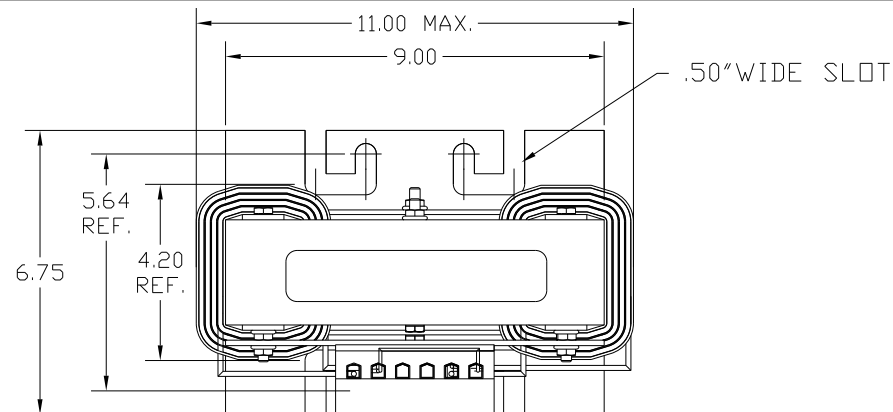


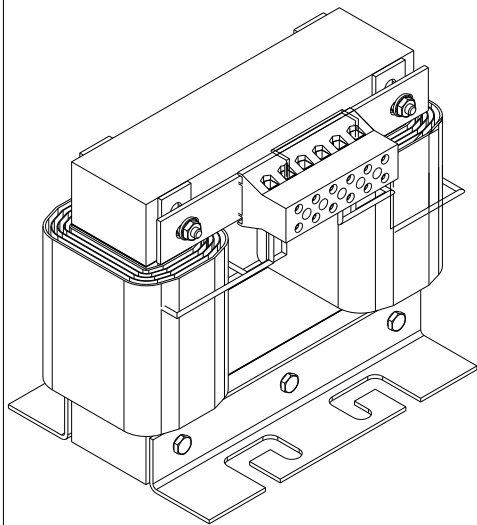

PART #	RATED AMPS	AMPS MAX	APPROX WT-LBS
--------	---------------	-------------	------------------




KDSG26J	21.6	21.6	54
---------	------	------	----

TRANS-COIL, INC. MILWAUKEE, WI WWW.transcoil.com 800-824-8282	PERFORMANCE AND PROTECTION FOR DRIVES. KDR Drive Reactor		C _{UL} US CSA [®] CE
	CATALOG# 1PH, 60Hz, 600V Max, (---A Max.) 40C Amb Max, 155C Rise	MOTOR HP/AMPS ---/---	

TERMINAL BLOCK

TORQUE(LB-IN)=CUSTOMER WIRE

35 = 1 AWG THRU 4 AWG
 30 = 6 AWG THRU 14 AWG
 25 = 16 AWG THRU 20 AWG
 20 = 22 AWG

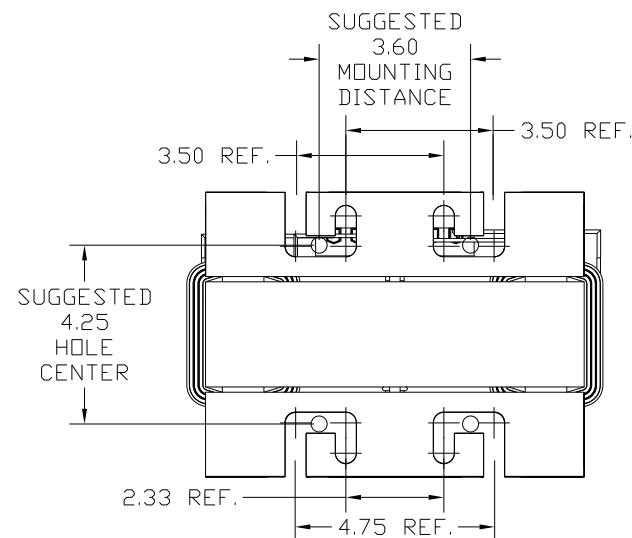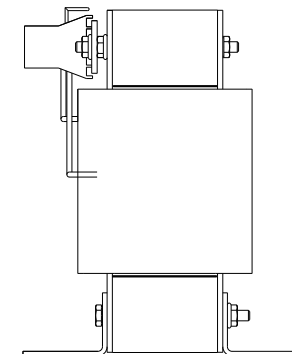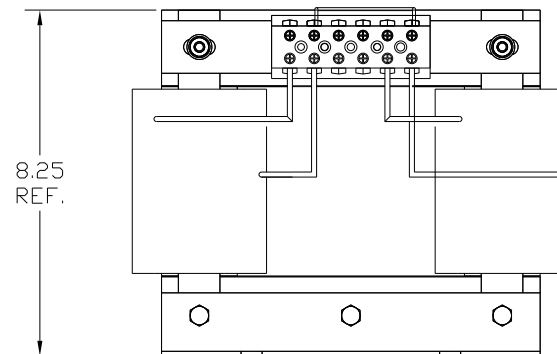

					TOLERANCES (EXCEPT AS NOTED)	 7878 N. 86th STREET MILWAUKEE, WI 53224
					DECIMAL	
					.XX ± .03	
					.XXX ± .01	
					FRACTIONAL ± 1/32	
					ANGULAR ± 1/2°	DRN BY DSW DATE 08/23/2010 DWG NO 104293DG
NO	REVISION	DATE	BY		SCALE TO FIT APPRVD C	SHT. 1 OF 1