

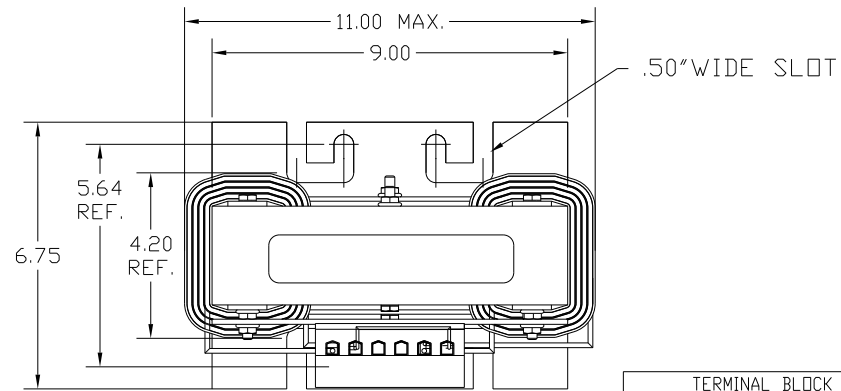
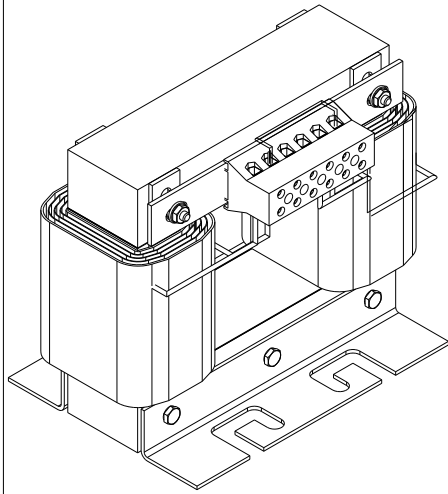
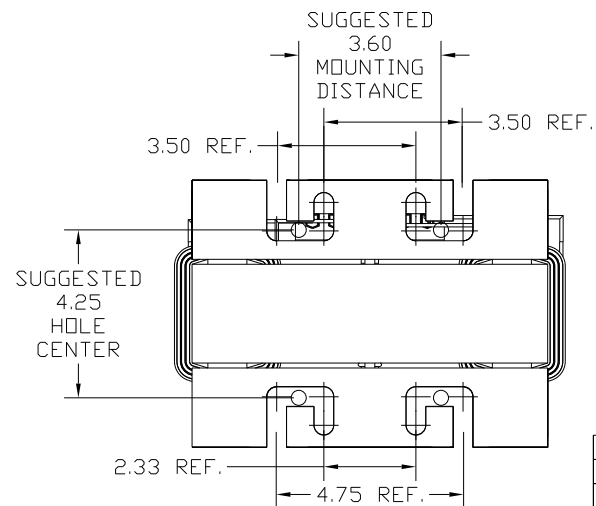


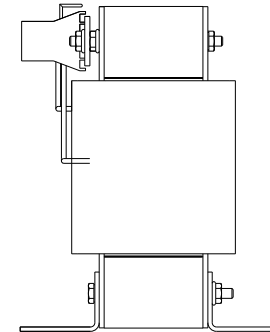

TERMINAL BLOCK
TORQUE(LB-IN)=CUSTOMER WIRE

35 = 1 AWG THRU 4 AWG
30 = 6 AWG THRU 14 AWG
25 = 16 AWG THRU 20 AWG
20 = 22 AWG

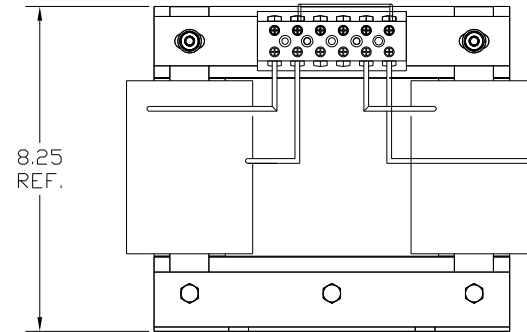

PART #	RATED AMPS	AMPS MAX	APPROX WT-LBS
--------	---------------	-------------	------------------

KDSG27J	27	27	46
---------	----	----	----

TRANS-COIL, INC.
MILWAUKEE, WI
WWW.TRANS-COIL.COM
800-824-8282

PERFORMANCE AND PROTECTION FOR DRIVES.
KDR Drive Reactor
CATALOG# MOTOR HP/AMPS
1PH, 60Hz, 600V Max, A Max.
40C Amb Max, 155C Rise

DATE CODE

A1

A2

C1

C2

				TOLERANCES (EXCEPT AS NOTED):		 7878 N. 86th STREET MILWAUKEE, WI 53224	
				DECIMAL			
				.XX ± .03		SINGLE PHASE TR. REACTOR 27 MAX , 240V (KDSG27J)	
				.XXX± .01			
				FRACTIONAL			
				± 1/32			
				ANGULAR		DRN. BY DSW DATE 12/2/10 DWG. NO. 104554DG	
				± 1/2°			
NO	REVISION	DATE	BY	SCALE TO FIT		APRVD. C SHT. 1 OF 1	

52A FILTER