

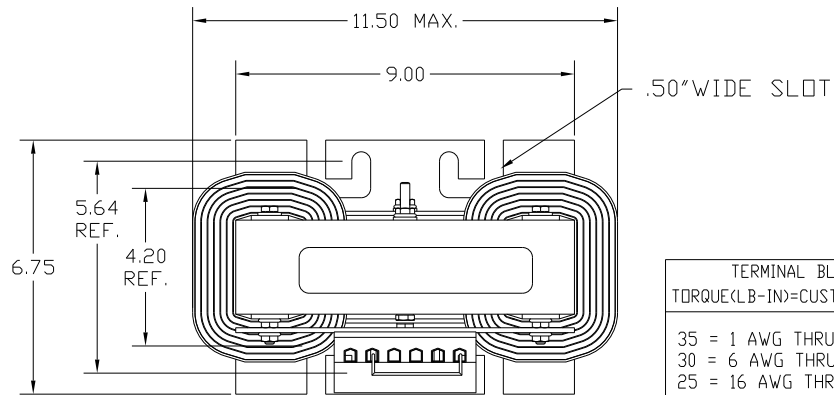
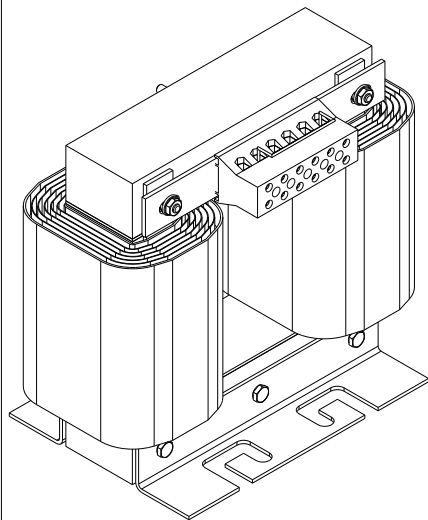
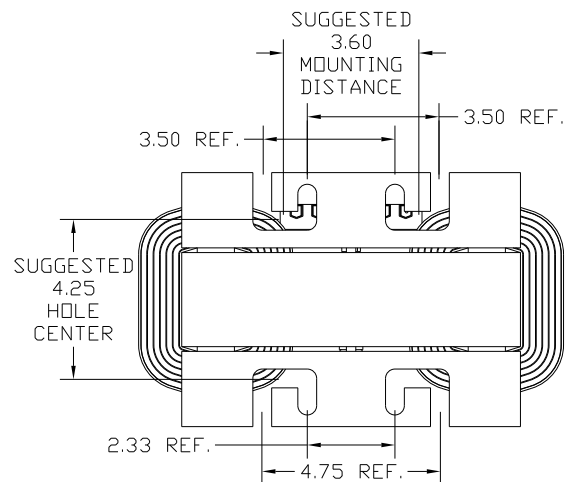


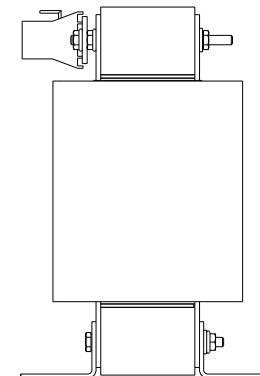

TERMINAL BLOCK
TORQUE(LB-IN)=CUSTOMER WIRE

35 = 1 AWG THRU 4 AWG
30 = 6 AWG THRU 14 AWG
25 = 16 AWG THRU 20 AWG
20 = 22 AWG

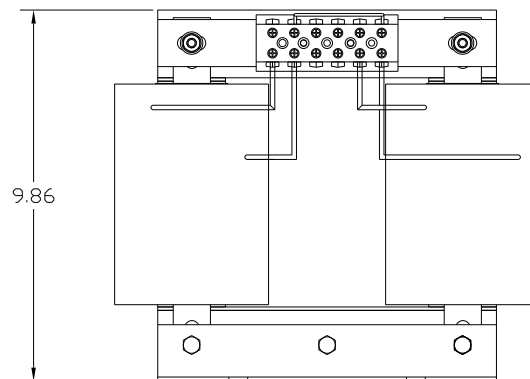

PART #	RATED AMPS	AMPS MAX	APPROX WT-LBS
--------	---------------	-------------	------------------

KDSG28J	36	36	54
---------	----	----	----

TCI TRANS-COIL, INC. MILWAUKEE, WI WWW.TRANSCOIL.COM 800-824-8282		PERFORMANCE AND PROTECTION FOR DRIVES. KDR Drive Reactor CATALOG# MOTOR HP/AMPS 1PH: 60Hz, 600V Max, [] A Max. 40C Amb Max, 155C Rise		UL US CSA CE	
DATE CODE	A1	A2	C1	C2	

				TOLERANCES (EXCEPT AS NOTED): DECIMAL .XX ± .03 .XXX ± .01 FRACTIONAL ± 1/32 ANGULAR ± 1/2°		TCI 7878 N. 86th STREET MILWAUKEE, WI 53224	
				SINGLE PHASE 70A, TRAP FILTER REACTOR 36A , 240V (KDSG28J)			
NO	REVISION	DATE	BY	DRN BY DSW	DATE 12/03/10	DWG NO. 104556DG	
				SCALE TO FIT	APPROV C	SHT. 1 OF 1	