
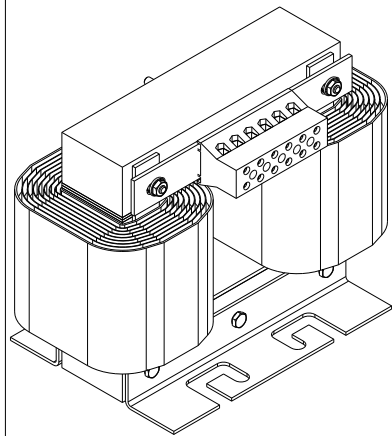
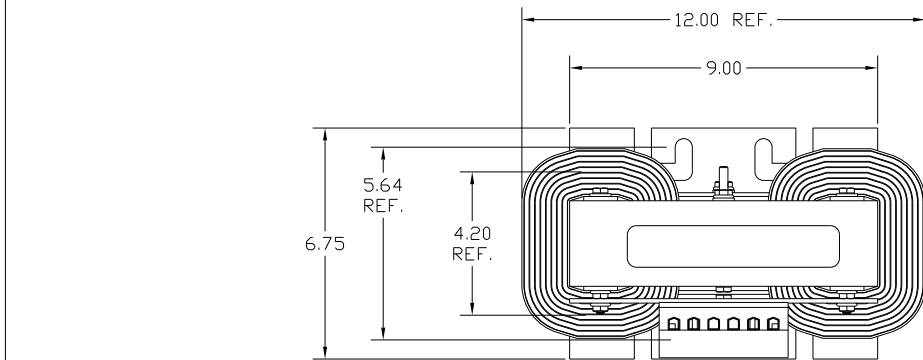
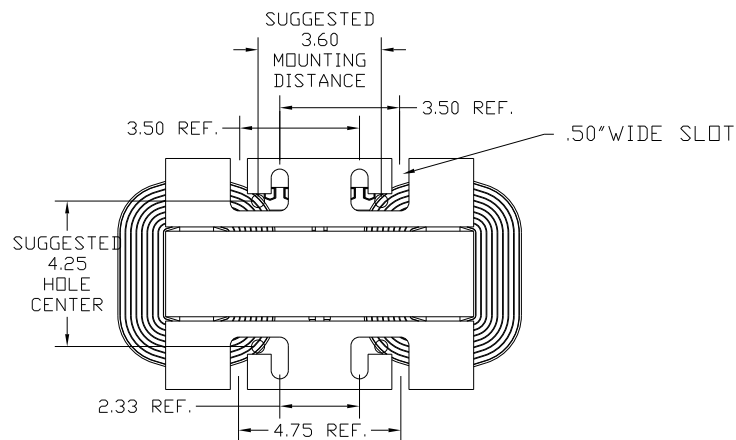


TERMINAL BLOCK
TORQUE(LB-IN)=CUSTOMER WIRE

35 = 1 AWG THRU 4 AWG
30 = 6 AWG THRU 14 AWG
25 = 16 AWG THRU 20 AWG
20 = 22 AWG



44A FILTER

PART #	RATED AMPS	AMPS MAX	APPROX WT-LBS
--------	---------------	-------------	------------------

KDSG4J	22.5	22.5	57
--------	------	------	----

TRANS-COIL, INC.
MILWAUKEE, WI
WWW.TRANSCOIL.COM
800-824-8282

PERFORMANCE AND PROTECTION FOR DRIVES.

KDR Drive Reactor

CATALOG# MOTOR HP/AMPS

1PH, 60Hz, 600V Max. A Max.

40C Amb Max, 155C Rise

DATE CODE

				TOLERANCES (EXCEPT AS NOTED):	7878 N. 86th STREET MILWAUKEE, WI 53224 SINGLE PHASE TR. REACTOR 22.5A , 480V (KDSG4J)
				DECIMAL	
				.XX ± .03	
				.XXX ± .01	
				FRACTIONAL ± 1/32	
NO	REVISION	DATE	BY	ANGULAR ± 1/2°	DRN BY DSW DATE 12/22/09 DWG NO 104155DG SCALE TO FIT APPRVD C SHT. 1 OF 1