

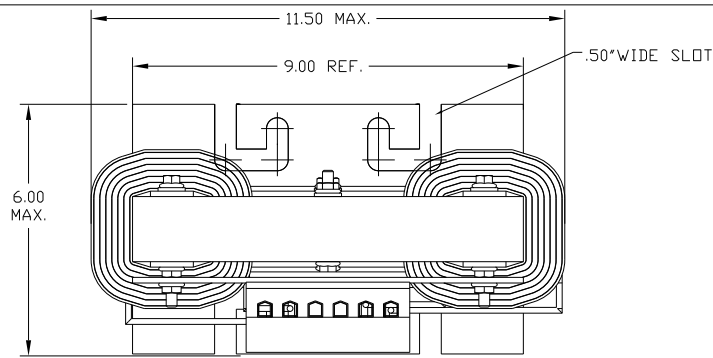
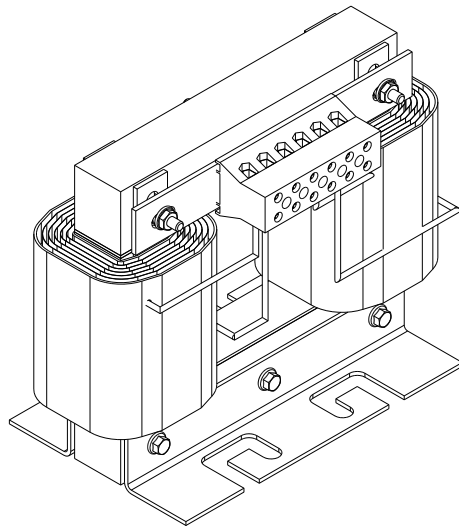


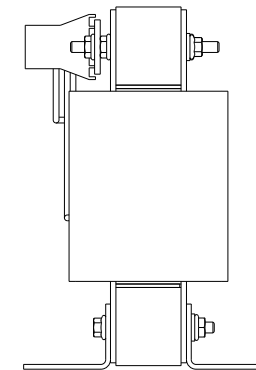


PART #	RATED AMPS	AMPS MAX	APPROX WT-LBS
KDSH26B	42.3	42.3	40

TCI		PERFORMANCE AND PROTECTION FOR DRIVES	
TRANS-COIL, INC. MILWAUKEE, WI WWW.transcoil.com 800-824-8282		KDR Drive Reactor CATALOG# MOTOR HP/AMPS 1PH, 60Hz, 600V Max. [--- A Max] 40C Amb Max, 115C Rise	
DATE CODE	A1 A2	B1 B2	C1 C2

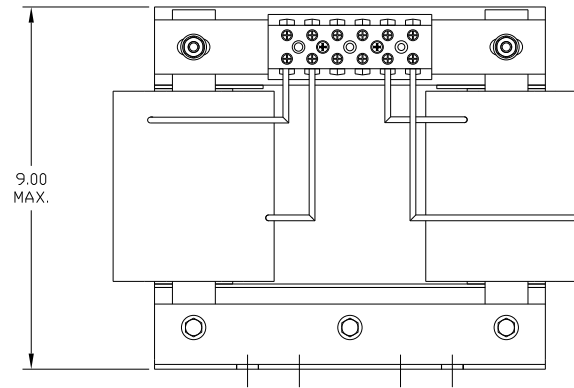

TERMINAL BLOCK TORQUE(LB-IN)=CUSTOMER WIRE	
35	= 1 AWG THRU 4 AWG
30	= 6 AWG THRU 14 AWG
25	= 16 AWG THRU 20 AWG
20	= 22 AWG

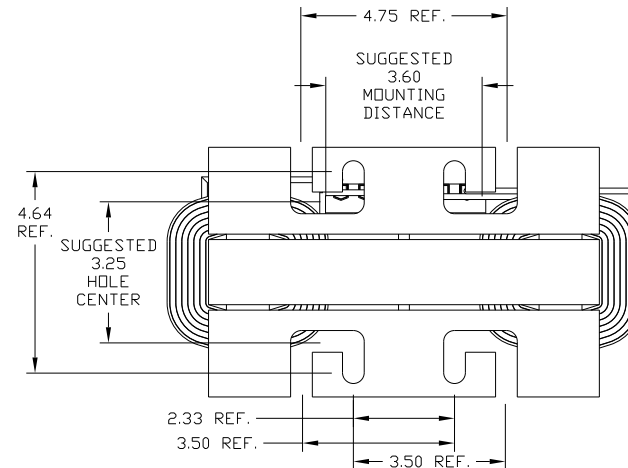

				TOLERANCES (EXCEPT AS NOTED): DECIMAL .XX ± .03 .XXX ± .01 FRACTIONAL ± 1/32 ANGULAR ± 1/2°	TCI 7878 N. 86th STREET MILWAUKEE, WI 53224	
				DRN. BY DSW DATE 8/23/2010 DWG. NO. 104292DG	SINGLE PHASE LR. REACTOR 42.3 MAX , 240V (KDSH26B)	
NO	REVISION	DATE	BY	SCALE TO FIT	APPRV.	SHT. 1 OF 1