

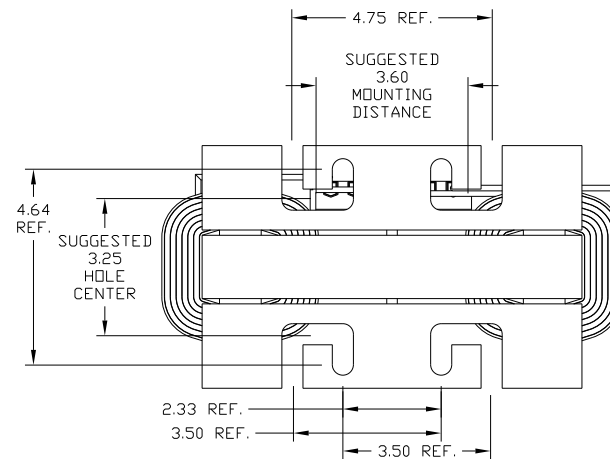
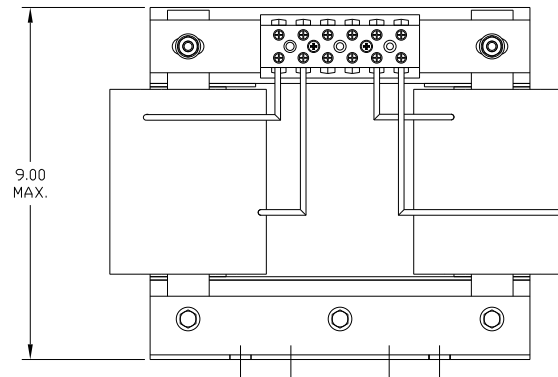
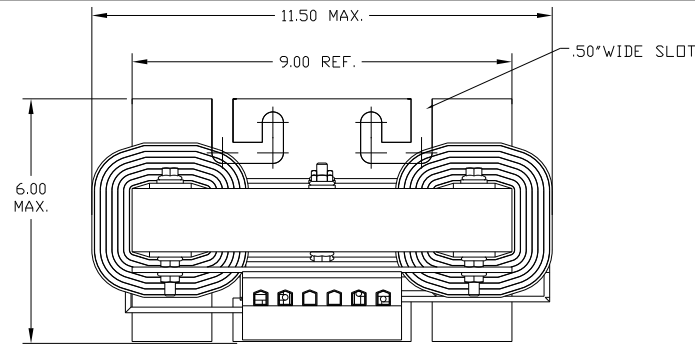


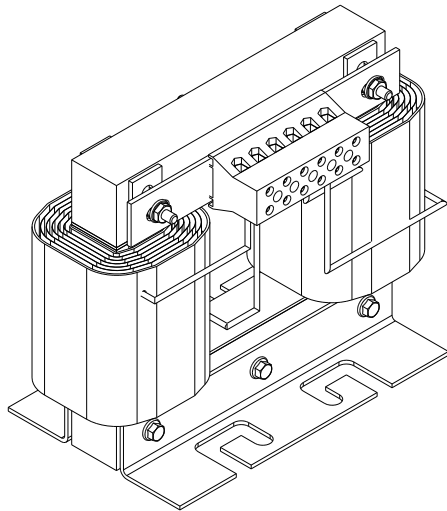

PART #	RATED AMPS	AMPS MAX	APPROX WT-LBS
--------	---------------	-------------	------------------

KDSH2B	20.9	21	35
--------	------	----	----

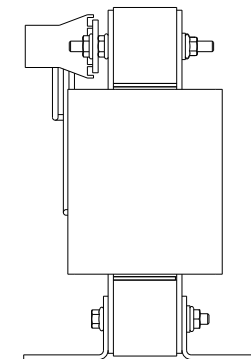

TERMINAL BLOCK TORQUE(LB-IN)=CUSTOMER WIRE
35 = 1 AWG THRU 4 AWG
30 = 6 AWG THRU 14 AWG
25 = 16 AWG THRU 20 AWG
20 = 22 AWG

					TOLERANCES (EXCEPT AS NOTED):		 7878 N. 86th STREET MILWAUKEE, WI 53224		
					DECIMAL				
					.XX ± .03				
					.XXX± .01				
					FRACTIONAL		SINGLE PHASE LR. REACTOR 21 MAX , 480V (KDSH2B)		
					± 1/32				
					ANGULAR				
					± 1/2°				
A	2661 ADD CE TO LABEL	3/24/10	DSW	DRN BY	DSW	DATE	11/30/09	DWG. NO.	104137DG
NO	REVISION	DATE	BY	SCALE	TO FIT	APPROV		C	SHT. 1 OF 1