
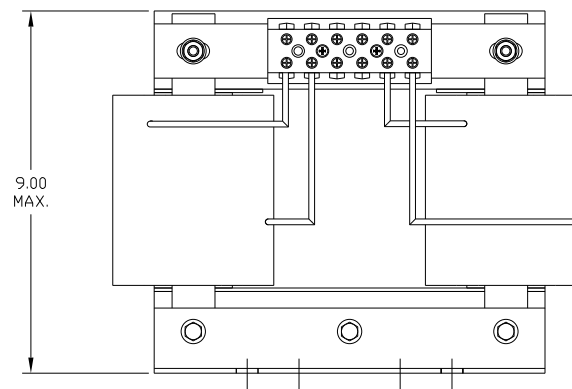
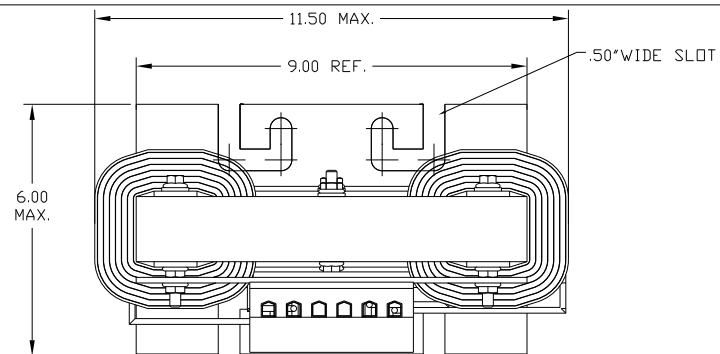
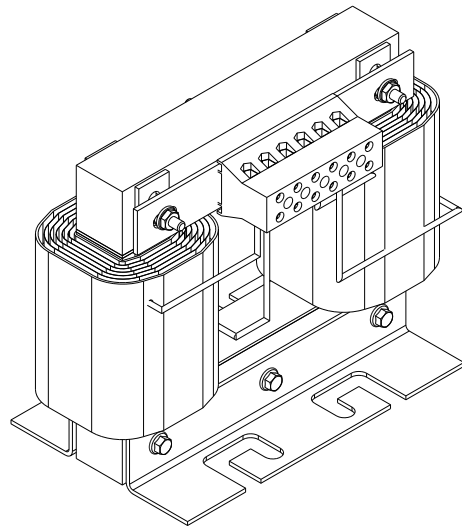



PART #	RATED AMPS	AMPS MAX	APPROX WT-LBS
--------	---------------	-------------	------------------

KDSH3B	14	14	30
--------	----	----	----



TERMINAL BLOCK
TORQUE(LB-IN)=CUSTOMER WIRE

35	=	1 AWG THRU 4 AWG
30	=	6 AWG THRU 14 AWG
25	=	16 AWG THRU 20 AWG
20	=	22 AWG

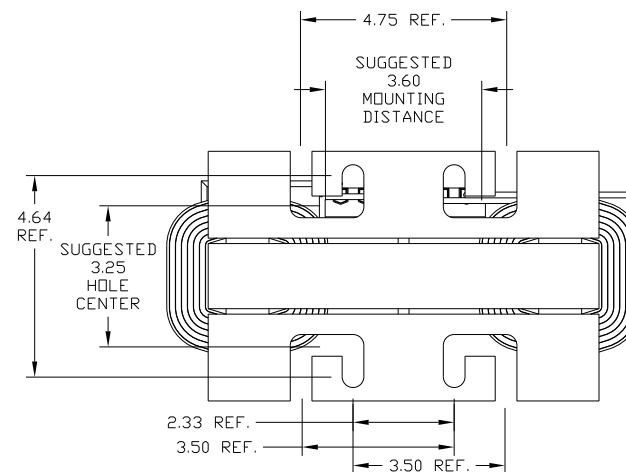

				TOLERANCES (EXCEPT AS NOTED)	 7878 N. 86TH STREET MILWAUKEE, WI 53224
				DECIMAL	
				.XX ± .03	
				.XXX ± .01	
				FRACTIONAL	
				± 1/32	
A	2661 ADD CE TO LABEL	3/24/10	DSW	ANGULAR	DRN BY DATE DSW 12/15/09 SCALE TO FIT APRVD C 104150DG SHT.1 OF 1