

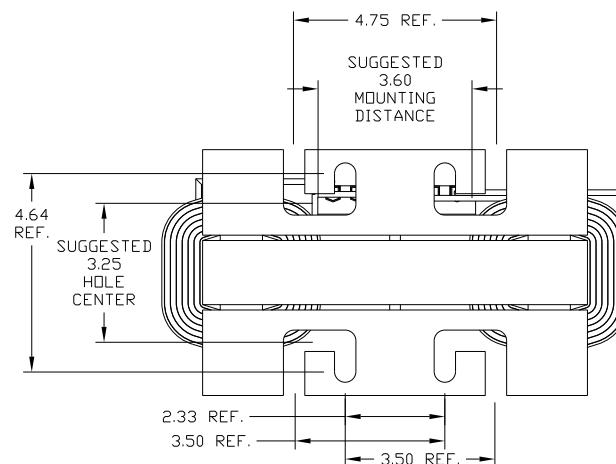
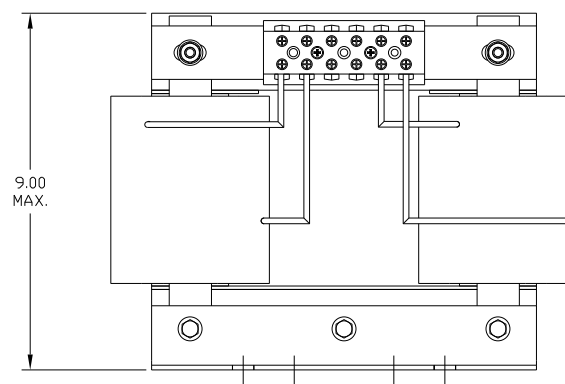
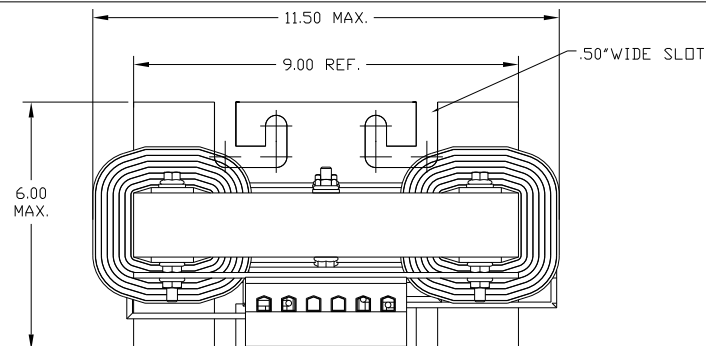


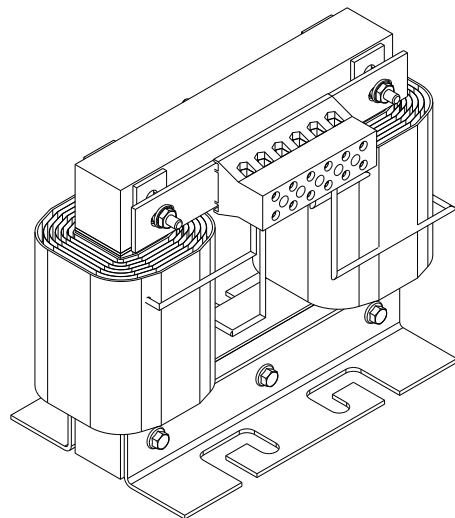

PART #	RATED AMPS	AMPS MAX	APPROX WT-LBS
--------	---------------	-------------	------------------

KDSH4B	34	34	38
--------	----	----	----

TCI		PERFORMANCE AND PROTECTION FOR DRIVES:	
TRANS-COIL, INC. MILWAUKEE, WI WWW.transcoil.com 800-824-8282	KDR Drive Reactor		
	CATALOG#	MOTOR HP/AMPS	
	1PH, 60Hz, 600V Max, --- A Max. 		
	40C Amb Max, 155C Rise		
DATE CODE	A1	A2	C1

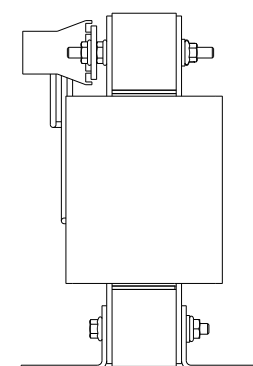

TERMINAL BLOCK TORQUE(LB-IN)=CUSTOMER WIRE	
35	= 1 AWG THRU 4 AWG
30	= 6 AWG THRU 14 AWG
25	= 16 AWG THRU 20 AWG
20	= 22 AWG

						TOLERANCES (EXCEPT AS NOTED)		 7878 N. 86th STREET MILWAUKEE, WI 53224		
						DECIMAL		SINGLE PHASE LR. REACTOR 34 MAX , 480V (KDSH4B)		
						.XX ± .03				
						.XXX ± .01				
						FRACTIONAL ± 1/32				
A	2661 ADD CE TO LABEL			3/24/10	DSW	ANGULAR ± 1/2°		DRN BY DSW	DATE 12/21/09	DWG. NO. 104154DG
NO	REVISION			DATE	BY			SCALE TO FIT	APPROV. C	SHT. 1 OF 1