
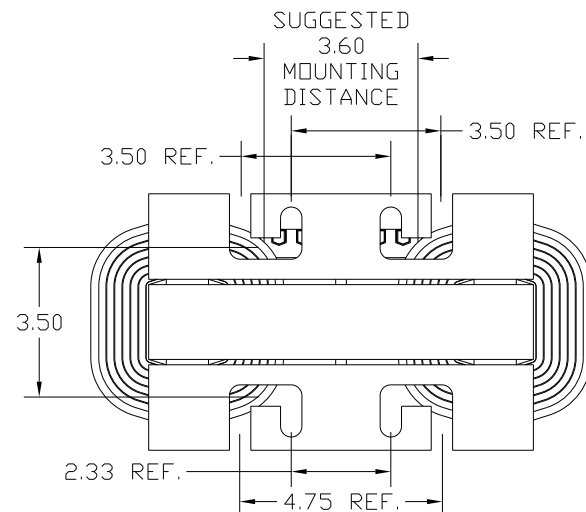
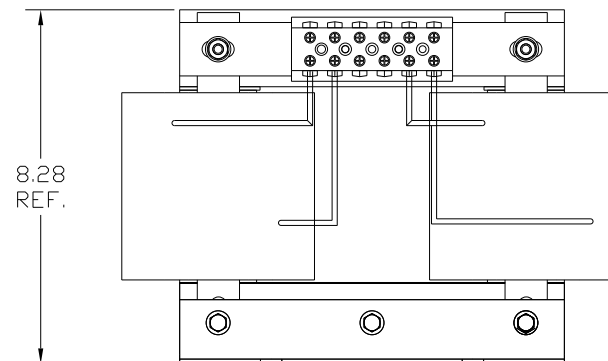
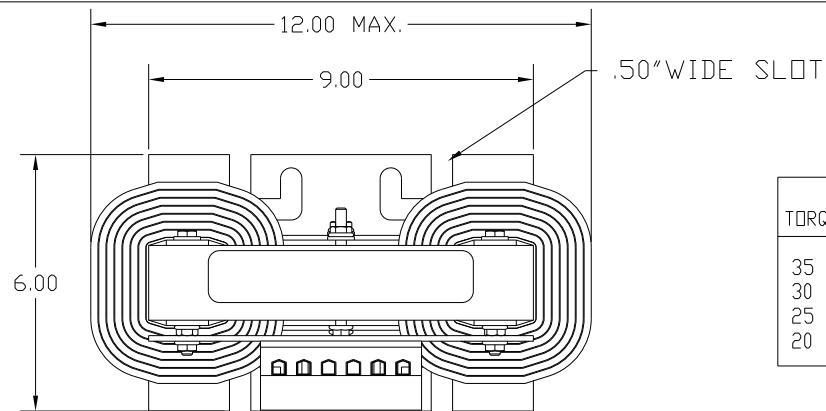


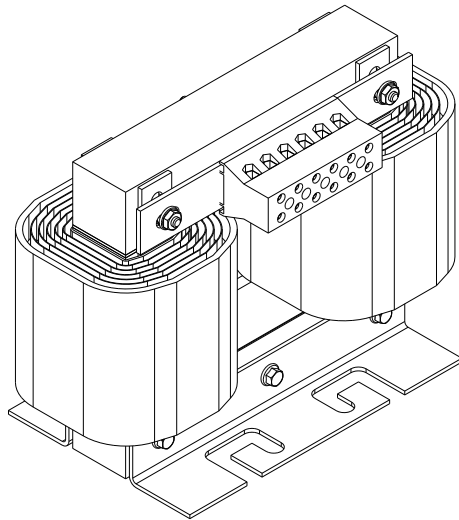


52 AMP Filter

PART #	RATED AMPS	AMPS MAX	APPROX WT-LBS
--------	---------------	-------------	------------------

KDSI21B	52	52	36
---------	----	----	----

TERMINAL BLOCK			
TORQUE(LB-IN)=CUSTOMER WIRE PERFORMANCE AND PROTECTION FOR DRIVES.			
35 = 1 AWG THRU 14 AWG			
30 = 6 AWG THRU 14 AWG			
25 = 16 AWG THRU 20 AWG			
20 = 22 AWG			

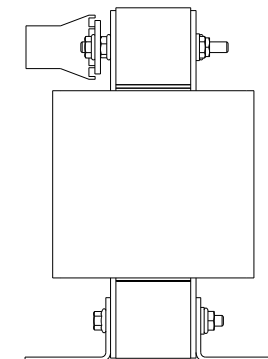

TOLERANCES (EXCEPT AS NOTED):			
DECIMAL			
.XX ± .03			
.XXX ± .01			
FRACTIONAL			
± 1/32			
ANGULAR			
± 1/2°			

TCL 7878 N. 86th STREET
MILWAUKEE, WI 53224

SINGLE PHASE TR. REACTOR
52A MAX , 240V (KDSI21B)

DRN BY	DSW	DATE	12/2/10	DWG NO.	104553DG
SCALE	TO FIT	APPROV.			

SHT. 1 OF 1