

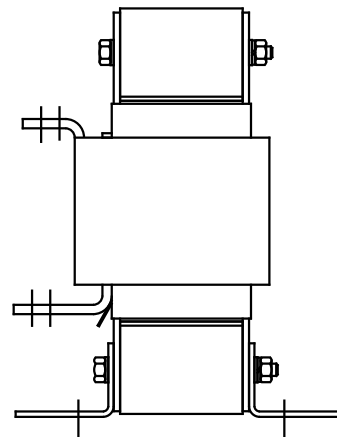
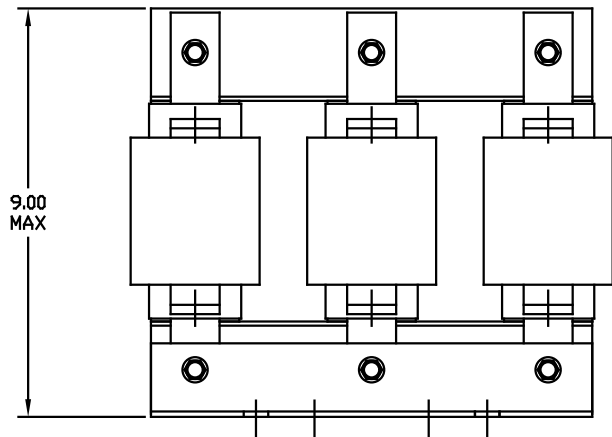


| CATALOG NO | VOLTS(V.) | __mH±10% | __AMPS(A) | APPROX WT-LBS | (TERMINAL) DIA HOLE |
|------------|-----------|----------|-----------|---------------|---------------------|
| KLR110CCB | 24 | .334 | 110 | 53 | .28 DIA HOLE |
| KLR130ACB | 14.4 | .170 | 130 | 50 | .28 DIA HOLE |
| KLR160ACB | 14.4 | .138 | 160 | 53 | .34 DIA HOLE |

SEE CHART FOR HOLE SIZE, (6 PLACES)

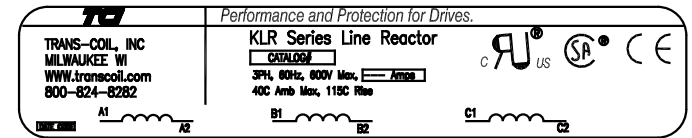

SUGGESTED 3.60 MOUNTING DISTANCE

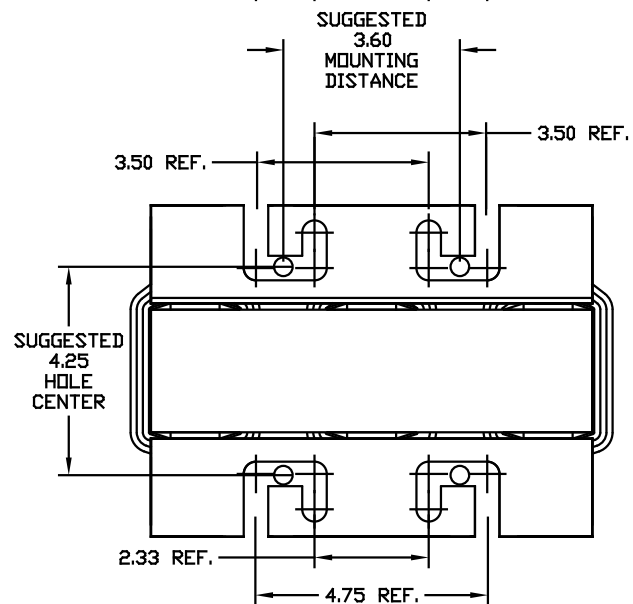

| | | | | | |
|--------------------|----------|-----------------------------|----|--|--|
| | | TOLERANCES EXCEPT AS NOTED: | | 7878 N. 86th STREET MILWAUKEE, WI 53224 | |
| | | DECIMAL | | | |
| | | .XX ± .03 | | SINE-GUARD REACTOR KLR CB'S (FRAME G) | |
| | | .XXX ± .010 | | | |
| | | FRACTIONAL ± 1/16 | | DESIGNED BY: BW DATE: 03/06/98 Dwg. No: KLR-24DG SCALE: 1/2"=1" APPROVED: C | |
| | | ANGULAR ± 1/2° | | | |
| 2235, MOUNTING CHG | 06/03/03 | DSW | | | |
| NO | REVISION | DATE | BY | | |