





690V	NEC MOTOR HP	CATALOG NO	__AMPS(A)	APPROX WT-LBS	WATTS LOSS
3% Z	7.5	KLR12DQDDR	12	7	44

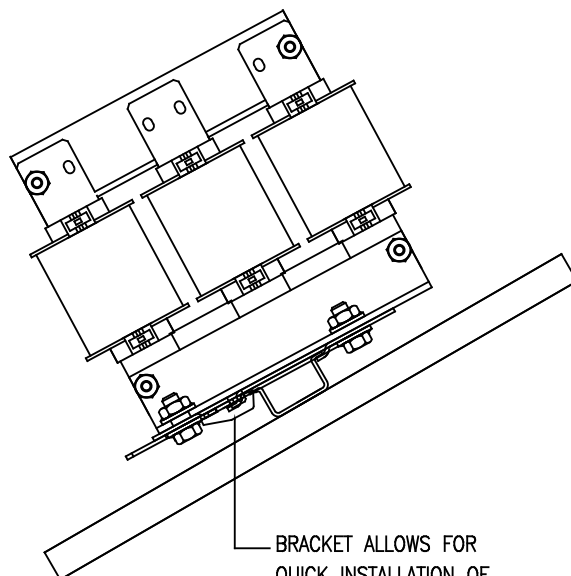


BRACKET ALLOWS FOR
QUICK INSTALLATION OF
REACTOR ON DIN RAIL.

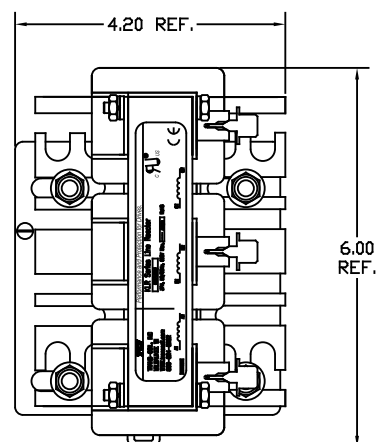


6-32 SET SCREW.
SCREW MUST BE FLUSH
WITH BOTTOM PLATE.

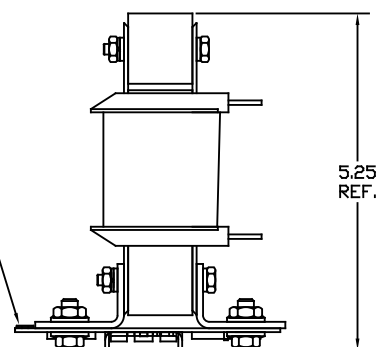

TCI'S DIN RAIL MOUNTED REACTORS FIT STANDARD SIZE DIN RAIL.
TCI RECOMMENDS USING HIGH PROFILE STANDARD STEEL RAIL
OR HEAVY DUTY STANDARD STEEL DIN RAIL.



STANDARD
STEEL
HIGH PROFILE
DIN RAIL.



HEAVY DUTY
STEEL
DIN RAIL.

TCI RECOMMENDS TAKING PRECAUTIONS WHEN SHIPPING
MOUNTED REACTORS.

				TOLERANCES UNLESS NOTED		TCI 7878 N. 86th STREET MILWAUKEE, WI 53224	
				XX ±.03		DIN RAIL REACTORS 690V (FRAME B)	
				XXX±.01			
				FRACTIONAL ± 1/32			
NO	REVISION	DATE	BY	± 1/2"	DRN BY DSV	DATE 03/06/07	FILE NO B KLR12DQDDRVDG SHT. 1 OF 1