

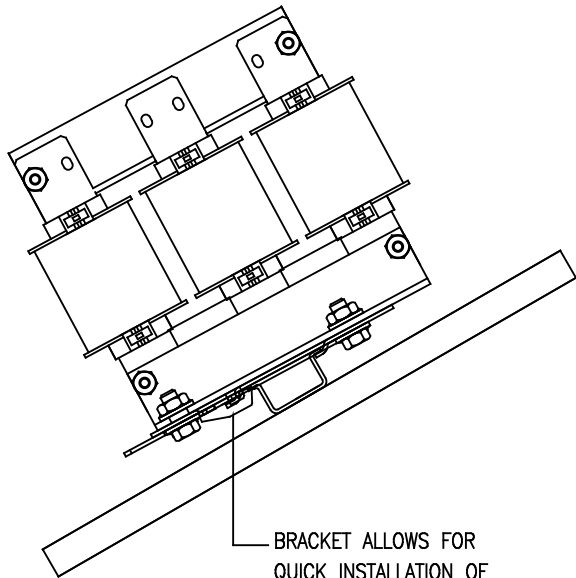


690V	NEC MOTOR HP	CATALOG NO	__AMPS(A)	APPROX WT-LBS	WATTS LOSS
5% Z	3	KLR6EQDDR	6	7	28

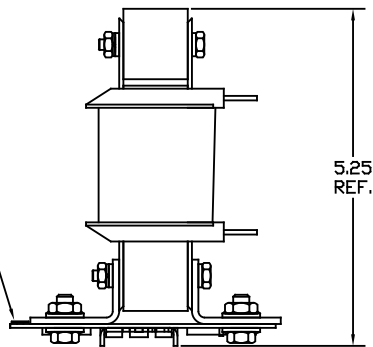

BRACKET ALLOWS FOR QUICK INSTALLATION OF REACTOR ON DIN RAIL.

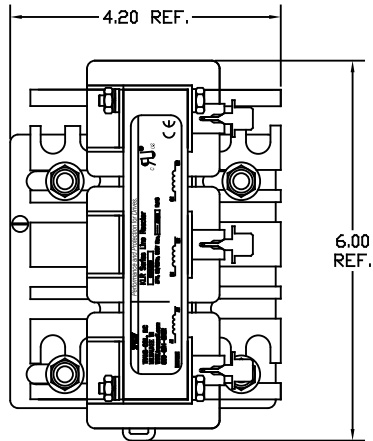

6-32 SET SCREW. SCREW MUST BE FLUSH WITH BOTTOM PLATE.

TCI Performance and Protection for Drives.


<p>TRANS-COIL, INC MILWAUKEE WI WWW.transcoil.com 800-824-8282</p>	<p>KLR Series Line Reactor</p> <p>690V/3PH</p> <p>3PH, 50/60Hz, 600V Max. </p>
--	--

AI RI


BI BI

CI CI

TCI'S DIN RAIL MOUNTED REACTORS FIT STANDARD SIZE DIN RAIL. TCI RECOMMENDS USING HIGH PROFILE STANDARD STEEL RAIL OR HEAVY DUTY STANDARD STEEL DIN RAIL.



STANDARD STEEL HIGH PROFILE DIN RAIL.



HEAVY DUTY STANDARD STEEL DIN RAIL.

TCI RECOMMENDS TAKING PRECAUTIONS WHEN SHIPPING MOUNTED REACTORS.

				TOLERANCES EXCEPT AS NOTED	TCI 7878 N. 86th STREET MILWAUKEE, WI 53224
				.XX ± .03 .XXX ± .01 FRACTIONS ± 1/32	
				SCALE TO FIT	DIN RAIL REACTORS 690V (FRAME B)
NO	REVISION	DATE	BY	DRAWN BY JISV	DATE 03/06/07
				PART NO. KLR6EQDDRVDG	SHEET 1 OF 1