

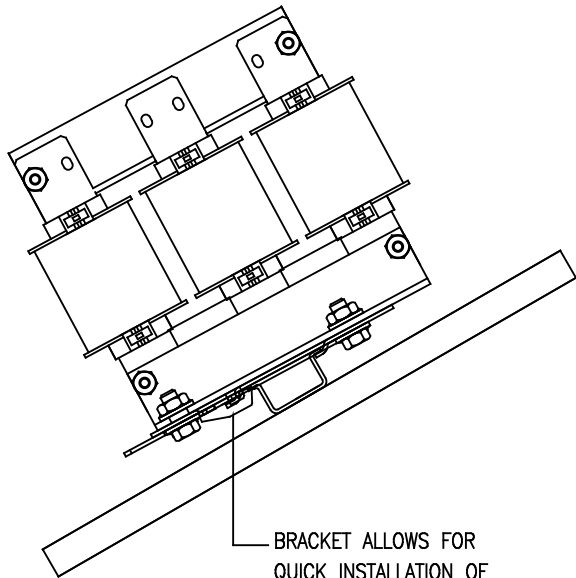


690V	NEC MOTOR HP	CATALOG NO	__AMPS(A)	APPROX WT-LBS	WATTS LOSS
5% Z	5	KLR8EQDDR	8	7	48

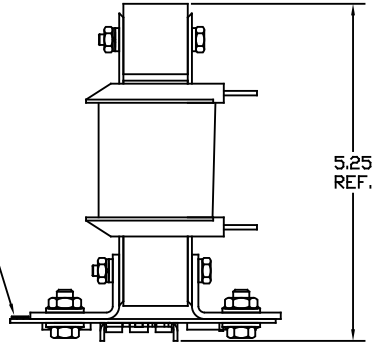

BRACKET ALLOWS FOR QUICK INSTALLATION OF REACTOR ON DIN RAIL.

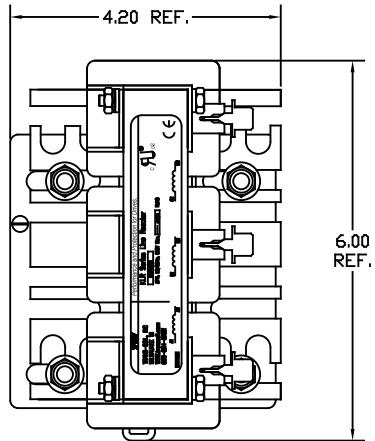

6-32 SET SCREW. SCREW MUST BE FLUSH WITH BOTTOM PLATE.


TCI Performance and Protection for Drives.

TRANS-COIL, INC
MILWAUKEE WI
WWW.transcoil.com
800-824-8282


KLR Series Line Reactor
690V/50/60Hz
3PH, 50/60Hz, 600V Max. **Frame B**

CE

TCI'S DIN RAIL MOUNTED REACTORS FIT STANDARD SIZE DIN RAIL. TCI RECOMMENDS USING HIGH PROFILE STANDARD STEEL RAIL OR HEAVY DUTY STANDARD STEEL DIN RAIL.



STANDARD STEEL HIGH PROFILE DIN RAIL.



HEAVY DUTY STANDARD STEEL DIN RAIL.

TCI RECOMMENDS TAKING PRECAUTIONS WHEN SHIPPING MOUNTED REACTORS.

				<p>TOLERANCES UNLESS OTHERWISE SPECIFIED:</p> <p>.XX ± .03</p> <p>.XXX ± .01</p> <p>FRACTIONS ± 1/32</p> <p>ANGLES ± 1/2°</p>		<p>TCI 7878 N. 86th STREET MILWAUKEE, WI 53224</p>	
				<p>DIN RAIL REACTORS 690V (FRAME B)</p>		<p>DATE: 03/06/07</p>	
NO	REVISION	DATE	BY	SCALE: TO FIT	DESIGNED BY: JSV	DATE: 03/06/07	PART NO: KLR8EQDDRVDG
							<p>SHEET 1 OF 1</p>