

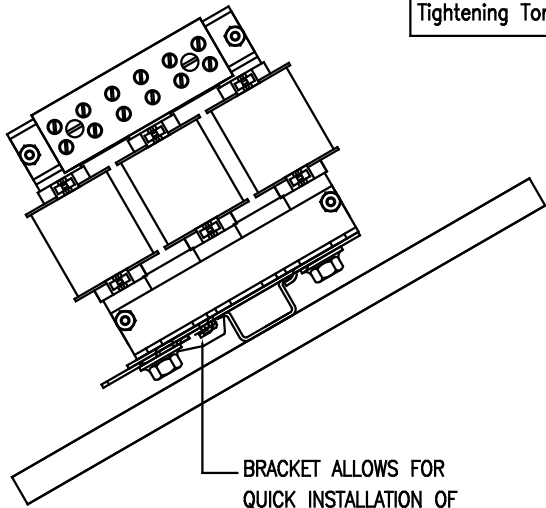


Block Wire Range: #18 to #4 AWG Solid or Stranded, Copper
Tightening Torque: 20 LB-IN

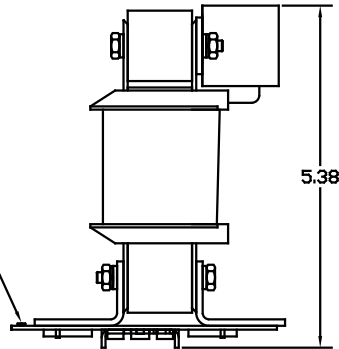

BRACKET ALLOWS FOR QUICK INSTALLATION OF REACTOR ON DIN RAIL.

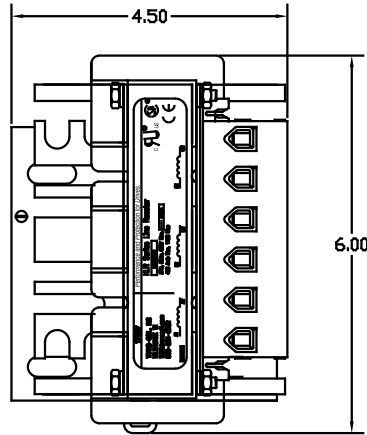

SET SCREW

CATALOG NO	VOLTS(V)	__mH-±10%	__AMPS(A)	APPROX WT-LBS	TORQUE(LB-IN)
KLR16ATBDR	14.40	1.38	16	8	20
KLR16BTBDR	7.20	.689	16	7	20
KLR16DTBDR	17.25	1.65	16	8	20

TRANS-COIL, INC
MILWAUKEE WI
WWW.transcoil.com
800-824-8282

Performance and Protection for Drives.


KLR Series Line Reactor

CATALOG# _____


3PH, 60Hz, 600V Max, _____ Amps

40C Amb Max, 115C Rise


NOTE: A1, A2, B1, B2, C1, C2, MARKINGS ON TERMINAL BLOCK FOR REFERENCE ONLY.

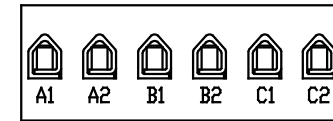

TCI'S DIN RAIL MOUNTED REACTORS FIT STANDARD SIZE DIN RAIL. TCI RECOMMENDS USING HIGH PROFILE STANDARD STEEL RAIL OR HEAVY DUTY STANDARD STEEL DIN RAIL.



STANDARD STEEL HIGH PROFILE DIN RAIL.



HEAVY DUTY STEEL DIN RAIL.

TCI RECOMMENDS TAKING PRECAUTIONS WHEN SHIPPING MOUNTED REACTORS.

				7878 N. 86th STREET MILWAUKEE, WI 53224	
				KLR B FRAME DIN RAIL REACTOR	
				REV 08/10/04 KLRBDR-1DG	
NO	REVISION	DATE	BY	± 1/2"	REV. 1