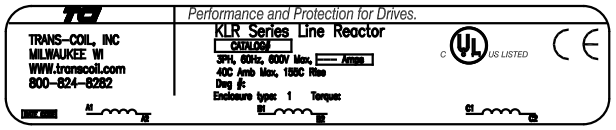

LABEL PLACED ON INSIDE WALL OF CABINET.

CATALOG NO	VOLTS(V.)	__mH-±10%	__AMPS(A)	APPROX WT-LBS
KLRUL300BPTE01	7.20	.037	300	132
KLRUL300FPTE01	8.62	.044	300	132

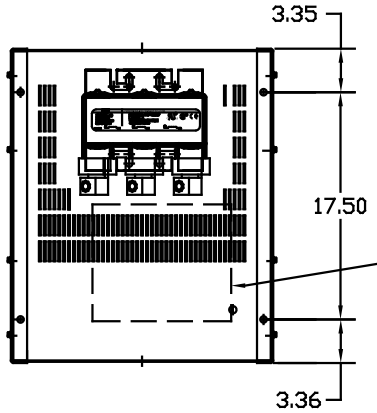

RECOMMENDED CONDUIT ENTRANCE AREA – LEFT FRONT SIDE, BOTTOM FRONT. RIGHT FRONT SIDE AND TOP.

NOTE: LUGS ROTATED TO MEET CLEAREANCE (PHASE TO PHASE), AND TO MEET CLEARANCE FROM LUGS TO GROUNDING SURFACE.

LUG WIRE RANGE FOR REACTOR.	ONE 600MCM–4 TWO 250MCM–1/0, AL. OR CU.
TIGHTENING TORQUE.	500 LB–IN

LABEL PLACED ON FRONT OF CABINET.

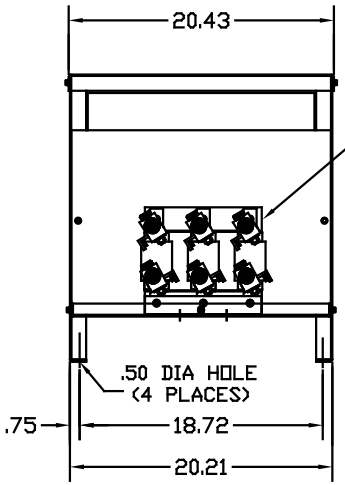

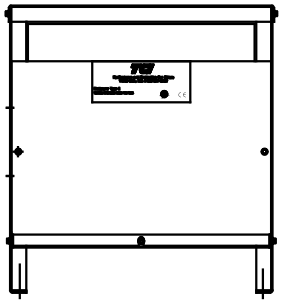

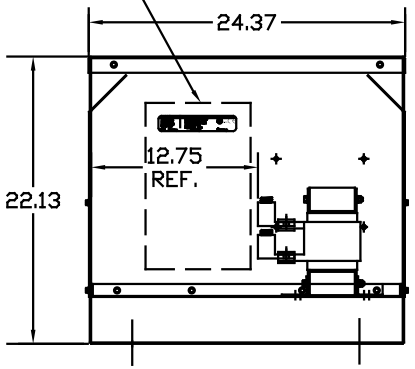

VENDOR LILLY POWDER COATINGS, INC.
PRODUCT CODE 312E
COLOR PEBBLE GRAY
POWDER TYPE POLYESTER POLYURETHANE

PAINT SUITABLE FOR OUTDOOR APPLICATION PER UL TYPE 3R AND APPLIED PER A UL ACCEPTED DTW2 COATING PROGRAM.

CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL LOCAL AND NATIONAL CODES

NO	REVISION	DATE	BY

TOLERANCES (EXCEPT AS NOTED)
DECIMAL
.XX ±.03
.XXX±.01
FRACTIONAL
± 1/32
ANGULAR
± 1/2°

7878 N. 86th STREET
MILWAUKEE, WI 53224

KLR FRAME J (ILSCO LUGS) TYPE 1 ENCLOSURE

DRN. BY DSW | DATE 12/09/03 | DWG. NO. B KLRULENCL-23DG
SCALE TO FIT | APRVD. | SHT. 1 OF 1