CATALOG NO	VOLTS(V.)	__mH-±10%	__AMPS(A)	APPROX WT-LBS
KLRUL850APTE01	14.40	.026	850	618
KLRUL850CPTE01	24.00	.043	850	608
KLRUL850DPTE01	17.24	.031	850	605
KLRUL850EPTE01	28.75	.052	850	618
KLRUL950APTE01	14.40	.023	950	625
KLRUL950CPTE01	24.00	.039	950	618
KLRUL950DPTE01	17.24	.027	950	608
KLRUL950EPTE01	28.75	.046	950	618

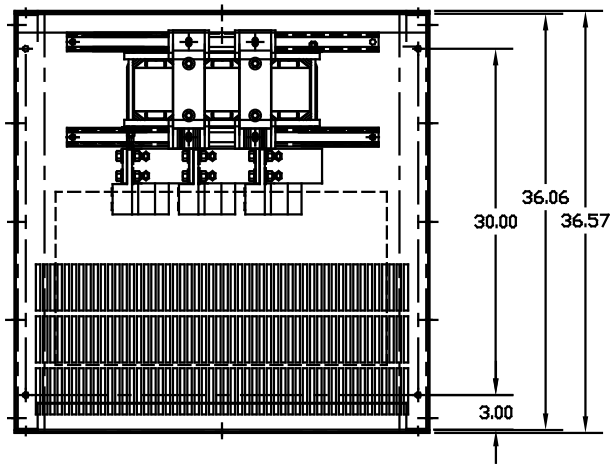

LABEL PLACED ON INSIDE WALL OF CABINET.

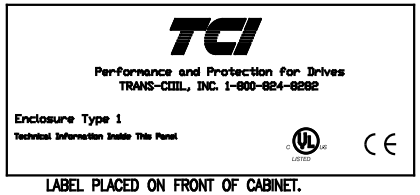

LABEL PLACED ON FRONT OF CABINET.

RECOMMENDED CONDUIT ENTRANCE AREA – LEFT FRONT SIDE, BOTTOM FRONT. RIGHT FRONT SIDE AND TOP.

NOTE: LUGS ROTATED TO MEET CLEAREANCE (PHASE TO PHASE), AND TO MEET CLEARANCE FROM LUGS TO GROUNDING SURFACE.

LUG WIRE RANGE FOR REACTOR.	THREE 600MCM-2, AL. OR CU.
TIGHTENING TORQUE.	500 LB-IN

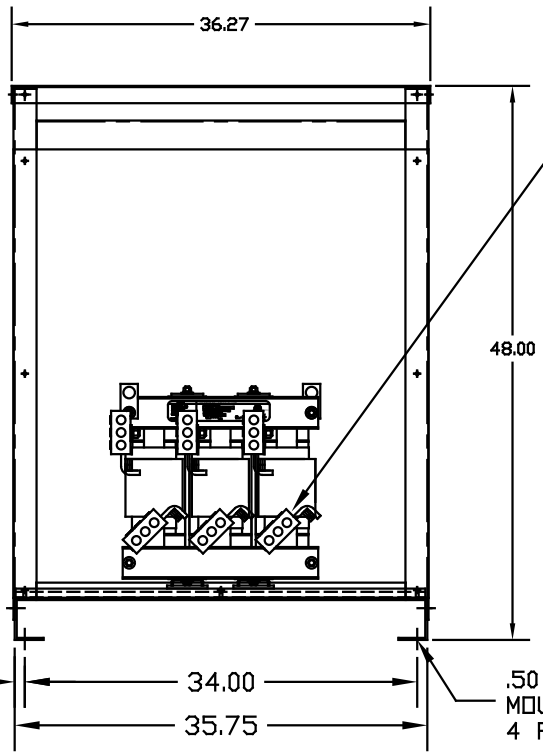

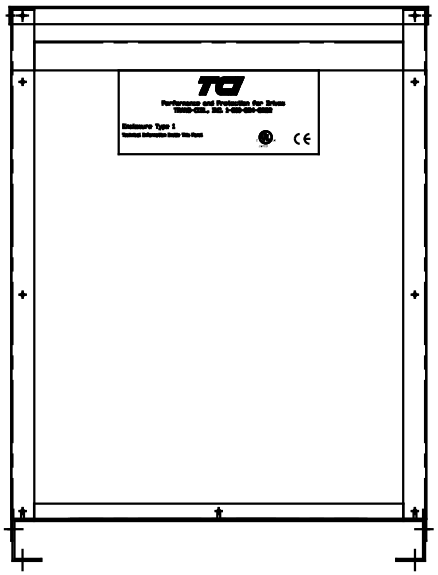

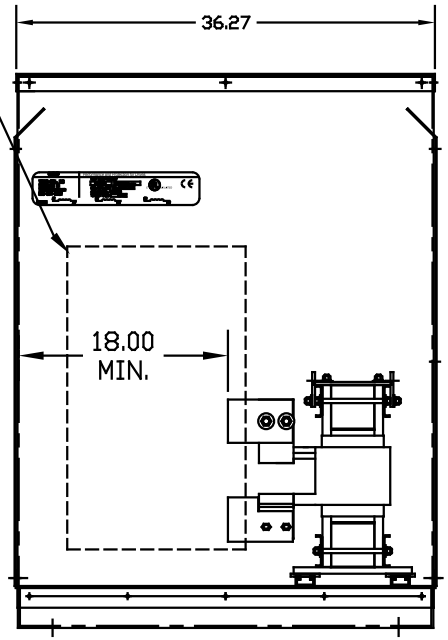

VENDOR LILLY POWDER COATINGS, INC.
PRODUCT CODE 312E
COLOR PEBBLE GRAY
POWDER TYPE POLYESTER POLYURETHANE

PAINT SUITABLE FOR OUTDOOR APPLICATION PER UL TYPE 3R AND APPLIED PER A UL ACCEPTED DTW2 COATING PROGRAM.

CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL LOCAL AND NATIONAL CODES

NO	REVISION	DATE	BY

TOLERANCES (EXCEPT AS NOTED)
DECIMAL
.XX ±.03
.XXX±.01
FRACTIONAL
± 1/32
ANGULAR
± 1/2°

TCI 7878 N. 86th STREET MILWAUKEE, WI 53224

KLR FRAME X (ILSCO LUGS) TYPE 1 ENCLOSURE

DRN. BY DSW | DATE 07/06/04 | DWG. NO. KLRULENCL-42DG
SCALE TO FIT | APPVD. | C | SHT. 1 OF 1