


TERMINAL BLK MARKING

BLOCK WIRE RANGE #18-#4 AWG  
TIGHTENING TORQUE. 20 LB-IN

CATALOG NO	VOLTS(V.)	__mH±10%	__AMPS(A)	APPROX WT-LBS	TORQUE(LB-IN)
KLRUL12ETB	28.75	3.67	12	8	20
KLRUL16CTB	24.00	2.30	16	13	20
KLRUL16ETB	28.75	2.75	16	13	20
KLRUL18ATB	14.40	1.23	18	12	20
KLRUL18CTB	24.00	2.04	18	12	20
KLRUL18DTB	17.25	1.47	18	12	20
KLRUL21ATB	14.40	1.050	21	13	20
KLRUL21DTB	17.25	1.26	21	13	20
KLRUL25ATB	14.40	.882	25	13	20
KLRUL25DTB	17.25	1.06	25	13	20
KLRUL27ATB	14.40	.817	27	13	20
KLRUL27DTB	17.25	.978	27	13	20
KLRUL55BTB	7.20	.200	55	12	20
KLRUL55FTB	8.62	.240	55	12	20

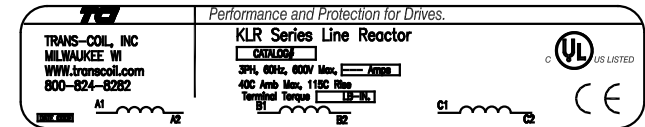

NOTE: A1, A2, B1, B2, C1, C2,  
MARKINGS ON COIL AND TERMINAL BLOCK  
FOR REFERENCE ONLY.

NO	REVISION	DATE	BY	TOLERANCES EXCEPT AS NOTED
				DECIMAL
				.XX ± .03
				.XXX ± .01
				FRACTIONAL
				± 1/32
				ANGULAR
				± 1/2°

**TCI** 7878 N. 86th STREET  
MILWAUKEE, WI 53224

KLRUL OPEN (FRAME C)  
LINE REACTOR

DRN BY DSW DATE 05/10/04 DWG NO BDKLRULOPEN-3DG  
SCALE TO FIT APPRVD. SHT. 1 OF 1