
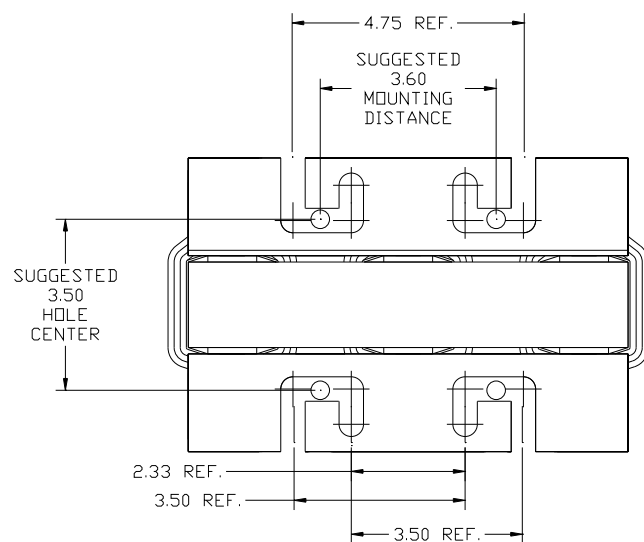
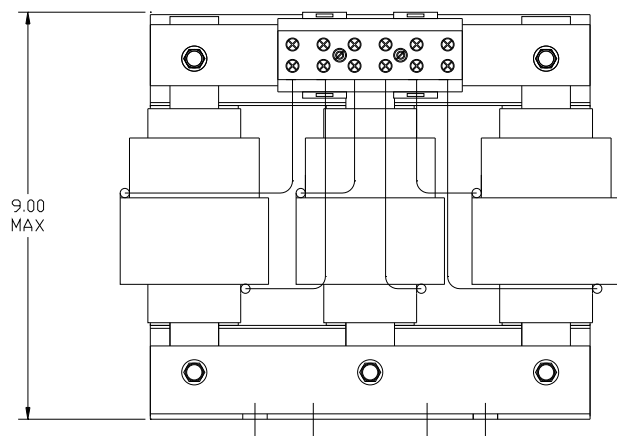


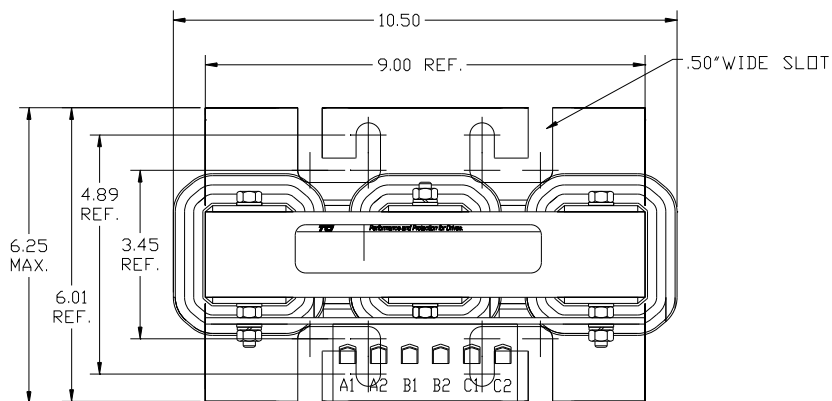


CATALOG NO	__mH $\begin{smallmatrix} +8\% \\ -2\% \end{smallmatrix}$	__AMPS(A)	APPROX WT-LBS
KTR15C65HG	2.882	22.96	45

TCI
 TRANS-COIL, INC
 MILWAUKEE, WI
 WWW.transcoil.com
 800-824-8282


Performance and Protection for Drives.
 KTR Tuning Reactor
 CATALOG#
 3PH, 60Hz, 600V Max, --- Amps
 40C Amb Max, 155C Rise

C[®] RU[®] US[®] SA[®] CE

DATE 0003 A1 A2 B1 B2 C1 C2

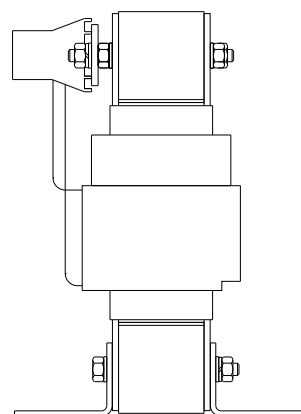

NOTE: A1, A2, B1, B2, C1, C2,
TERMINAL BLOCK
FOR REFERENCE ONLY.

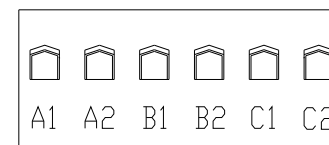

TERMINAL BLOCK
TORQUE(LB-IN)=CUSTOMER WIRE

35 = 1 AWG THRU 4 AWG
30 = 6 AWG THRU 14 AWG
25 = 16 AWG THRU 22 AWG

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED)		 W132 N10611 Grant Drive Germantown, WI 53022	
				DECIMAL			
				.XX ± .02			
				.XXX± .01			
				FRACTIONAL		TRAP REACTOR	
A				± 1/32		KTR15C65HG	
				ANGULAR		DRN BY DSW DATE 2/2/05 DWG NO 102376DG	
				± 1/2°		SCALE TO FIT SIZE C	
NO REVISION				DATE		BY	
2661 ADD CE				3/8/10		DSW	