

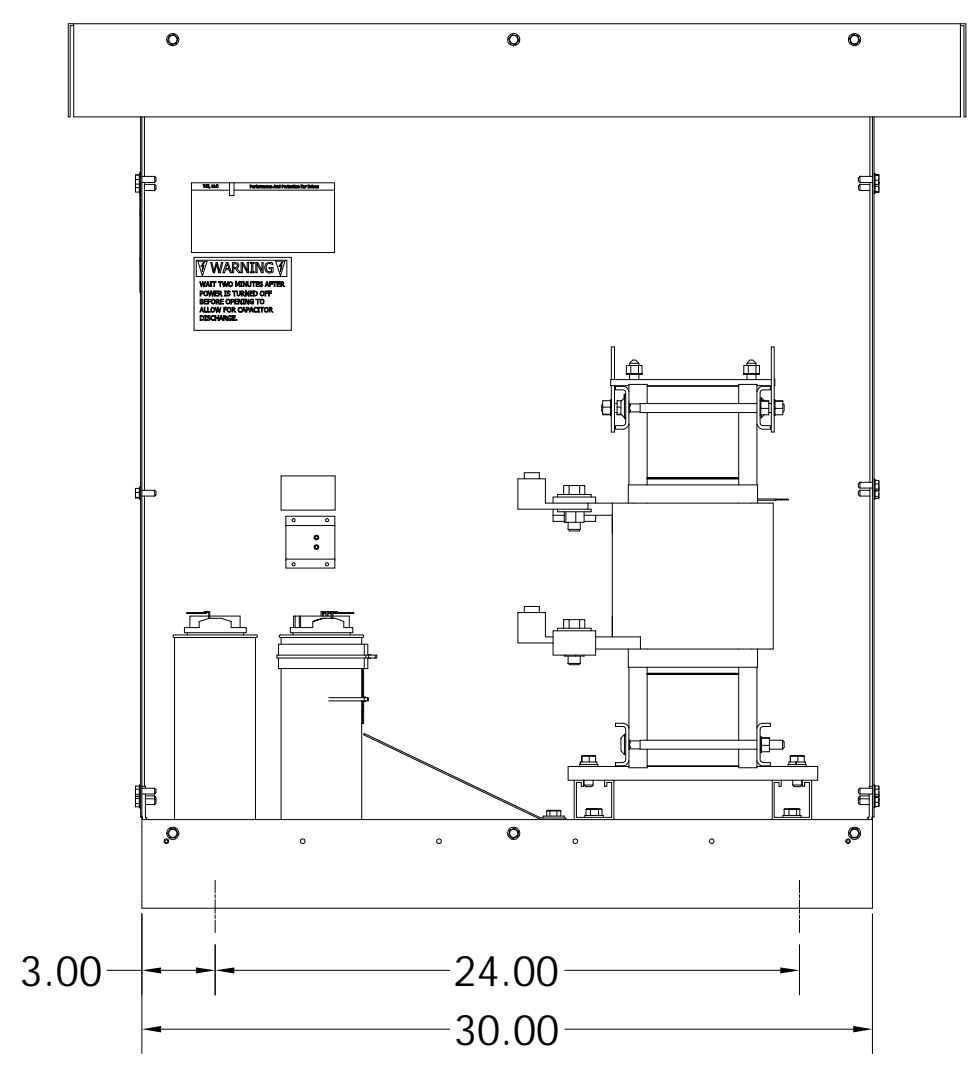
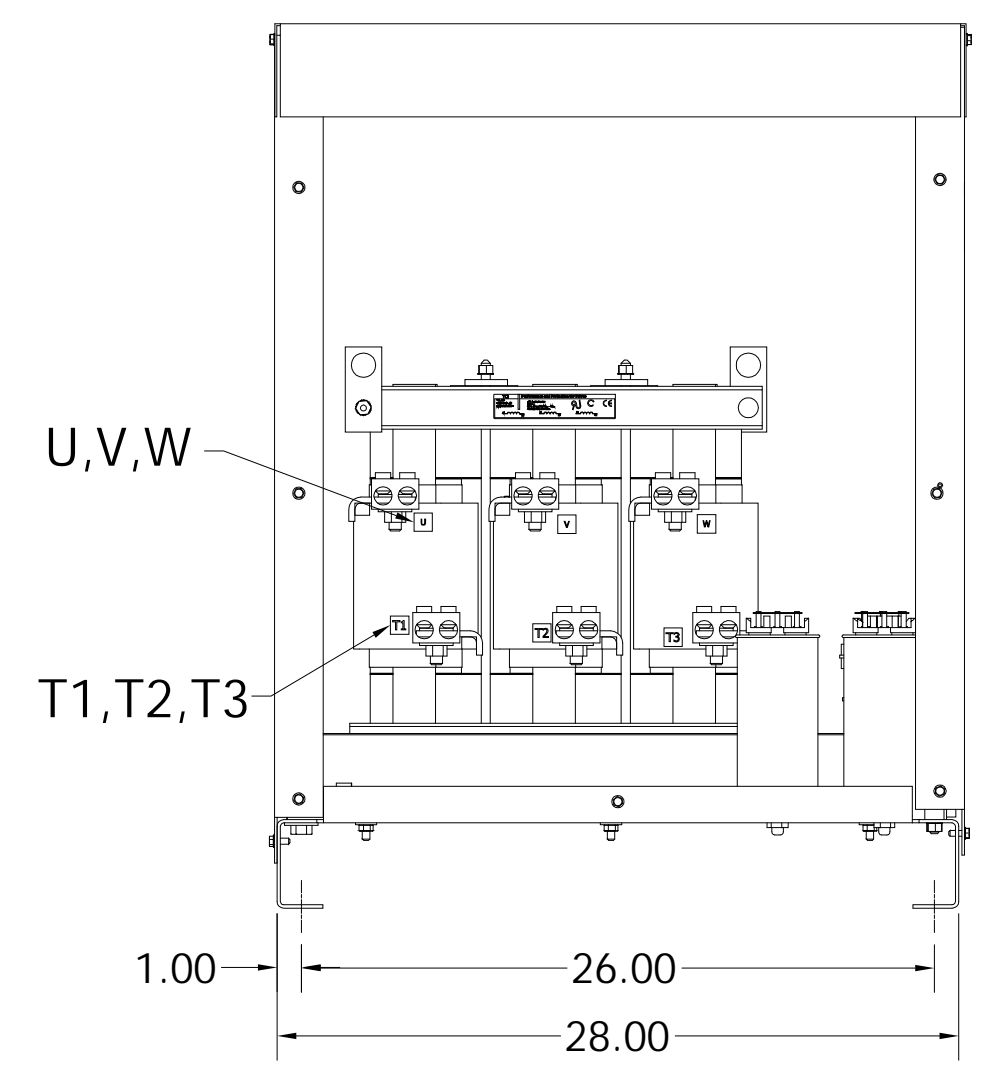
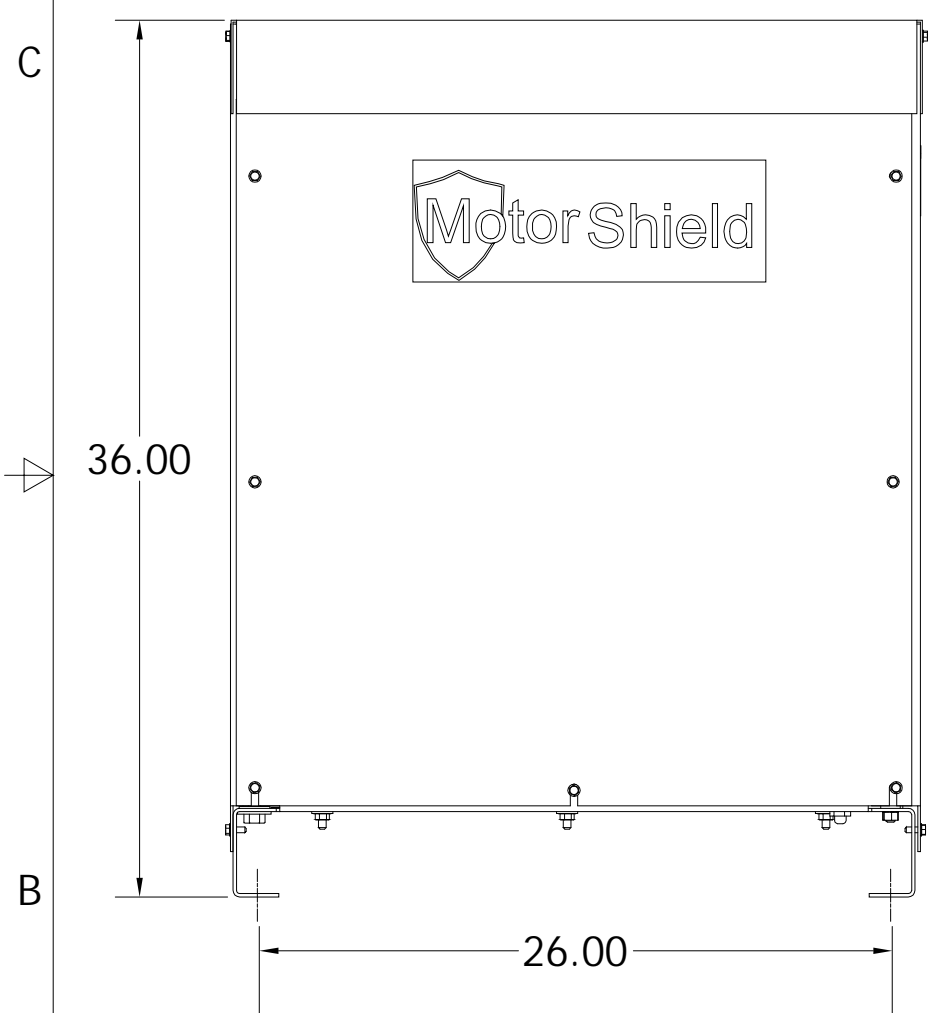
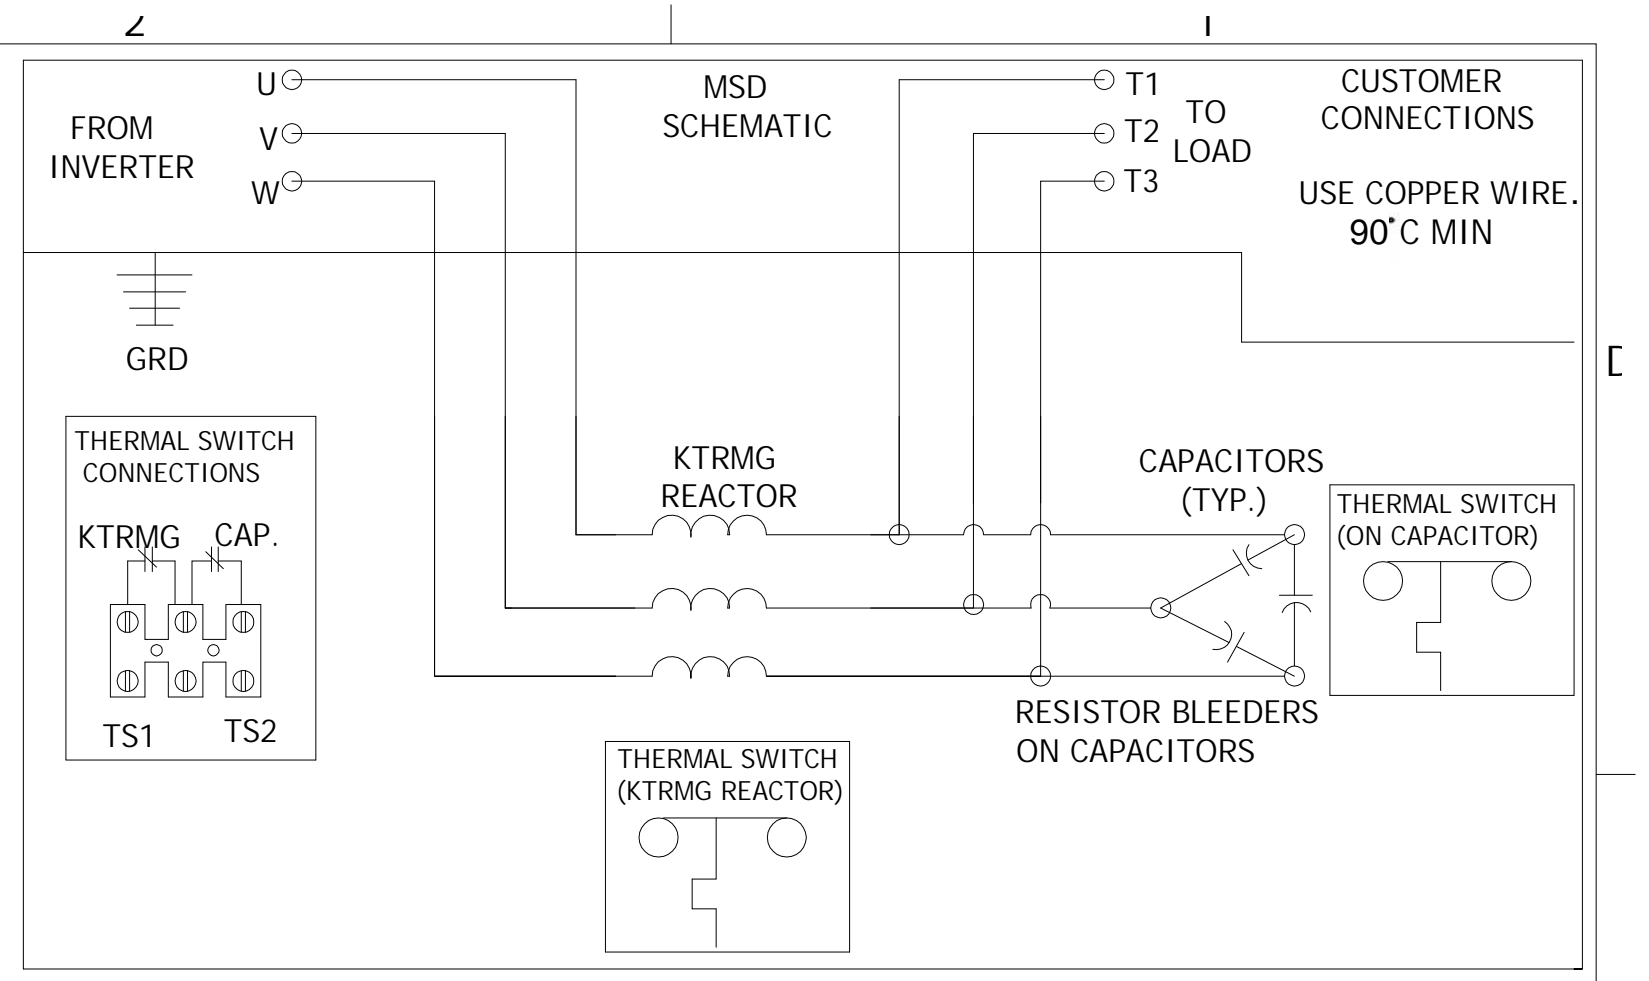


TERMINAL BLOCK ASSEMBLY, MOUNTED ABOVE CAPACITORS



NOTE: FOR TERMINAL TORQUE SEE IOM MANUAL.

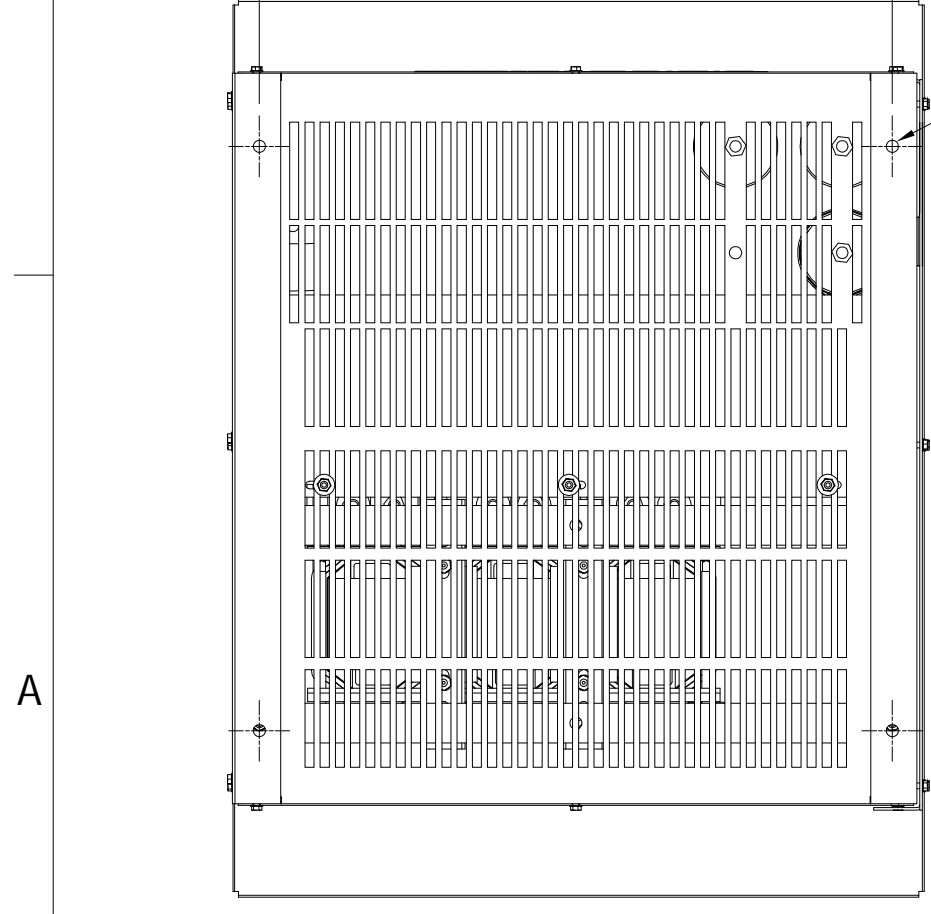

| MSD PART NUMBER | HP | VOLTAGE | CURRENT | WEIGHT | PRESSURE | TERMINAL WIRE RANGE |
|-----------------|-----|---------|----------|--------|----------|---------------------|
| MSD0362A300 | 300 | 480V | 362 AMPS | 470LBS | (2) | 350MCM-6AWG |
| MSD0420A300 | 350 | 480V | 420 AMPS | 575LBS | (2) | 600MCM-4AWG |

CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

| | | | | | | | |
|----------------------------|----------|------|----|------------------------------|-----|--|--|
| | | | | TOLERANCES (EXCEPT AS NOTED) | | TCI ® W132 N10611 Grant Drive Germantown, WI 53022 | |
| | | | | DECIMAL | | | |
| | | | | .XX +/- .25 .XXX +/- .10 | | | |
| | | | | FRACTIONAL | | MSD 362 AMPS TO 420 AMPS MotorShield Sinewave Filter 480/3/60, Type 1/3R. | |
| B 3696 ADD DISCHARGE LABEL | | | | 7/29/16 | DSW | | |
| A AS BUILT | | | | 5/19/15 | DSW | DWG. No.: 105799DG SHEET 1 OF 1 | |
| NO | REVISION | DATE | BY | ANGULAR | | | |
| | | | | +/- 1° | | | |