


CUSTOMER CONNECTIONS  
INTO SINEWAVE FILTER


CUSTOMER  
CONNECTIONS

USE COPPER WIRE  
60°C MIN <100 A.  
75°C MIN ≥100 A.

POWER SCHEMATIC

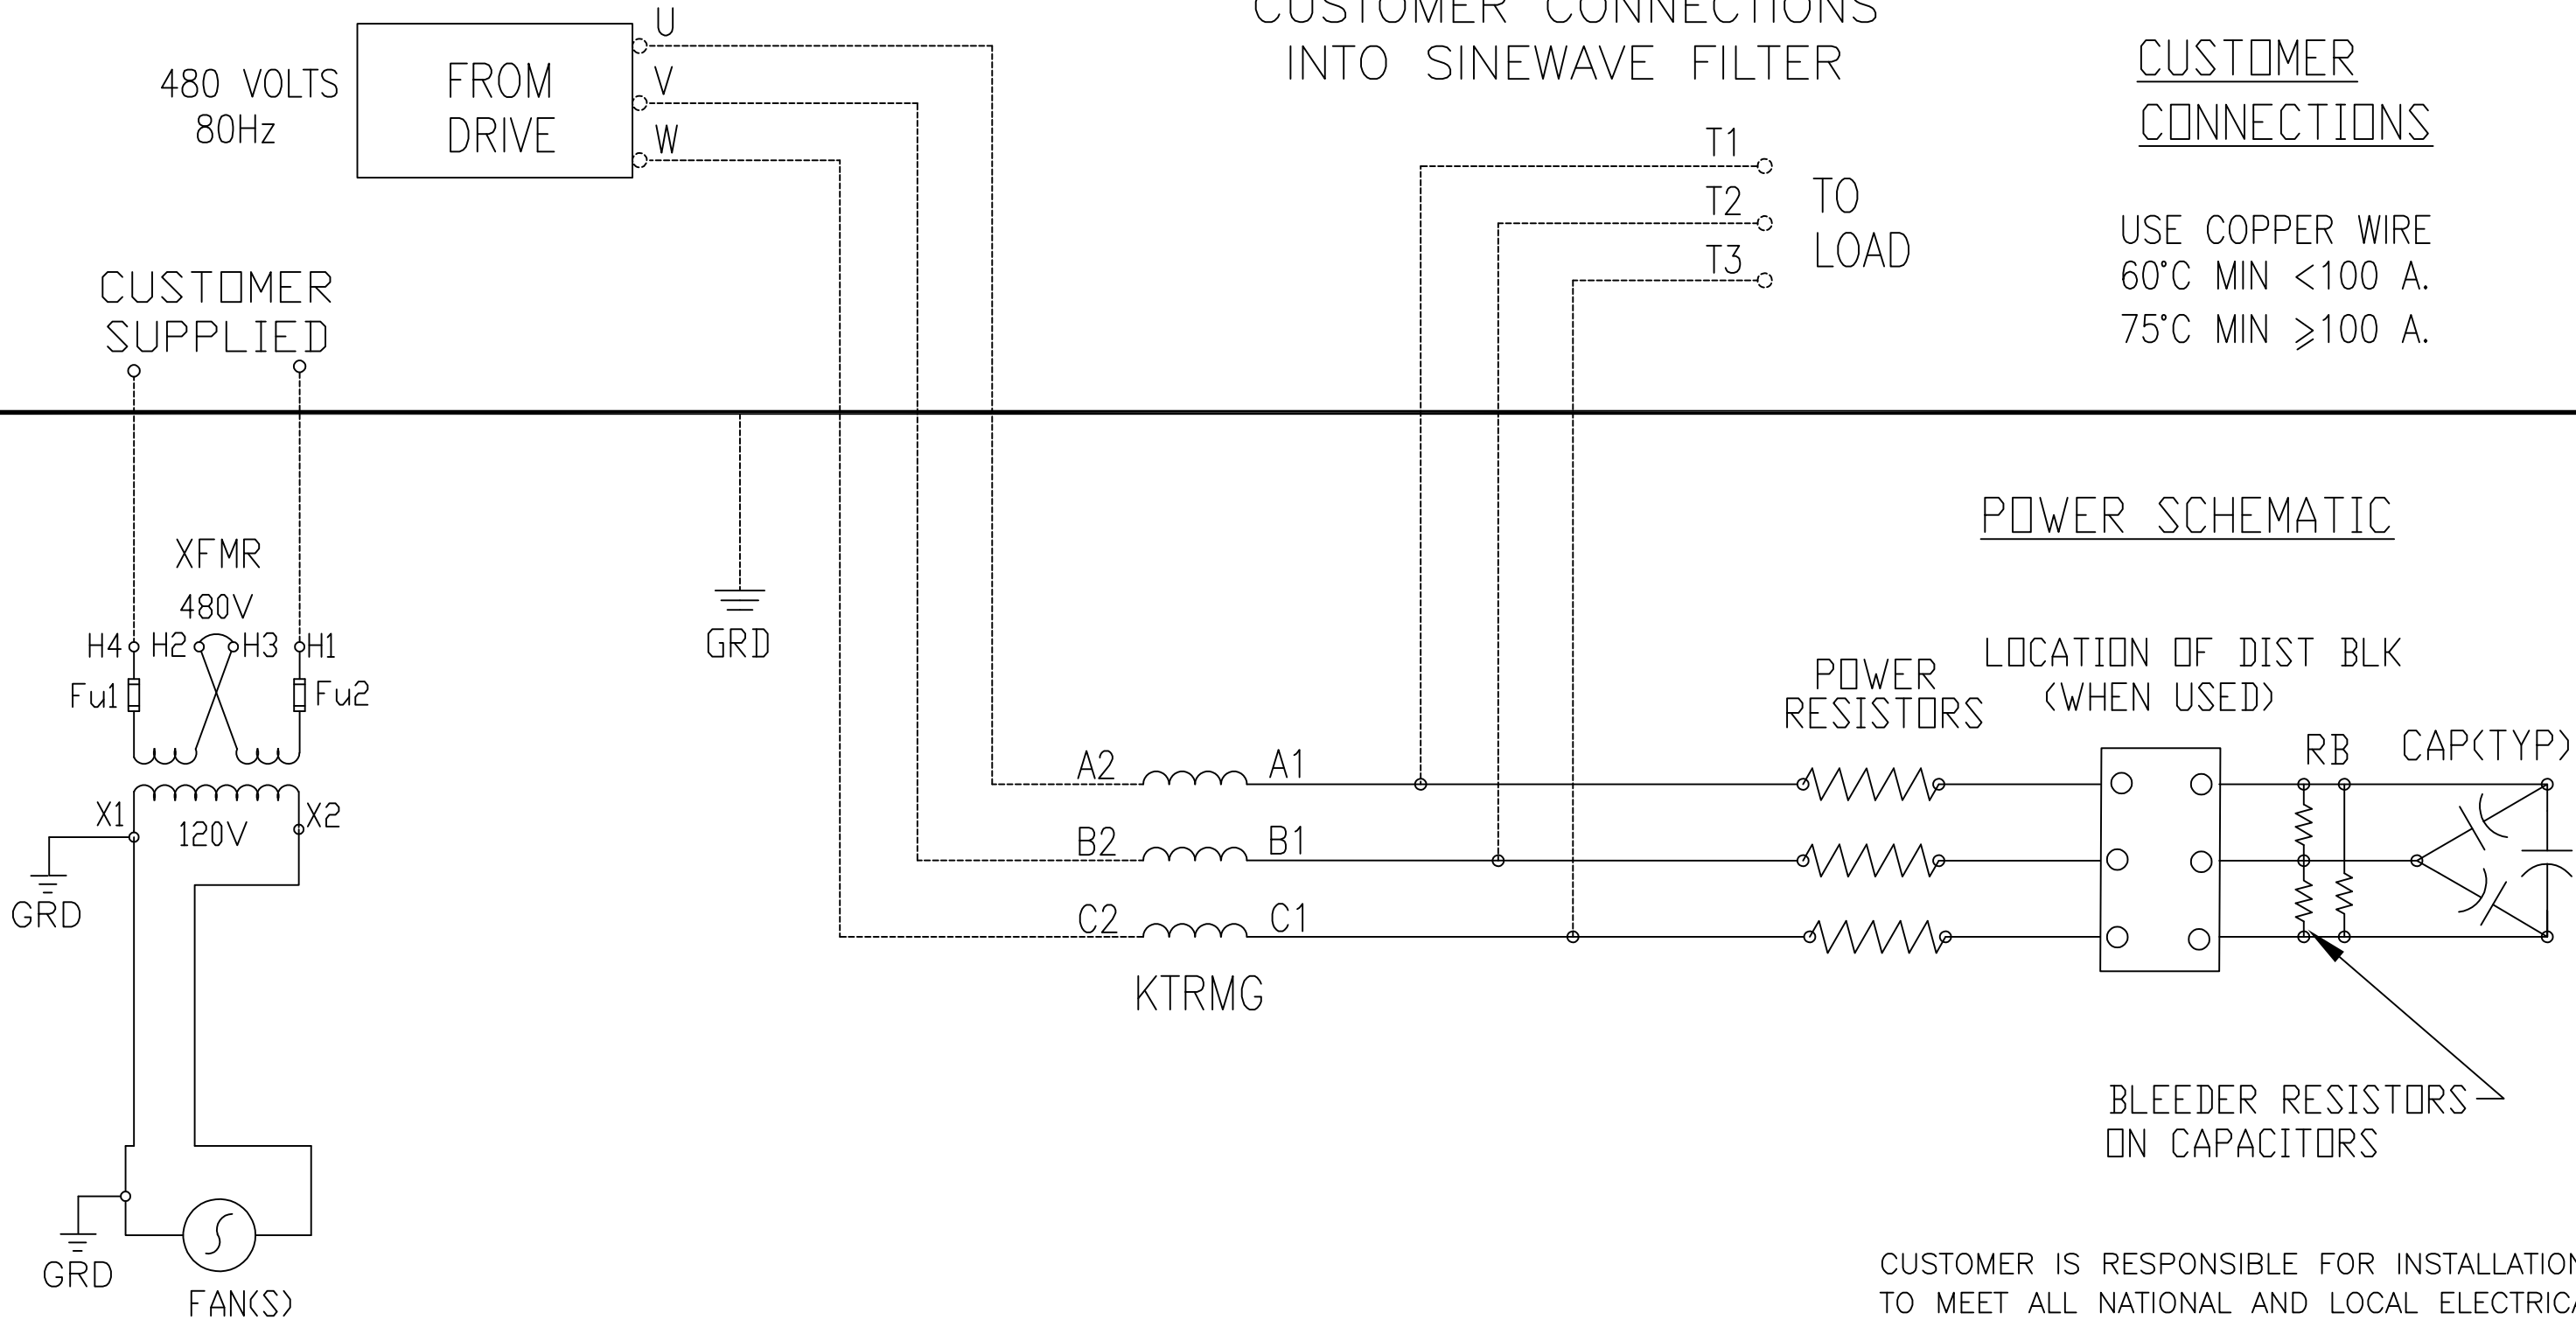

CUSTOMER IS RESPONSIBLE FOR INSTALLATION  
TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES

				TOLERANCES (EXCEPT AS NOTED)	 W132 N10611 Grant Drive Germantown, WI 53022
				DECIMAL	
				.XX ± .03 .XXX ± .010	
				FRACTIONAL ± 1/16	
A	4117 DRAWING UPDATE	9/13/17	JSM	ANGULAR ± 1/2°	DRN. BY DSW DATE 08/06/08 SCALE 1/8"=1"
NO	REVISION	DATE	BY		DWG. NO. B 26736 SHT. 1 OF 1