

480V.  
60 HZ.  
LINE


FUSED DISCONNECT  
OR CIRCUIT BREAKER  
(CUSTOMER SUPPLIED)

CUSTOMER CONNECTIONS


T1  
T2 LOAD  
T3

CUSTOMER CONNECTIONS  
75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE  
ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE


FACTORY POWER CONNECTIONS

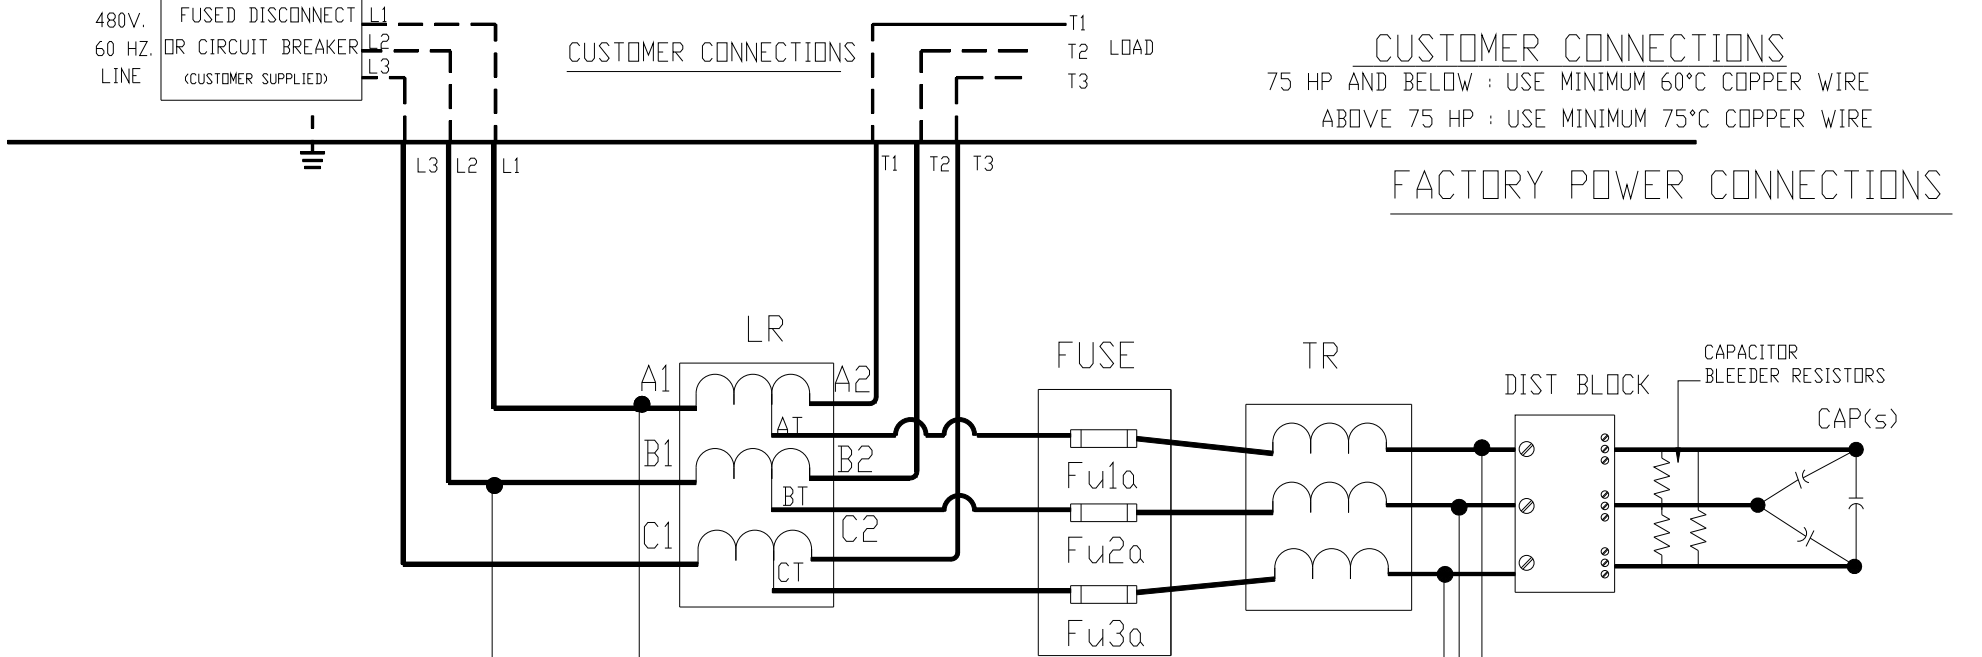

CONTROL CONNECTIONS

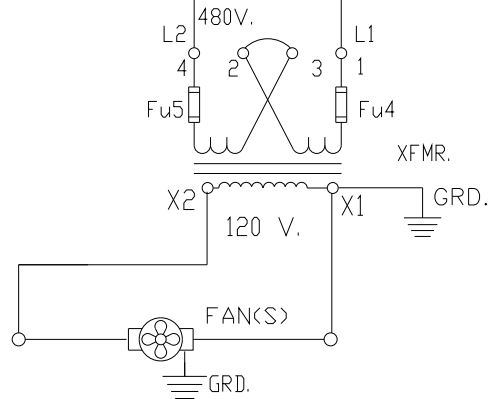

CONNECTIONS FOR  
FUSE MONITOR  
OPTION

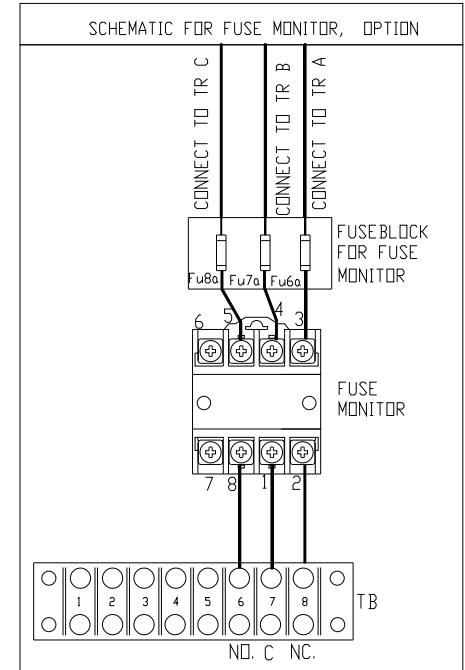

<p>TCL, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCL AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCL.</p>				TOLERANCES (EXCEPT AS NOTED): DECIMAL .XX ± N/A	W132 NI0611 Grant Drive Germantown, WI 53022	
	B	3178 MOVE MONITOR CONNECTION	9/4/14	DSW		.XXX ± N/A
	A	3088 MONITOR UPDATE			DSW	FRACTIONAL ± N/A
	A	SWITCH PHASE A TO C	4/25/14	DSW	ANGULAR ± N/A	<p>DRN BY: DSW DATE: 11/11/13 DWG. NO: 28697-5S</p> <p>SCALE: NONE SIZE: C</p>
	NO	REVISION	DATE	BY	SCALE	<p>SHT. 1 of 1</p>