



CUSTOMER CONNECTIONS

75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE  
 ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE

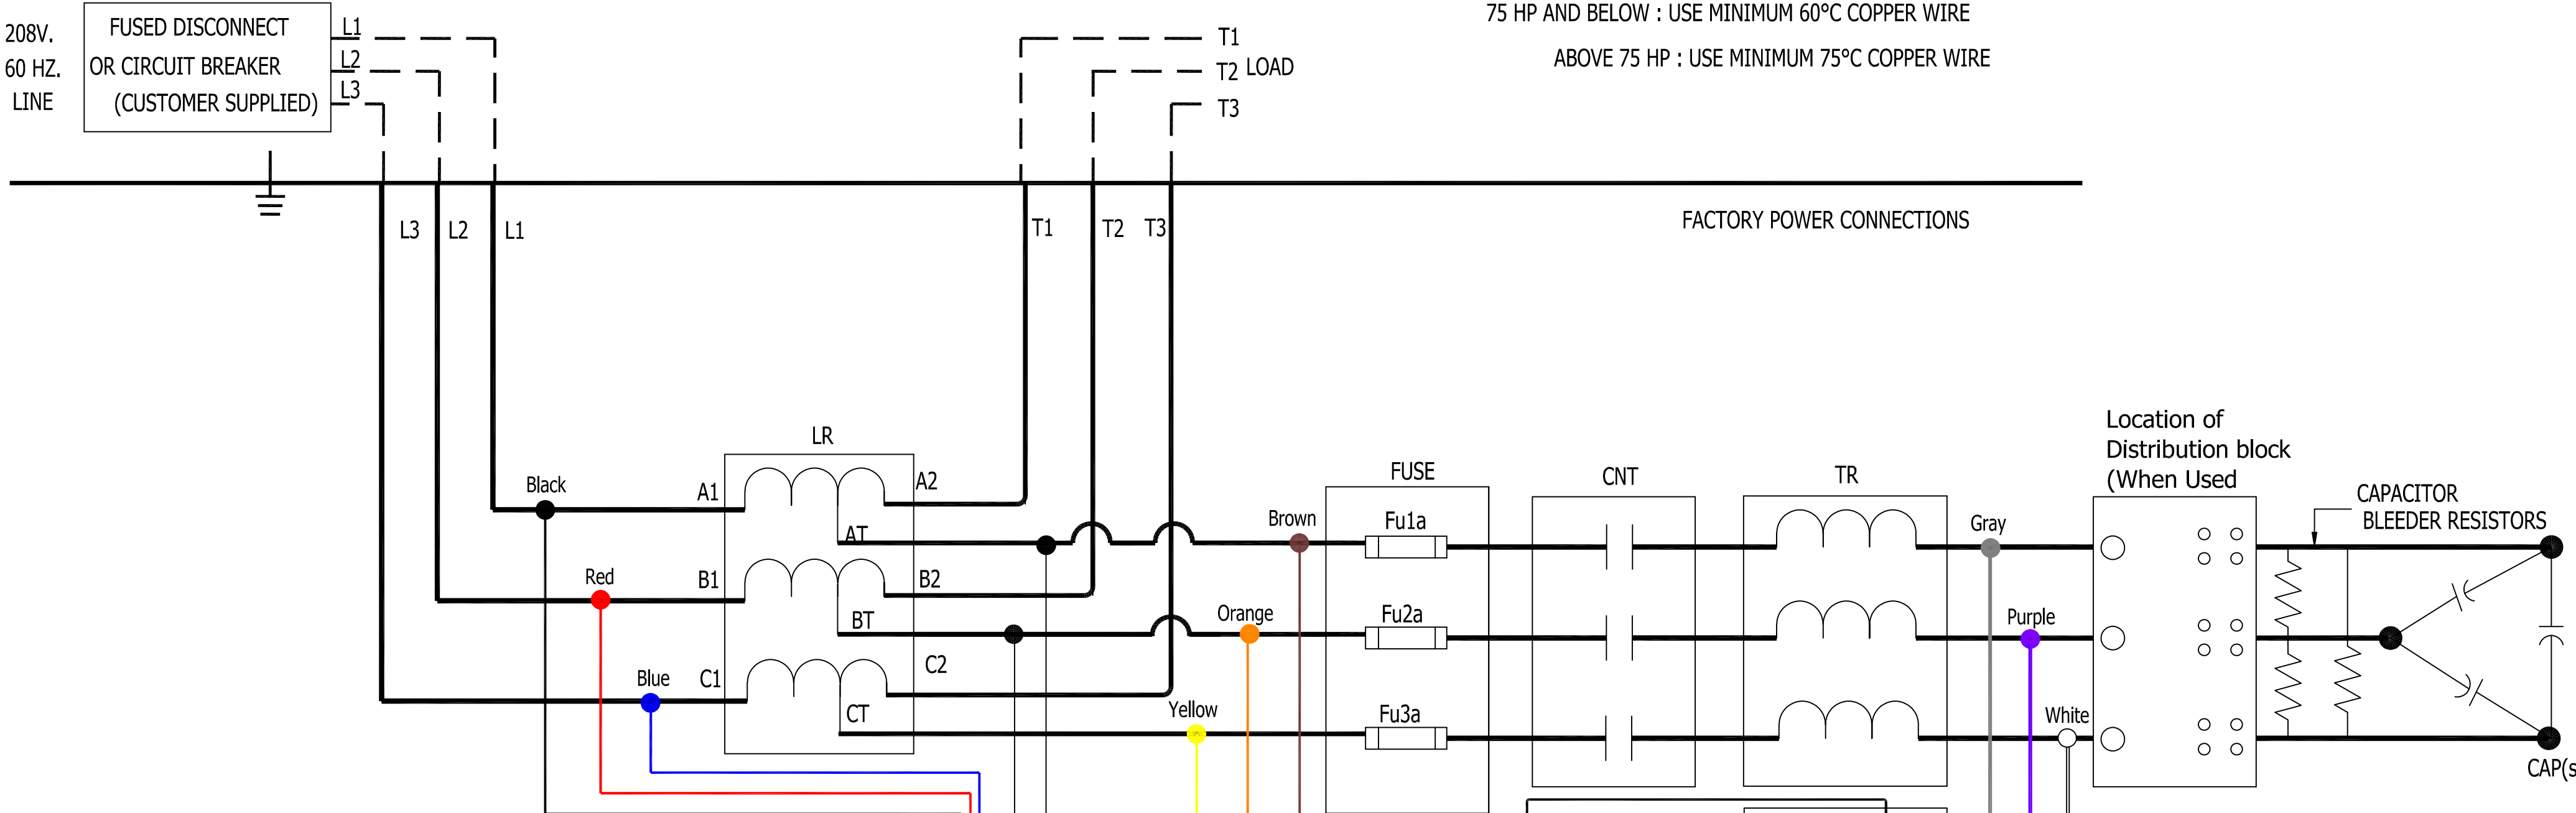

CONTROL CONNECTIONS

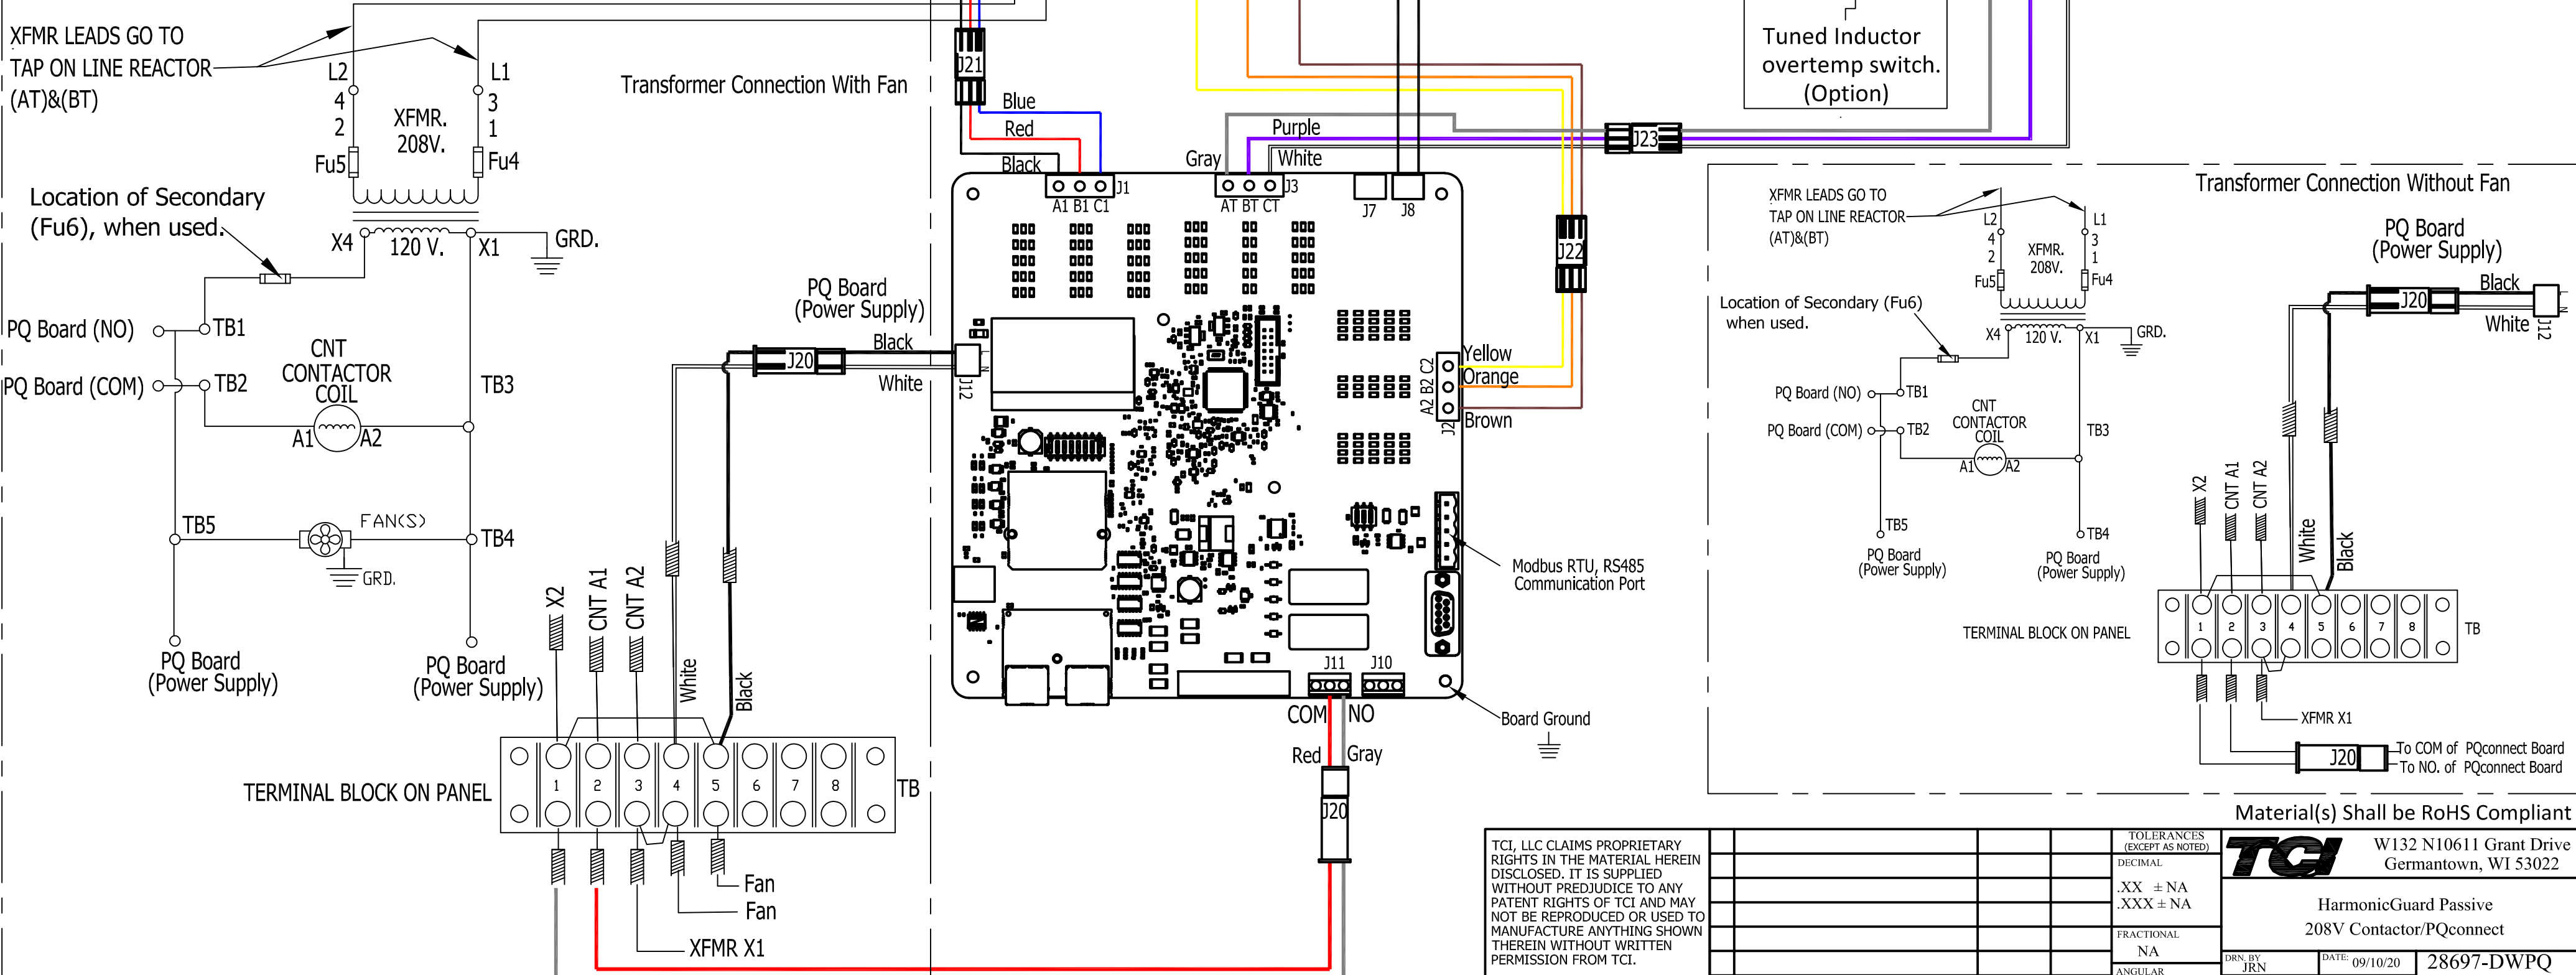

Material(s) Shall be RoHS Compliant

TCL, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCL AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCL.

NO	REVISION	DATE	BY	TOLERANCES (EXCEPT AS NOTED)
				DECIMAL
				.XX ± NA
				.XXX ± NA
				FRACTIONAL
				NA
				ANGULAR
				NA

W132 N10611 Grant Drive  
 Germantown, WI 53022

**HarmonicGuard Passive**  
 208V Contactor/PQconnect

DRN: JRN DATE: 09/10/20 28697-DWPQ  
 SCALE: NA APRVD: C SIZE: C SHT. 1 OF 1