


600V, 60 HZ, LINE  
 FUSED DISCONNECT OR CIRCUIT BREAKER (CUSTOMER SUPPLIED)

CUSTOMER CONNECTIONS

CUSTOMER CONNECTIONS

75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE  
 ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE

FACTORY POWER CONNECTIONS

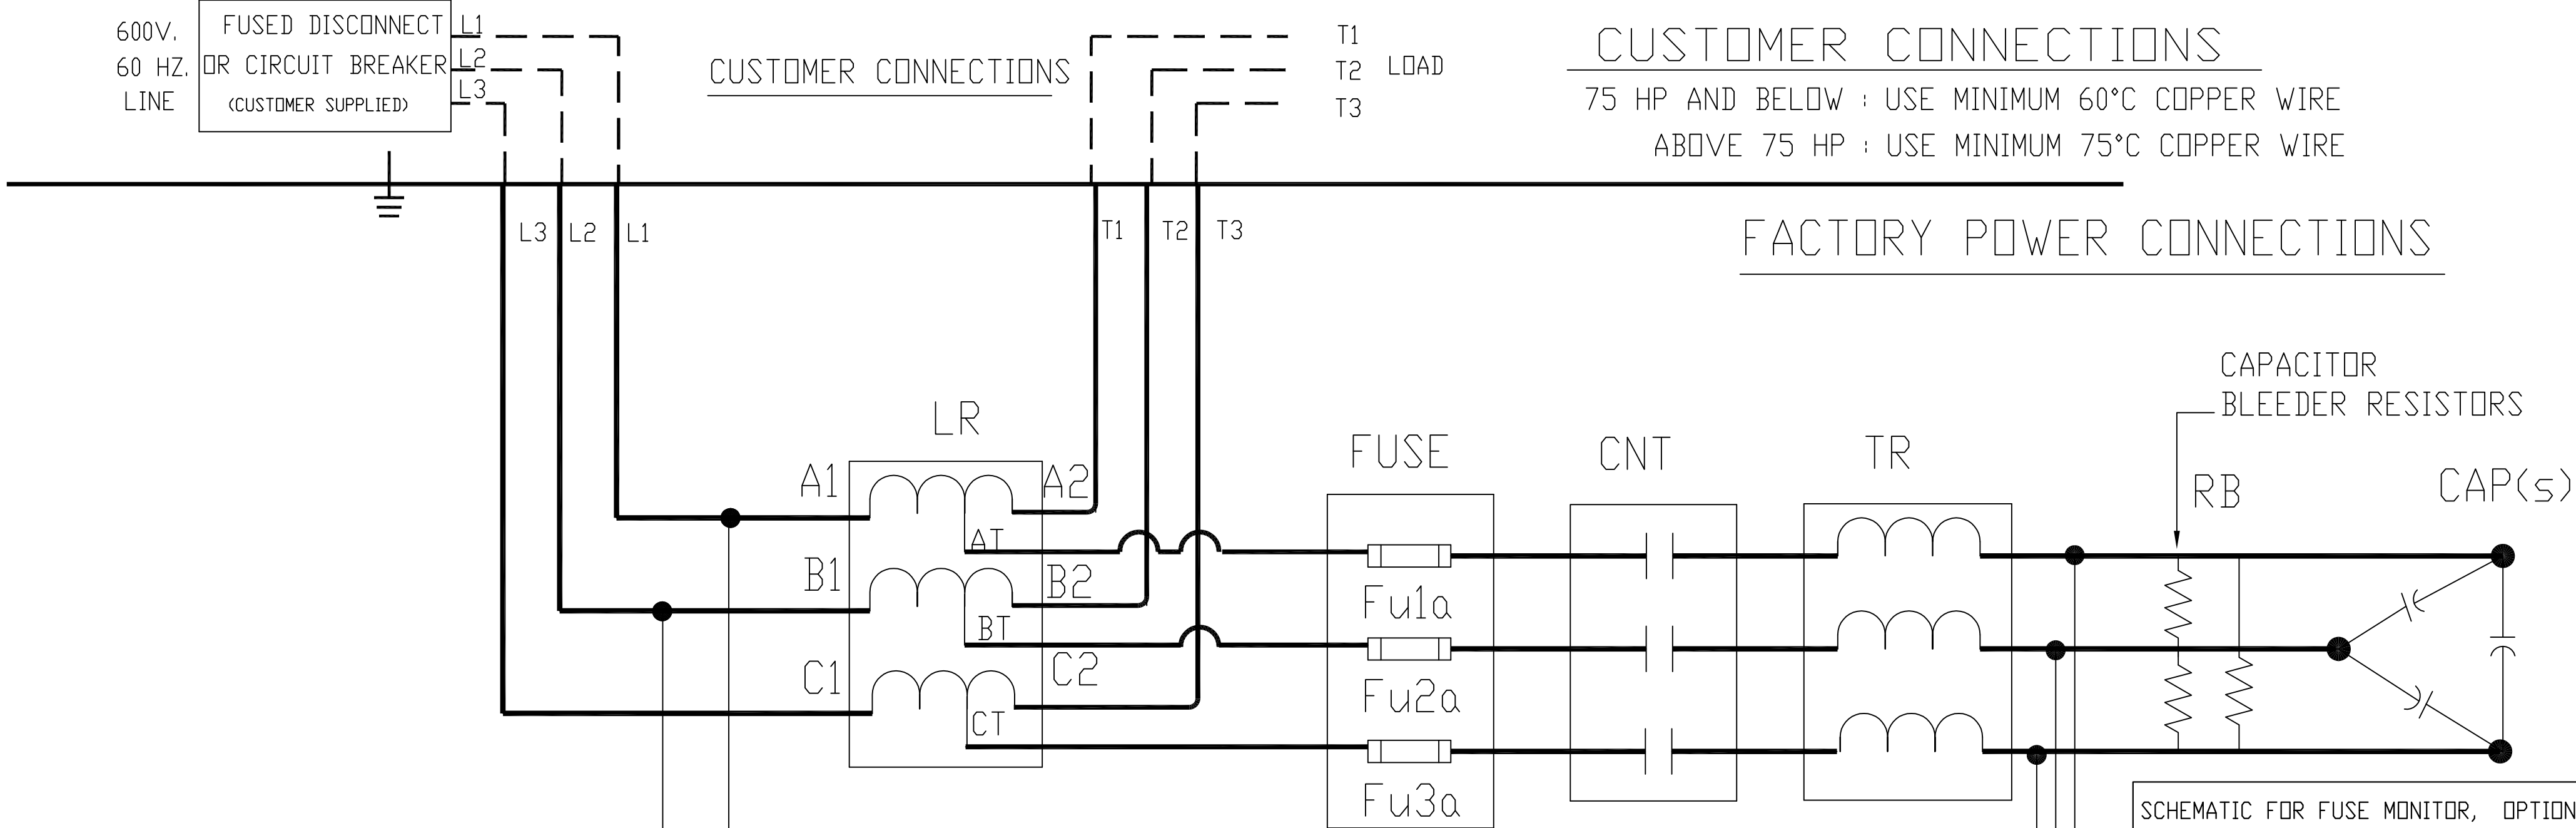


SCHEMATIC FOR FUSE MONITOR, OPTION


CONTROL CONNECTIONS

NOTE 1:  
 FOR PROPER OPERATION  
 CONNECT AUXILIARY N.O.  
 RUN RELAY CONTACT  
 FROM DRIVE


LOCATION OF SECONDARY FUSING, IF PROVIDED.

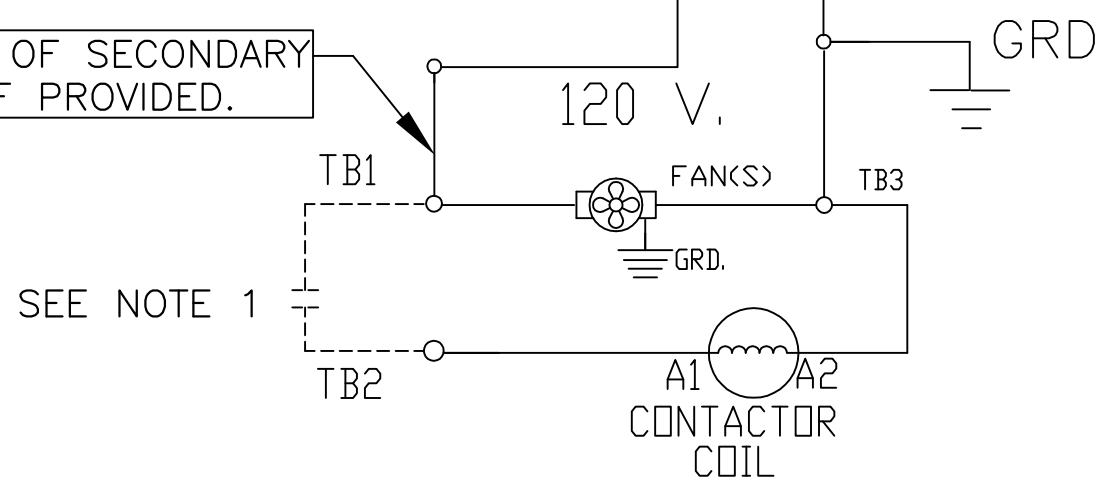

CONNECTIONS FOR FUSE MONITOR OPTION

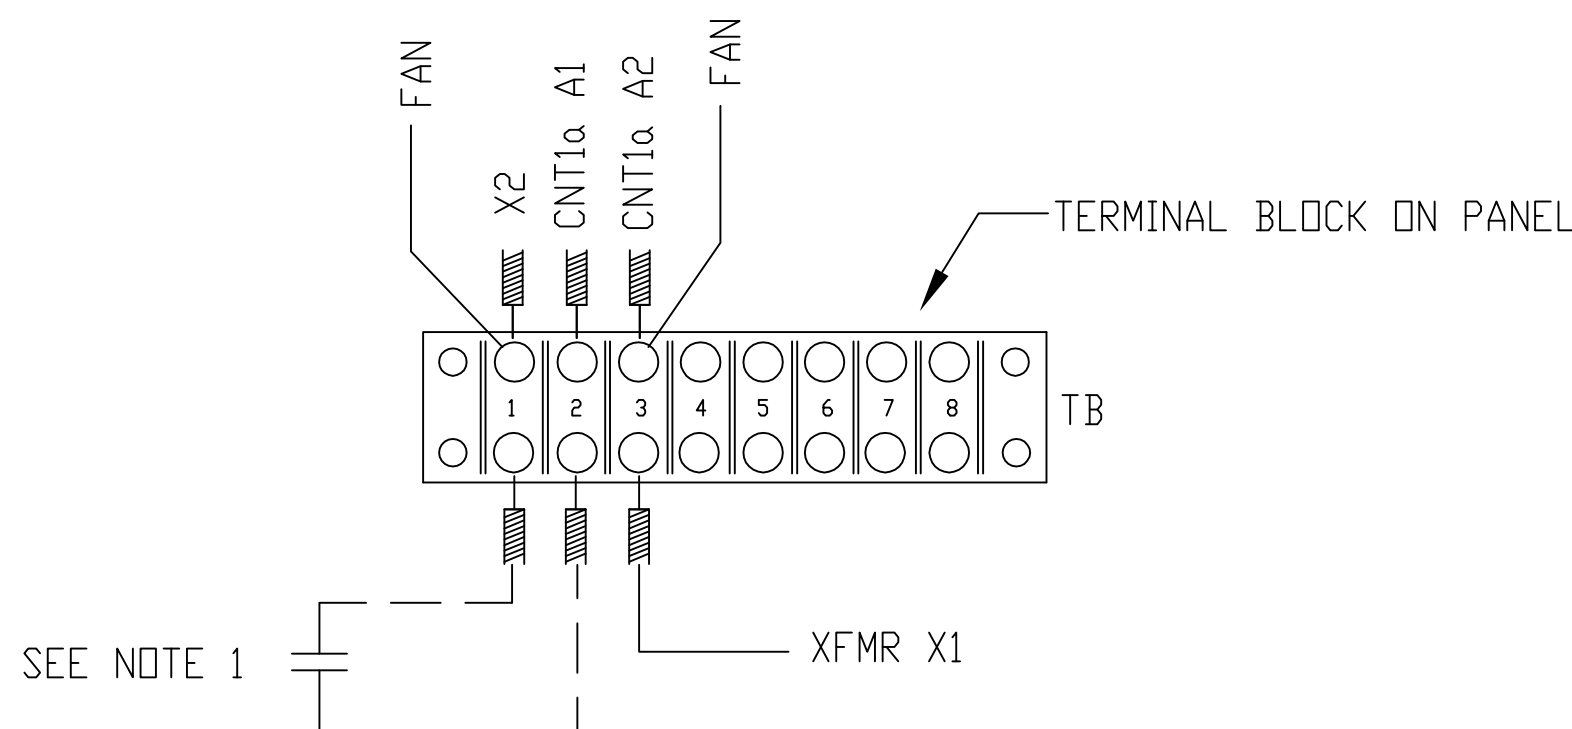

SEE NOTE 1

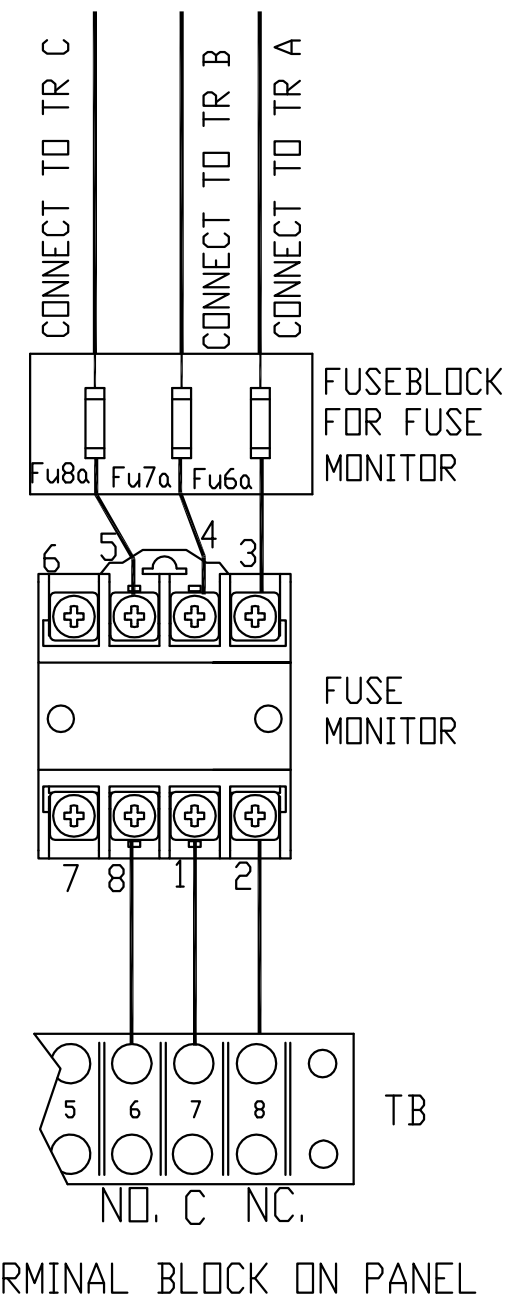

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.					TOLERANCES (EXCEPT AS NOTED)	W132 N10611 GRANT DRIVE GERMANTOWN, WI 53022 <b>HARMONICGUARD PASSIVE</b> 600V SCHEMATIC 15HP, 30HP TO 200HP, TYPE 3R WITH CONTACTOR DRN. BY DSW DATE 3/17/15 DVG. NO. 29474-5 SCALE NONE SIZE C SHT.1 OF1
					DECIMAL	
					.XX ± NA	
					.XXX ± NA	
					FRACTIONAL ± NA	
				ANGULAR ± NA		
NO	REVISION	DATE	BY			