

600V.  
60 HZ.  
LINE


FUSED DISCONNECT  
OR CIRCUIT BREAKER  
(CUSTOMER SUPPLIED)

CUSTOMER CONNECTIONS

CUSTOMER CONNECTIONS


75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE  
ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE

FACTORY POWER CONNECTIONS

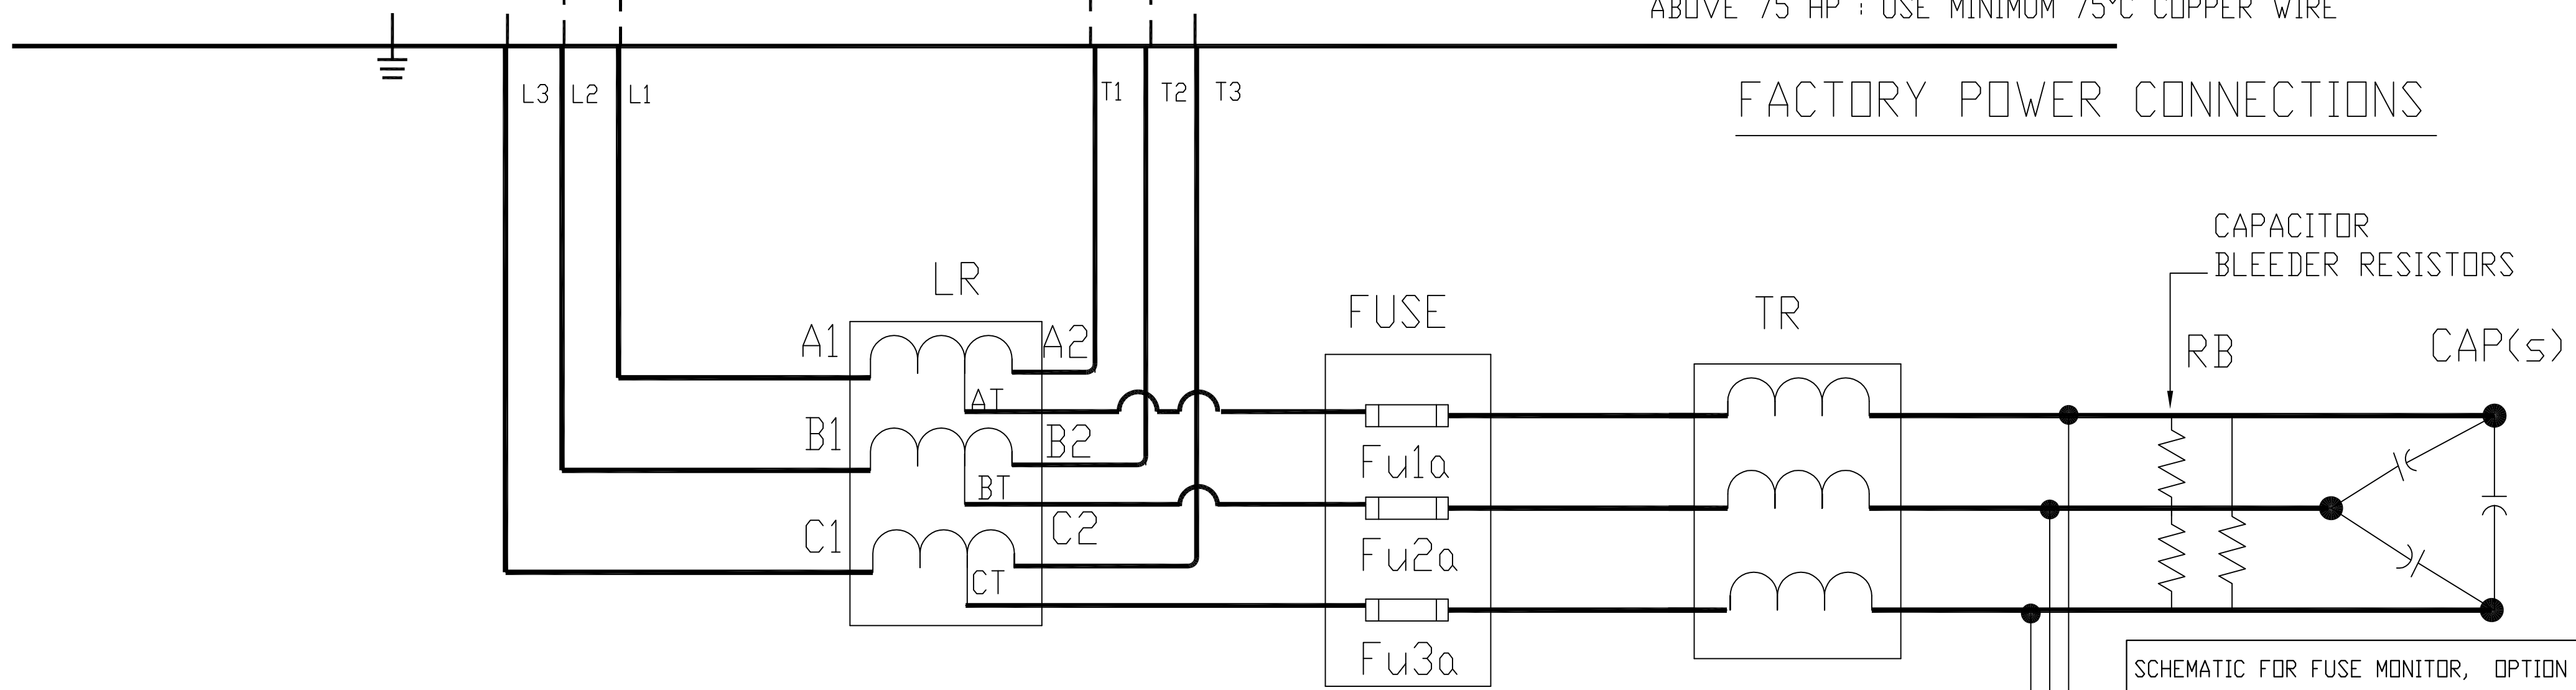

SCHEMATIC FOR FUSE MONITOR, OPTION

CONNECTIONS FOR  
FUSE MONITOR  
OPTION

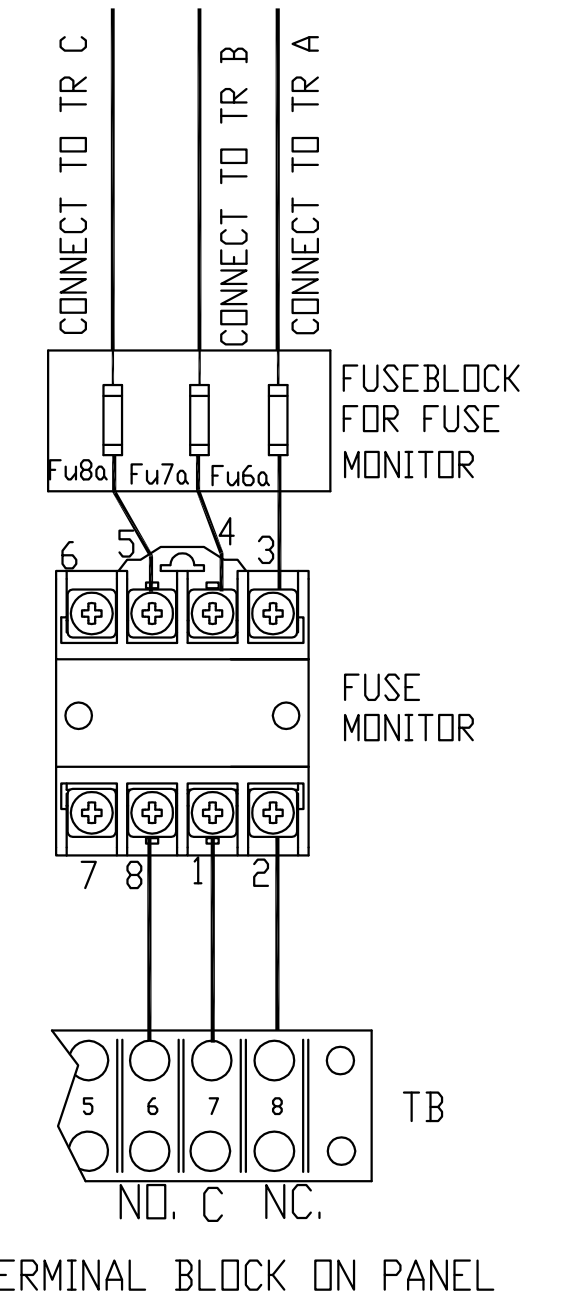

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.					TOLERANCES (EXCEPT AS NOTED)	W132 N10611 GRANT DRIVE GERMANTOWN, WI 53022 <b>HARMONICGUARD PASSIVE</b> 600V SCHEMATIC 15HP, 30HP TO 150HP, OPEN 15HP, 30HP TO 150HP, TYPE1	
					DECIMAL		DRN BY DSW DATE 3/17/15 DWG. NO. 29474
					.XX ± NA		SCALE NONE SIZE C
					.XXX ± NA		
					FRACTIONAL ± NA		SHT.1 of 1
				ANGULAR ± NA			
	NO	REVISION	DATE	BY			