

480V.
60 HZ.
LINE

FUSED DISCONNECT
OR CIRCUIT BREAKER
(CUSTOMER SUPPLIED)


CUSTOMER CONNECTIONS

T1
T2 LOAD
T3

CUSTOMER CONNECTIONS



75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE
ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE

FACTORY POWER CONNECTIONS

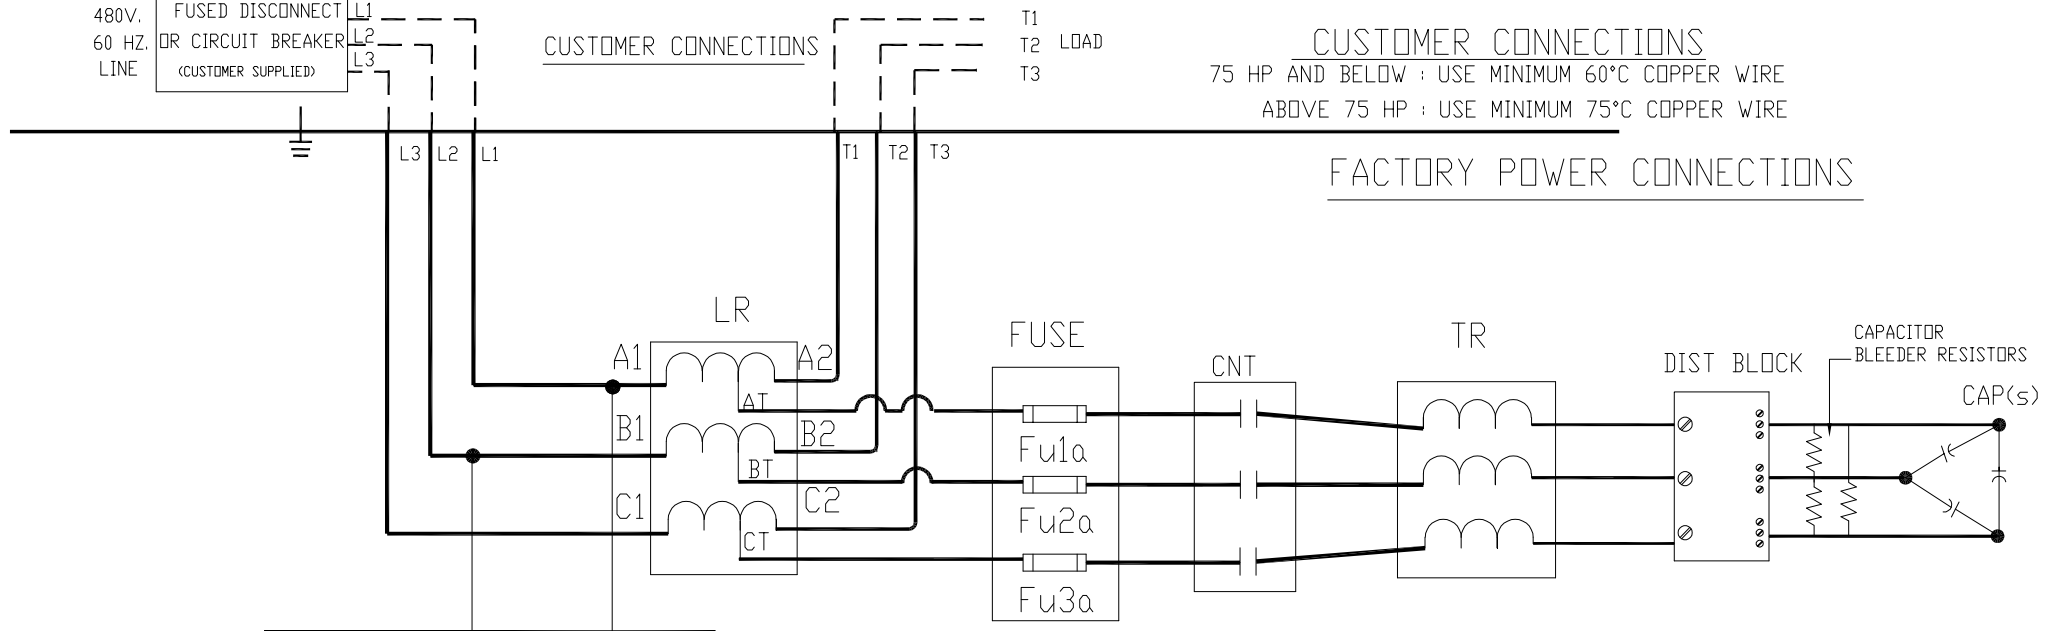

CONTROL CONNECTIONS

NOTE 1:
FOR PROPER OPERATION:
CONNECT AUXILIARY N.O.
RUN RELAY CONTACT
FROM DRIVE

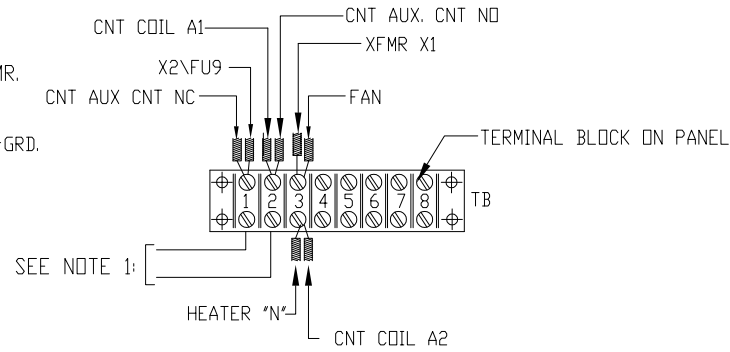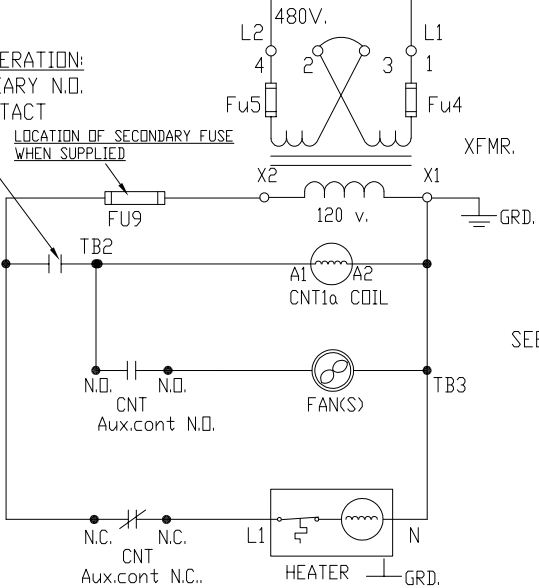

Material(s) Shall be RoHS Compliant

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED, IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED)	W132 N10611 Grant Drive Germantown, WI 53022 HarmonicGuard Passive 480V Contactor/800W Heater	
				DECIMAL		.XX ± NA .XXX ± NA
				FRACTIONAL		NA
				ANGULAR		NA
A	As Designed	11/18/20	DW	REV. BY DSW	DATE 11/18/20	29597-H
NO	REVISION	DATE	BY	SCALE NA	APPROV. C	SIZE C